


PC-7121-63-67-1012 & 2012

OPEN VALVE


TORQUE 904 LB.-FT.
BHP 303 @ SPGR 0.44
GPM 26,500 HEAD 70

CLOSED VALVE

TORQUE _____ LB.-FT.
BHP _____ @ SPGR _____

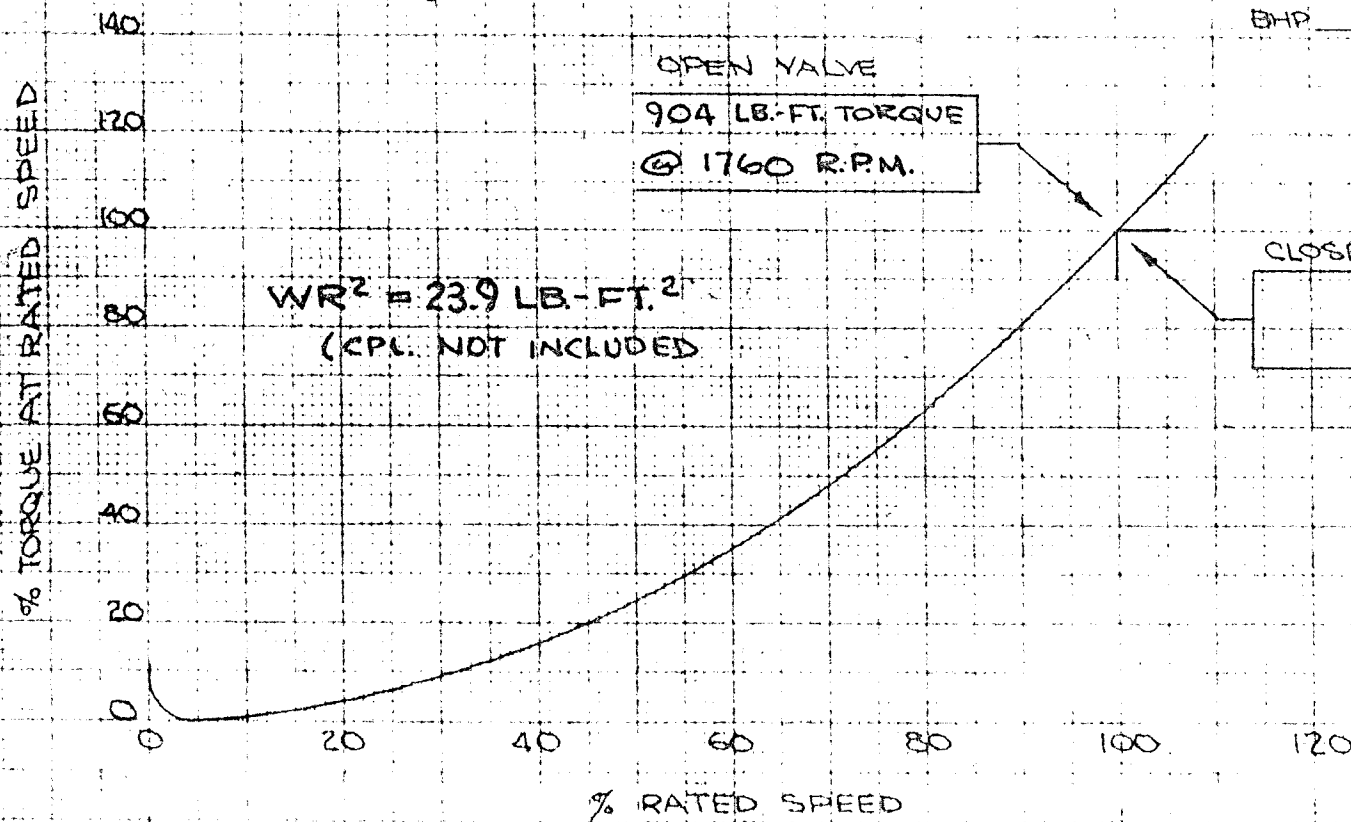

ENGINEERING DATA
FILE COPY

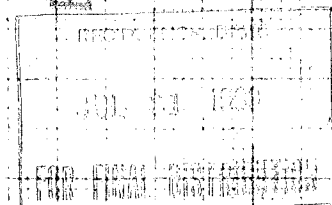

SPEED-TORQUE CURVE

PHILLIPS PETROLEUM CO.
REACTOR CIRCULATOR
PUMP No 290399/400

CHARACTERISTIC CURVE SHEET
BINGHAM PUMP CO.
2800 N. W. FRONT AVE

IMPELLER
MAX
DIA 19
M.T.

20 x 20 HLTE

PUMP

DIA IMPELLER
18 3/4

IMPELLER PATL
2413 HLTL-1

1760 R.P.M.

27203