

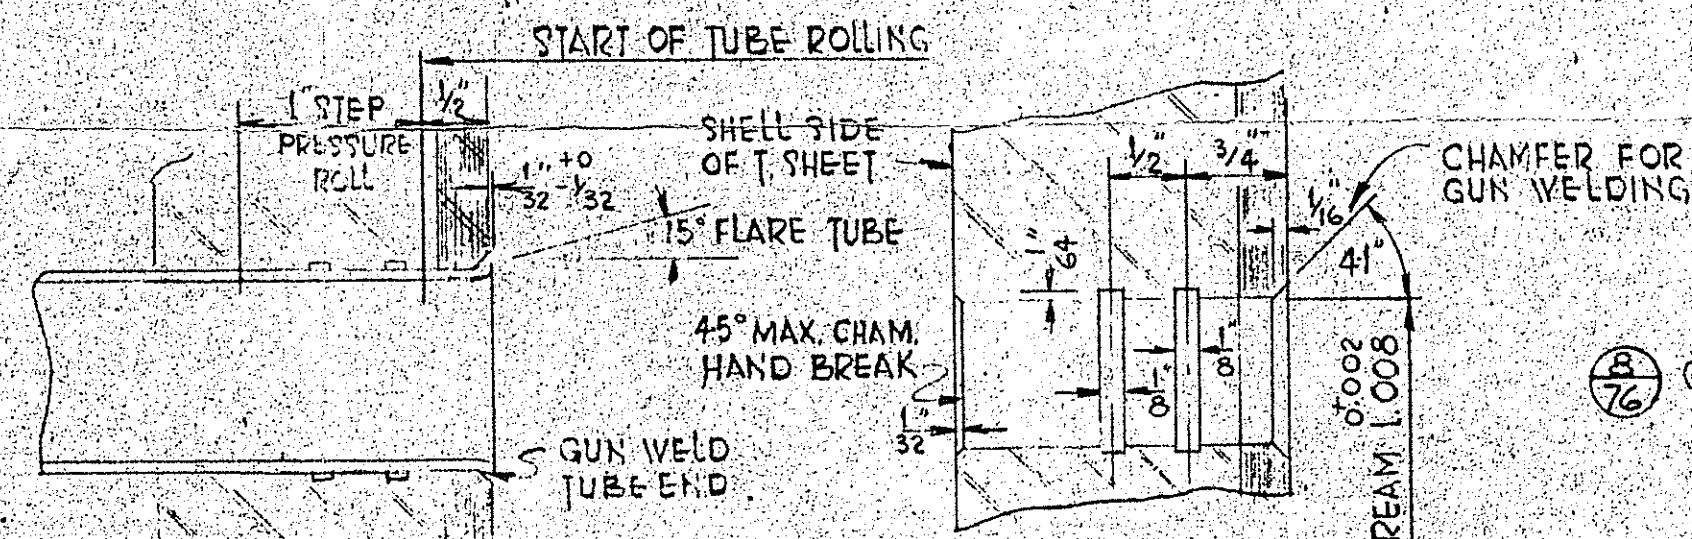
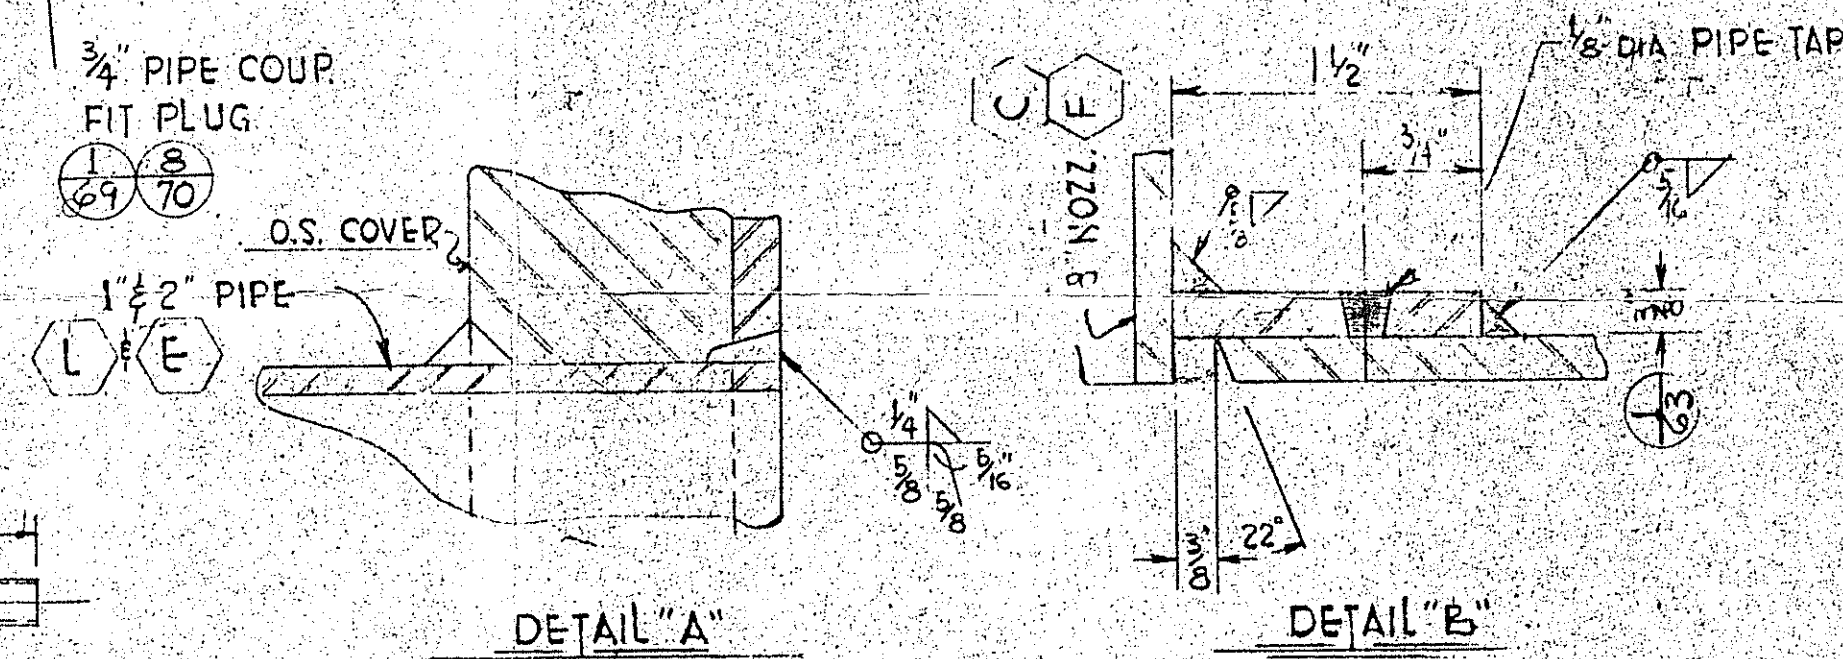
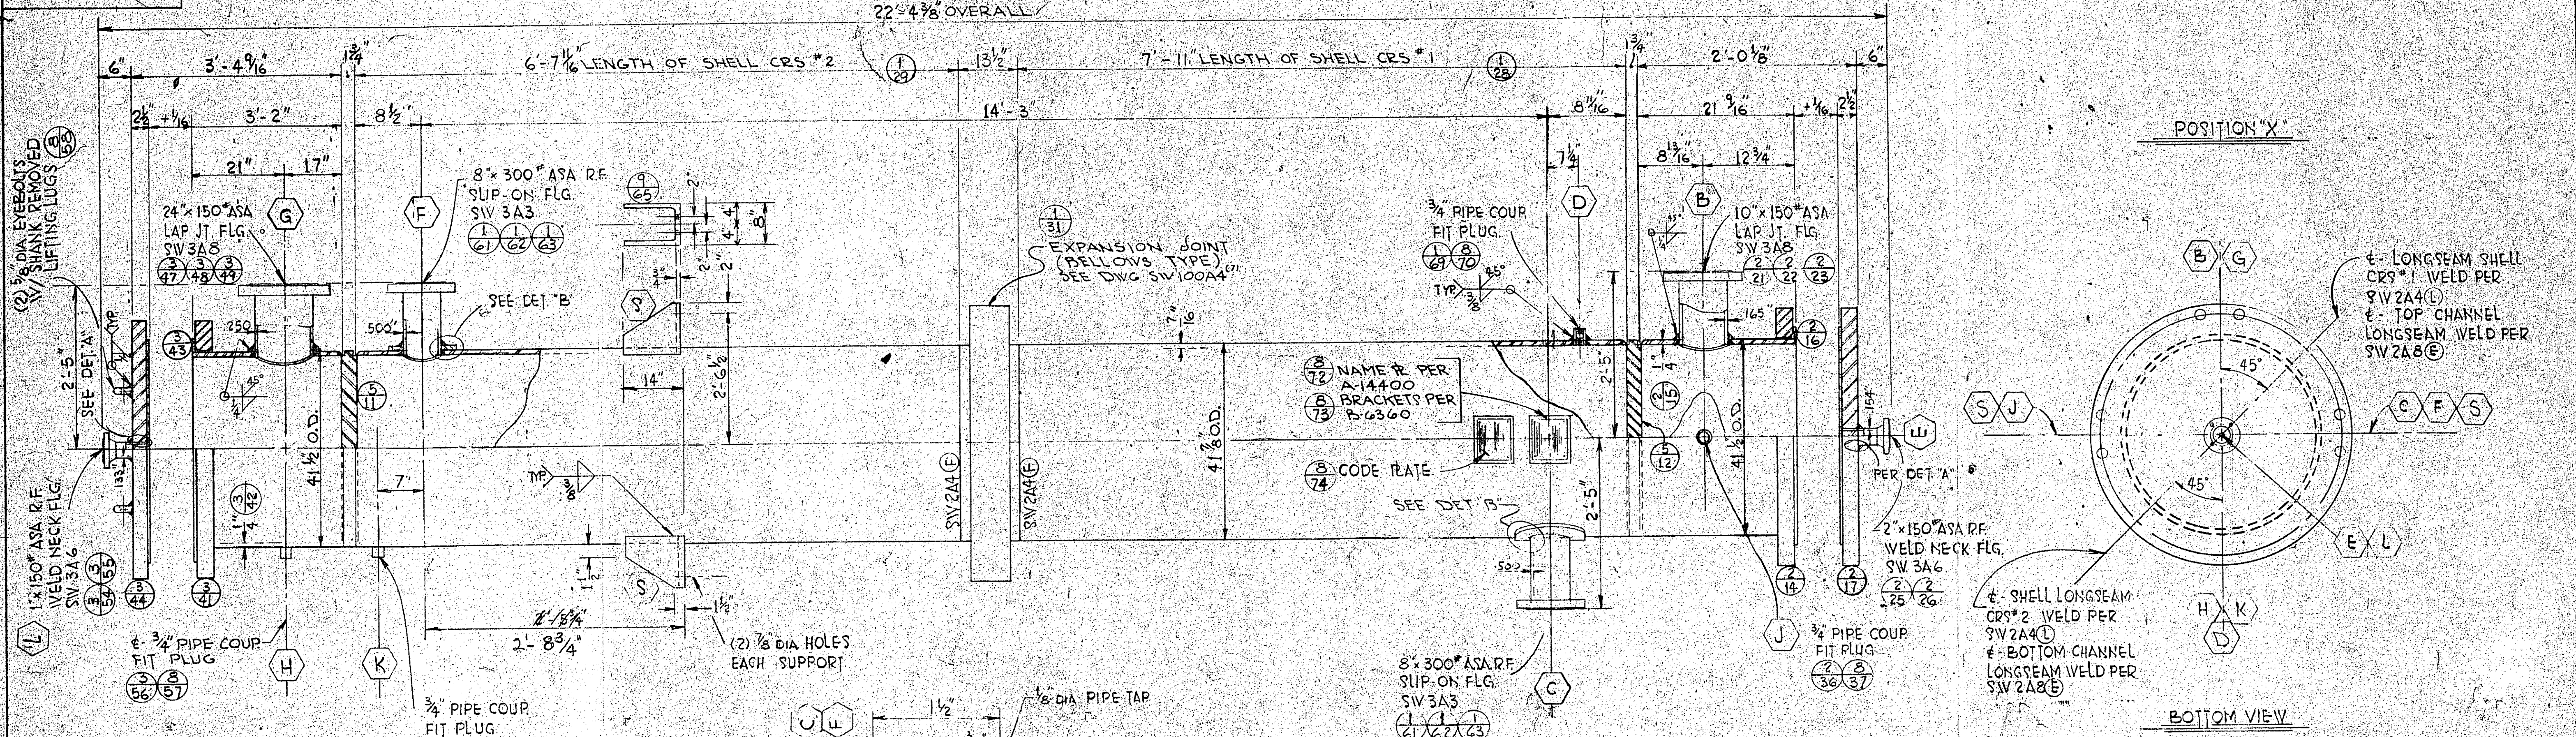
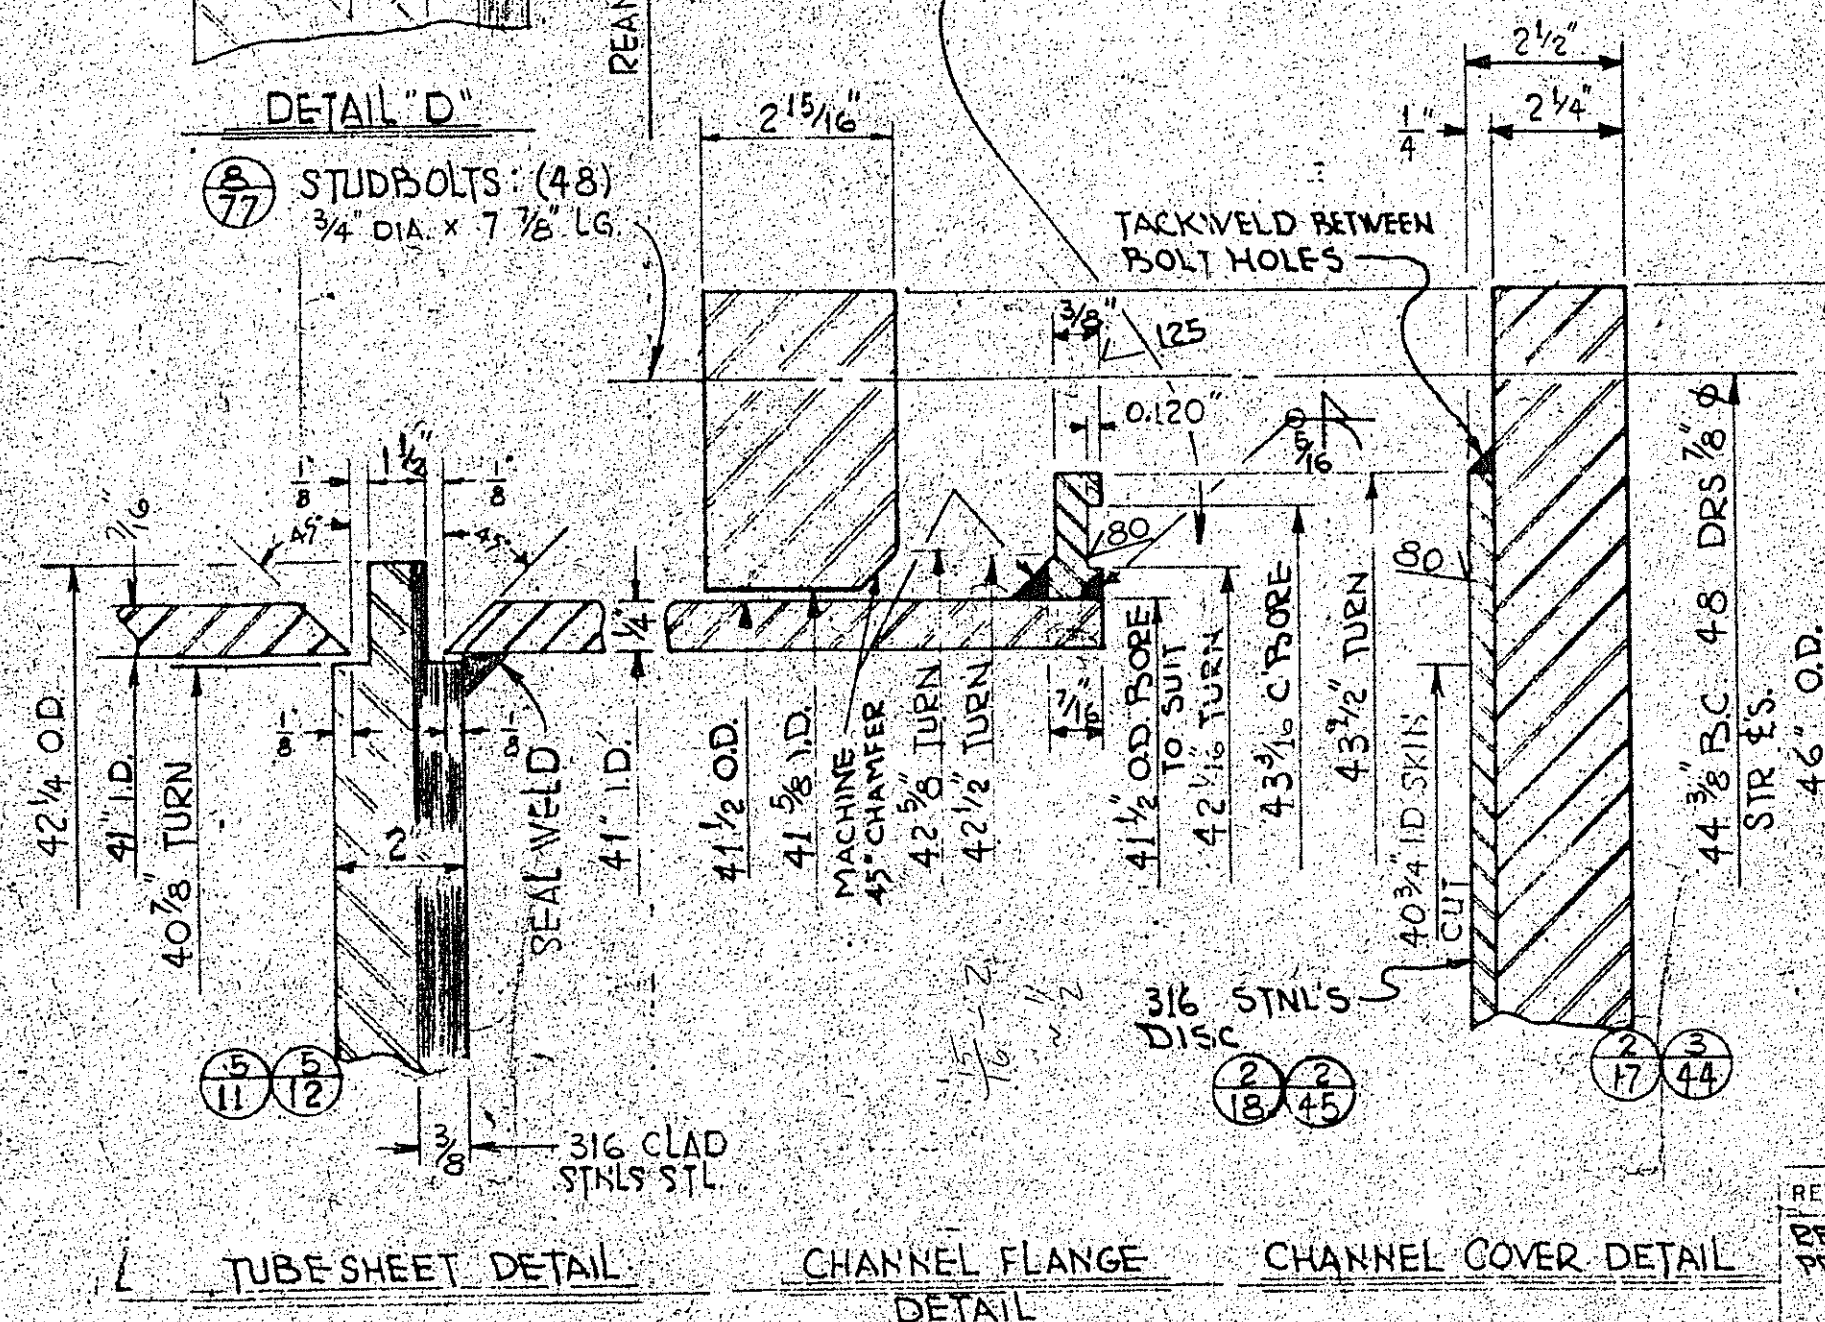
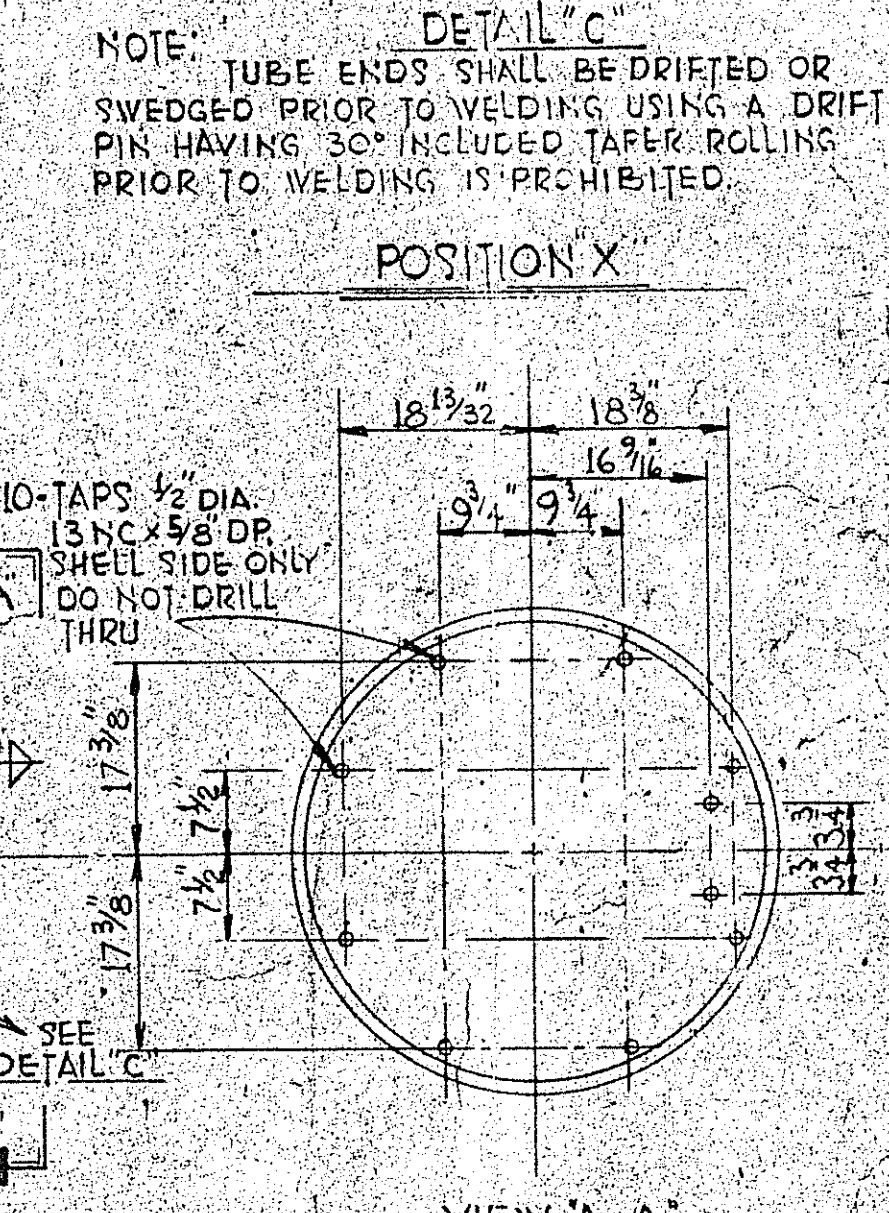


22' = 4 3/8" OVERALL

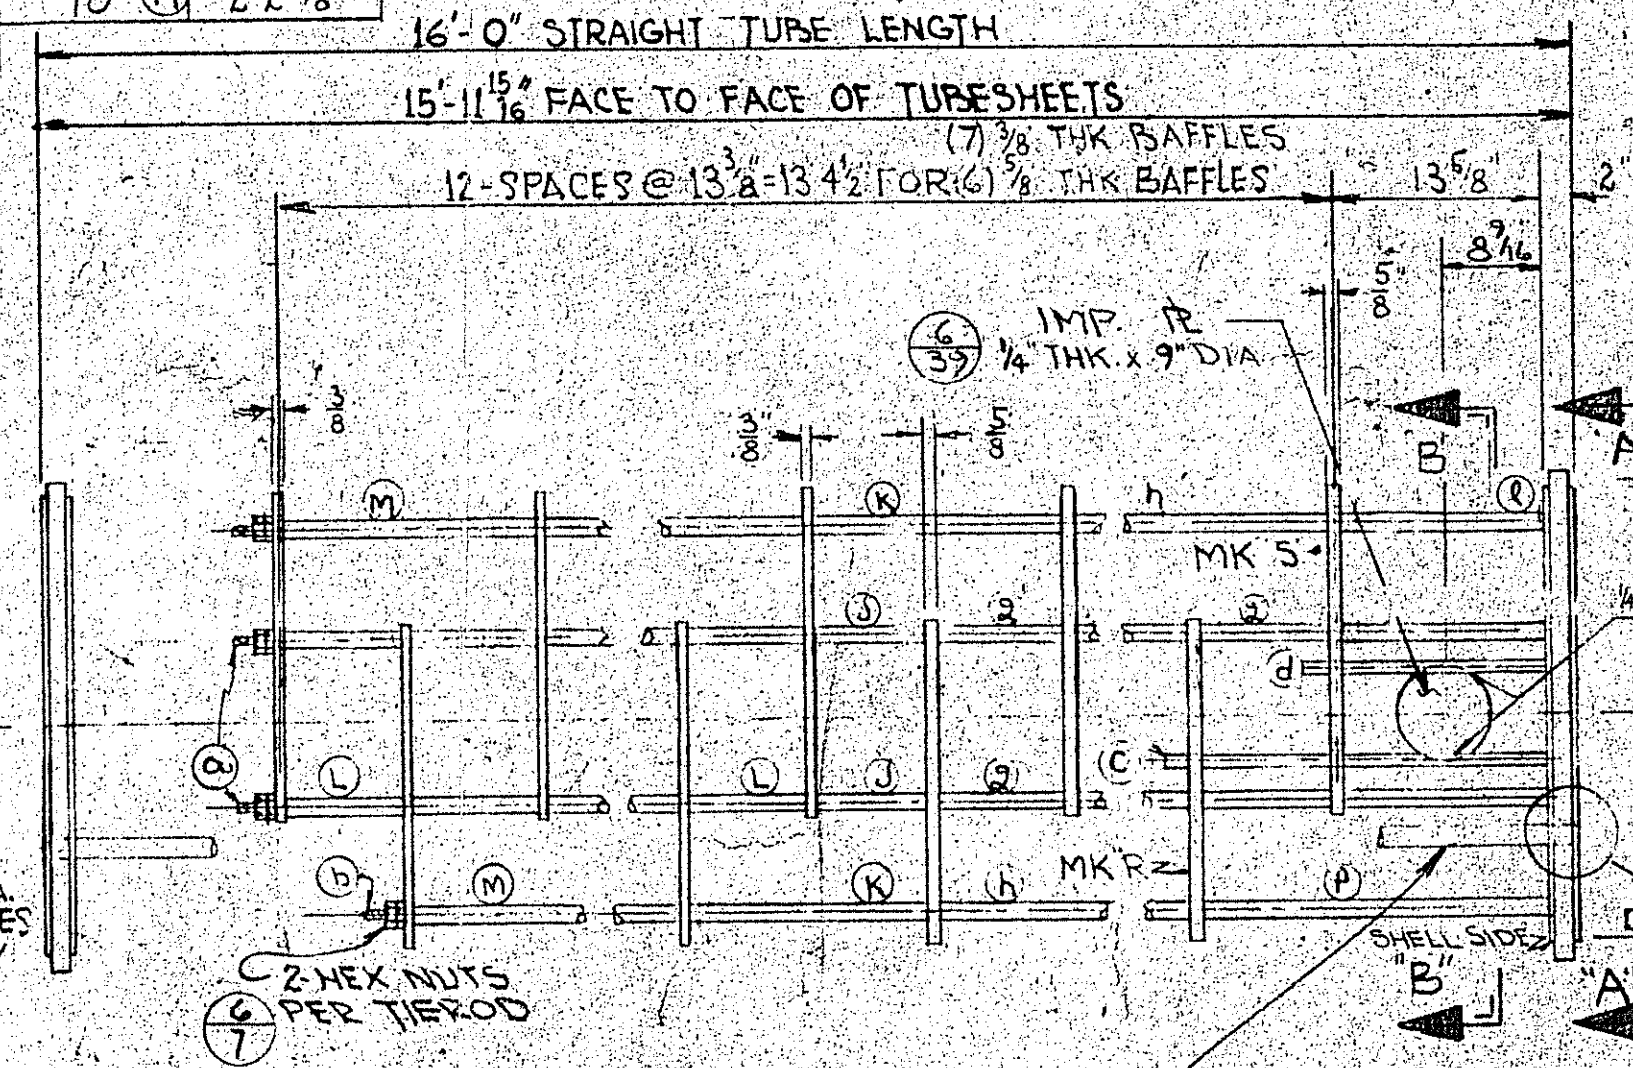

TIER RODS $\frac{1}{2} \phi$		SPACERS $\frac{1}{4} OD$	
Nº REQ'D	"A"	Nº REQ'D	"B"
6 (a)	14'-9 1/2"	4 (j)	12 3/8"
2 (b)	13'-8 1/8"	4 (k)	2' 2 1/4"
1 (c)	2'-5 3/4" TUE 3/4"	24 (l)	13"
1 (d)	16" TO E 3/4"	20 (m)	12 3/4"
		8 (n)	2' 2 3/8"

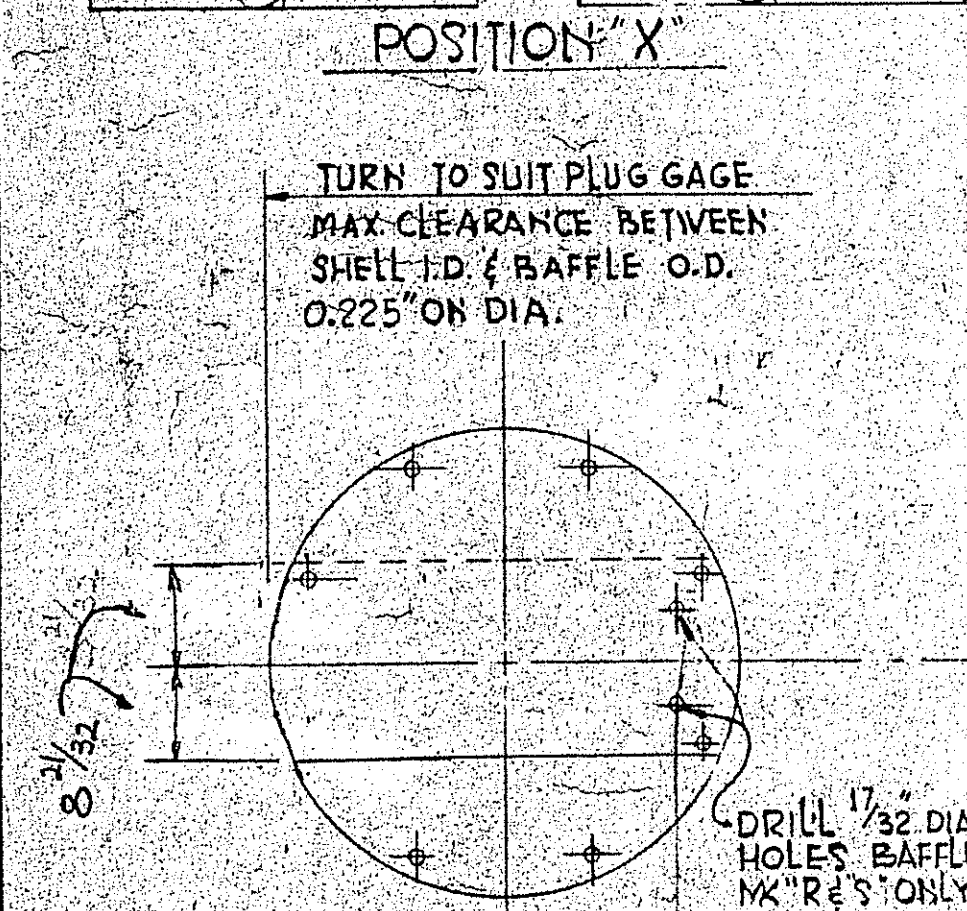

B.P.F. NO.	37342	DATE	5/24/67
SHEET 3		APPARATUS NO. E-412-2	
PROJECT & ACCOUNT		26001	2003
ORDER NO.		336-026-01090	
PLANT		HAWAII	
APPROVED		H. G. Schwenker	

GENERAL NOTES:
ALL BOLT HOLES STR. & S.
ALL PIPE COUP. ARE 3000" SCREWED.

HERCULES INC.

CUST. ORD. N° 336-026-01090-11-000-FCO
PURE DMT STILL REBOILER (ITEM F)
EQUIP. N°S E 412-2
S.W. ORD. N° 66-94-6223
ONE UNIT REQ.

REV. Δ CKD <i>MM</i>	<i>4-27</i>	REV. Δ CKD <i>MM</i>	<i>5-16</i>
REV. PER CUST. M.K.D.		REV. BUNDLE PER CUST.	
PRINT DTD. 4-18-67			
<i>HRB 4-27-67</i>		<i>M.E.B. 5-15-67</i>	
DETAILS for HEAT EXCHANGER			
41-16NX11-8V			
DRAWN: <i>T.E.B.</i>	<i>3-16</i>		
CHECKED: <i>MM</i>	<i>3-21</i>	<i>66-94 6223 D1</i> <i>GULFPORT, MISS.</i>	
APPROVED:			
SCALE: <i>CH</i>	DATE:		