ID 66-94-6221 D1

B.P.F. NO. 37340	DATE 4/17/67
SHEET 2	APPARATUS NO. S-205-2A,2B S-2205-2A,2B
PROJECT & ACCOUNT 26001	2001 2014
ORDER NO. 336-026-01090	
PLANT Wilmington	
APPROVED W. R. Wilmerson	

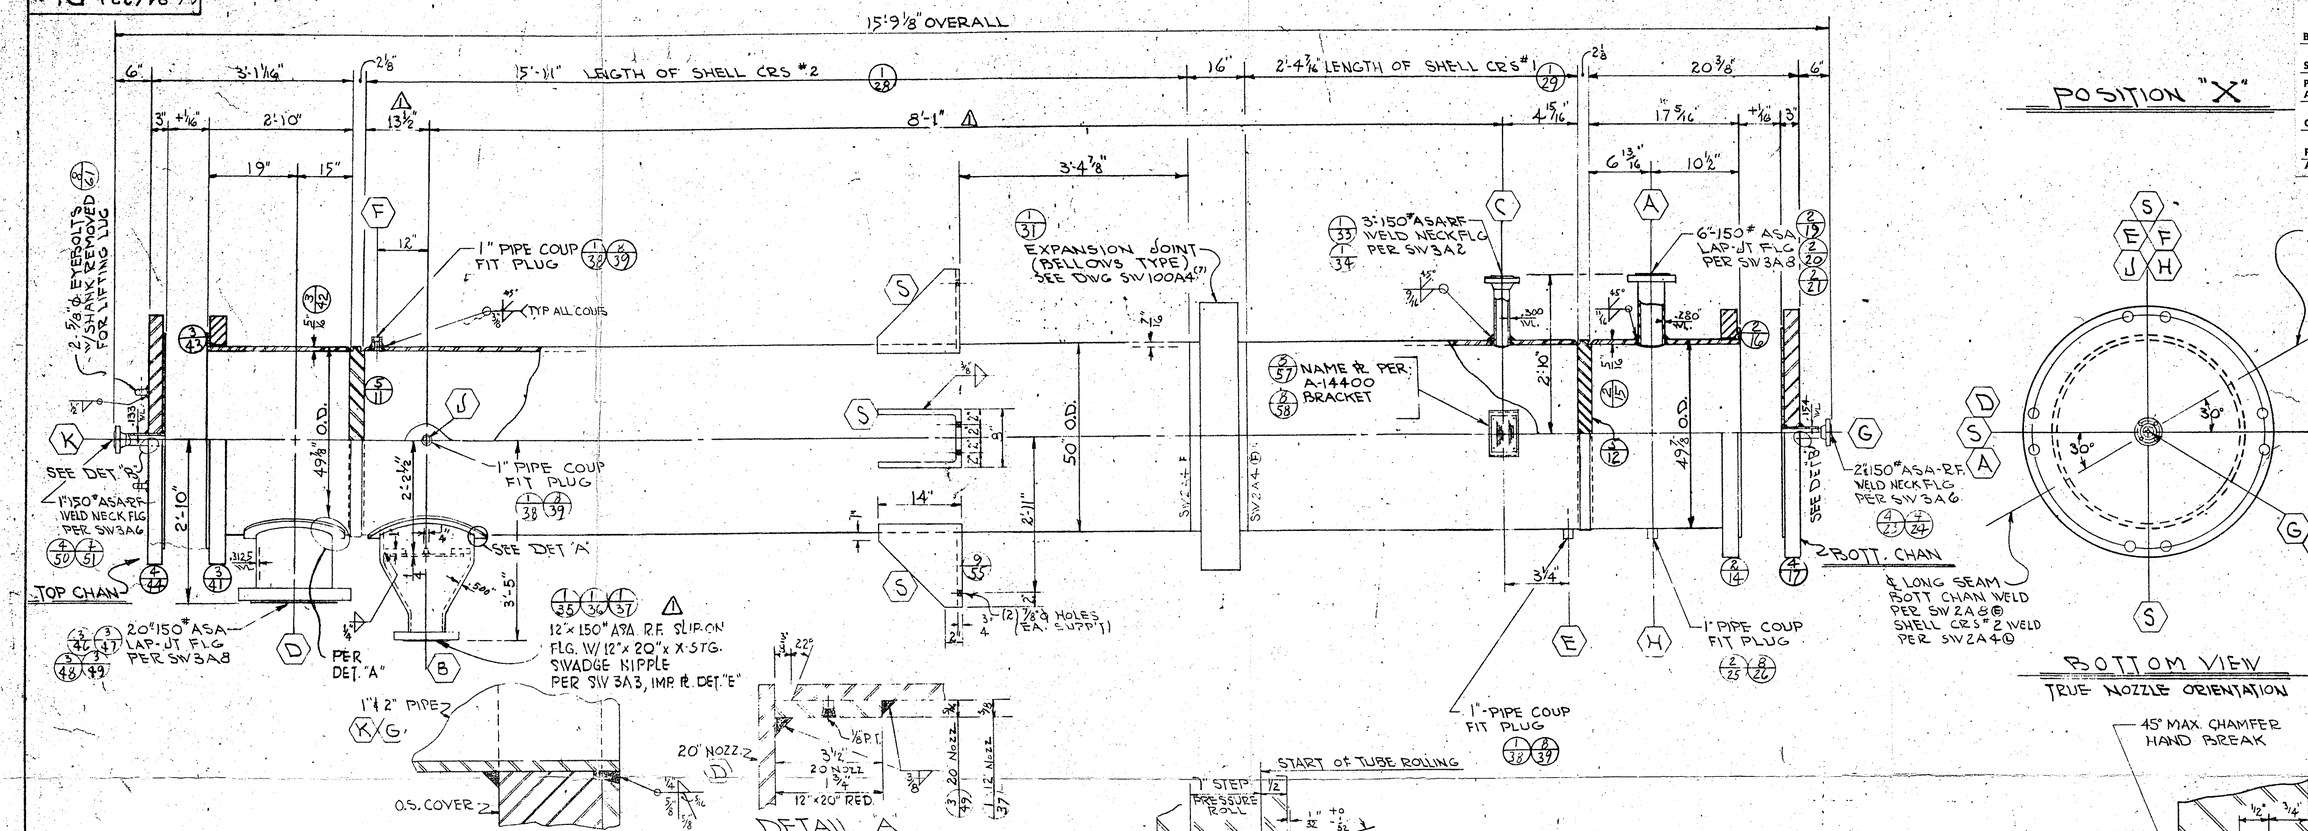

GENERAL NOTES:
ALL BOLT HOLES STR ℄'S.
ALL PIPE COUP. ARE 3000# SCREWED.

HERCULES INC.
CUST. ORD. Nº 336-026-01090-11-000-FCD
MROH STILL EF-BOILER (ITEM D)
EQUIP. Nº'S. E-205-2A & B; E-2205-2A & B
S.W. ORD. Nº 66-94-6221
FOUR (4) UNITS REQ'D.

#104182

REV.	CKD.	REV.	CKD.
REV. NOZ., "B" & TIE ROD LOCATIONS.	3-8-67	REV. GASKET FACEING. TO SUIT FLEXITALLIC GASKET	3-31

DETAILS FOR 50-10NX11-8V HEAT EXCHANGER

DRAWN: H.R.B. 2-21-67
CHECKED:
APPROVED:
SCALE: CHS DATE

66-94-6221 D1
GULFPORT, MISS.

STRUTHERS WELLS CORPORATION · WARREN, PENNSYLVANIA

STRUTHERS WELLS CORPORATION · WARREN, PENNSYLVANIA