
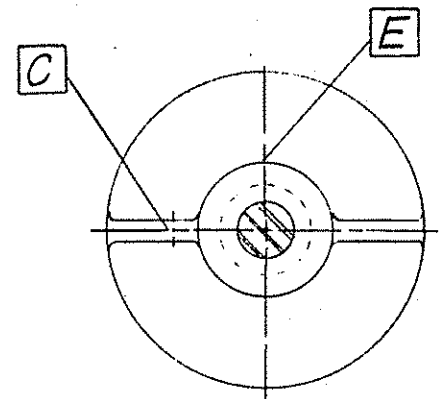


B25283

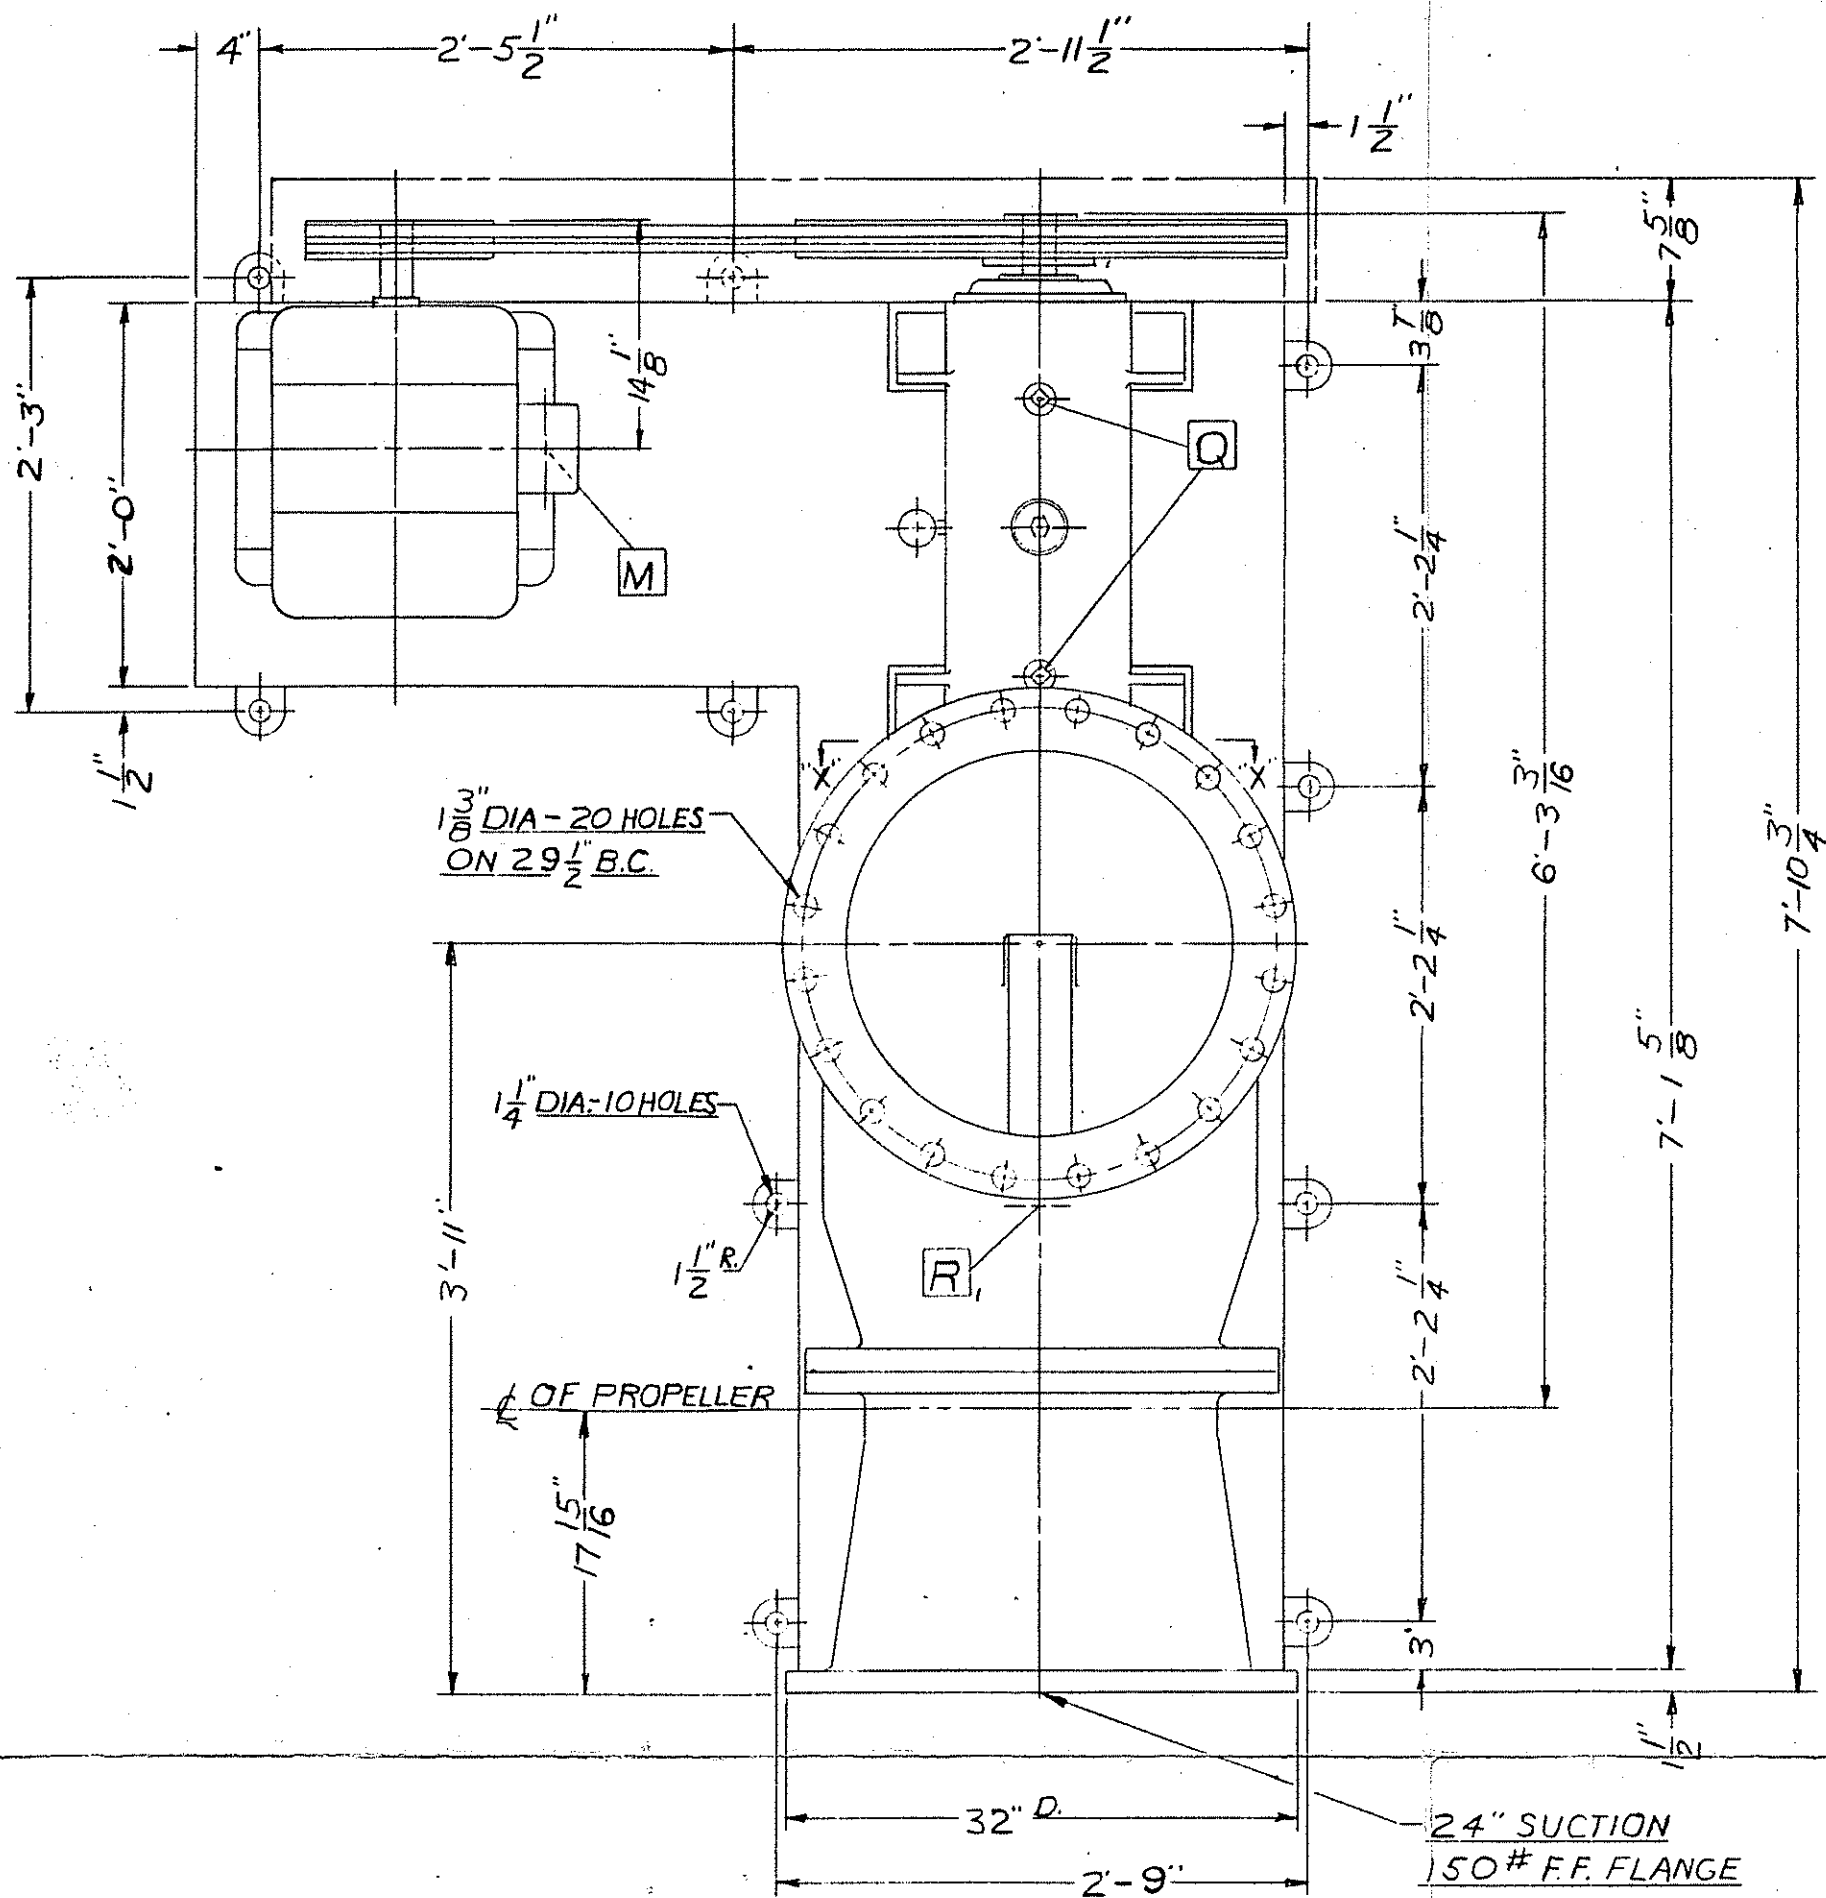


VIEW "X"-X"

NOTES:

- C 1/4" PIPE TAP - SEAL FLUID INLET
- E 1/2" PIPE TAP - SEAL FLUID OUTLET
- M 1 1/2" PIPE TAP - MOTOR CONDUIT
- Q 1" PIPE TAP - OIL FILL (PLUGGED)
- R 1" PIPE TAP - BASIN DRAIN (PLUGGED) AT LOWEST POINT IN ELBOW

⊗ 1/8" ALLOWED FOR SHIMMING

PUMP WT. - 5375#
MOTOR WT. - 355#
TOTAL WT. - 5730# APPROX.

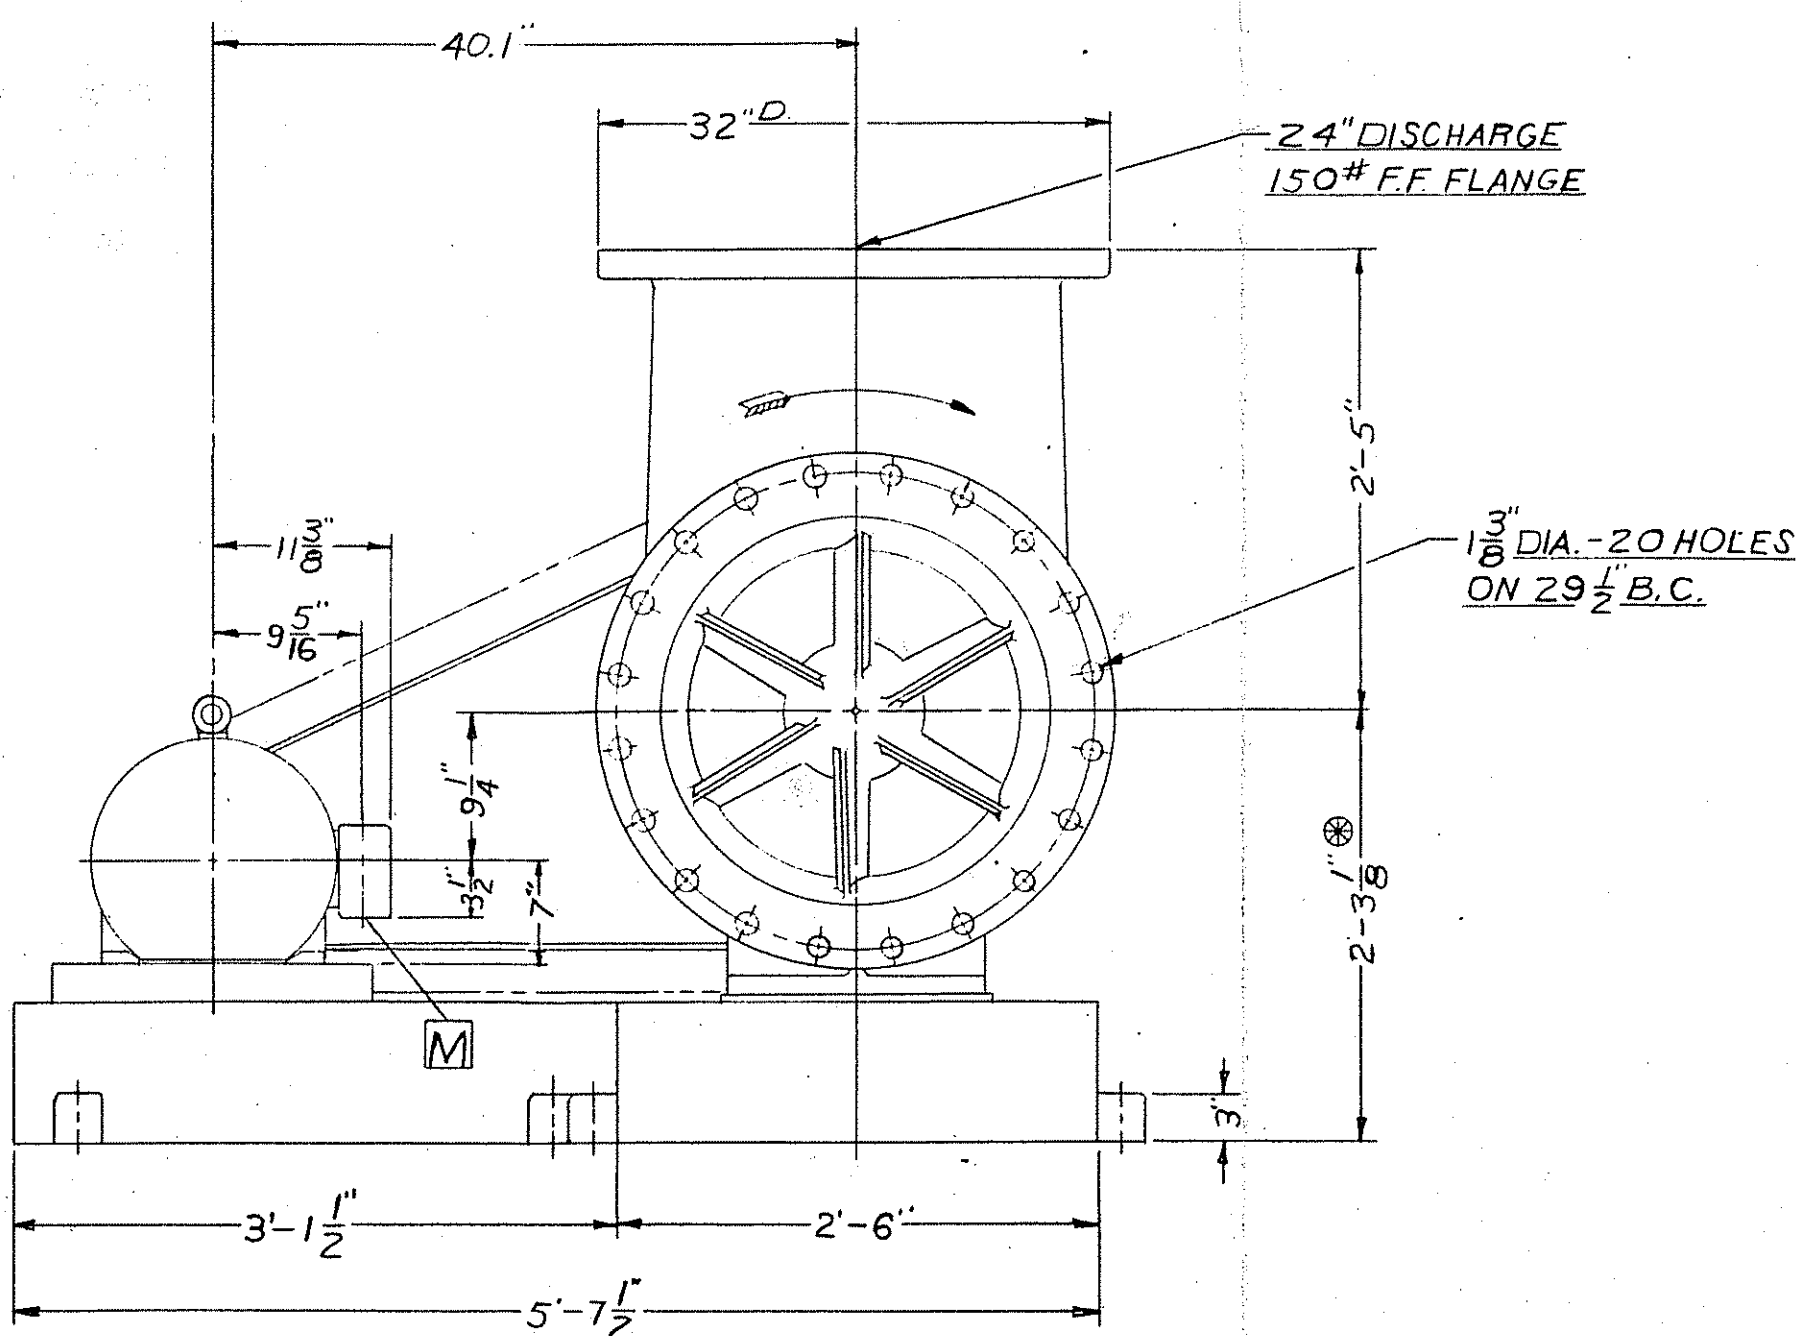

B.P.F. NO. 42287 DATE 4/17/72
SHEET 39 APPARATUS NO.
PROJECT & ACCOUNT 26035 2030
ORDER NO. 336-026-35020
PLANT APPROVED HANOVER
H.G. Schuber
CERTIFIED FOR
STRUTHERS SCIENTIFIC & INTERNATIONAL CORP.
Your Order 9-72-05-10212-049
Our Order 53864-1 Date 4-10-72
By R. Benedict
LAWRENCE PUMPS INC.

STRUTHERS SCIENTIFIC & INTERNATIONAL CORP.
ORDER NO. 9-72-05-10212-049
HERCULES ORDER NO. 336-026-35020-12-000-FCD

PUMP NO. 53864-1 PRUE CRYST. CIRCULATING PUMP-P-4509-2

10453
10456B36

2			
1			
NO.	DATE	BY	DESCRIPTION
REVISIONS			
ELEVATION OF 24 HORIZONTAL PROPELLER PUMP & 25 HP-1800 R.P.M.-230/460 V.-3 PH.-60 HZ.-ENC. T.E.F.C.-S.F.I.15 (G.E.) MOTOR FR.# 284T			
DRAWN BY	R.M.	LAWRENCE PUMPS INC. LAWRENCE, MASS.	
CHECKED BY	RAM		
SCALE:	1"-1'-0"	DRAWING NUMBER B25283	
DATE	10 APR. 72		