


D-COK, P.O. NO.: 56603-P-13-19, ITEM NO.: J-688A/B, AIR COMPRESSOR DISCHARGE FILTER/COALESCER, (2 UNITS)
 ASME DESIGN & STAMP FOR 50 PSIG @ MDMT 0°F/250°F w/.125" C.A., PWHT - NO, LIFT LUGS - YES, PMI - NO,
 RADIOGRAPH - RT2, UT,MT,PT - NO, IMPACTS - NO, INSULATION SUPPORTS - NO, DAVIT - YES,
 EXTERIOR - SP10, INORGANIC ZINC, 2-3 MILS D.F.T.,
 SHELL - 24" SCH. STD (.375" WALL) SA106-B, HEAD - .328" MIN. 2:1 ELLIP. SA516-70


#105841

#105842

WEIGHT: 2,237 LBS. EACH

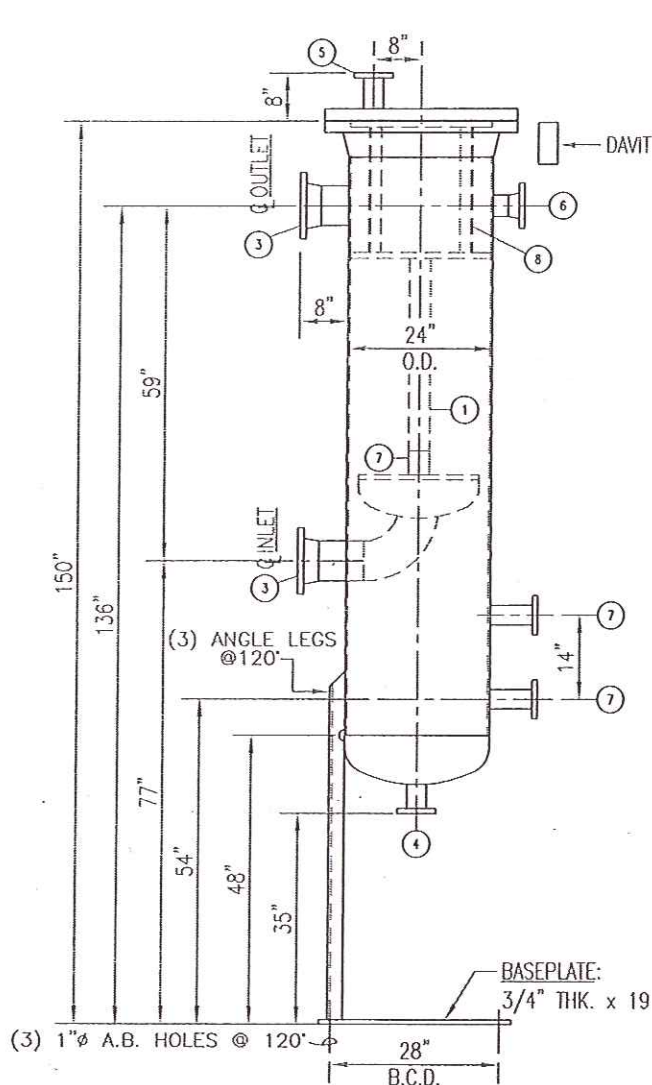

ELEVATION VIEW

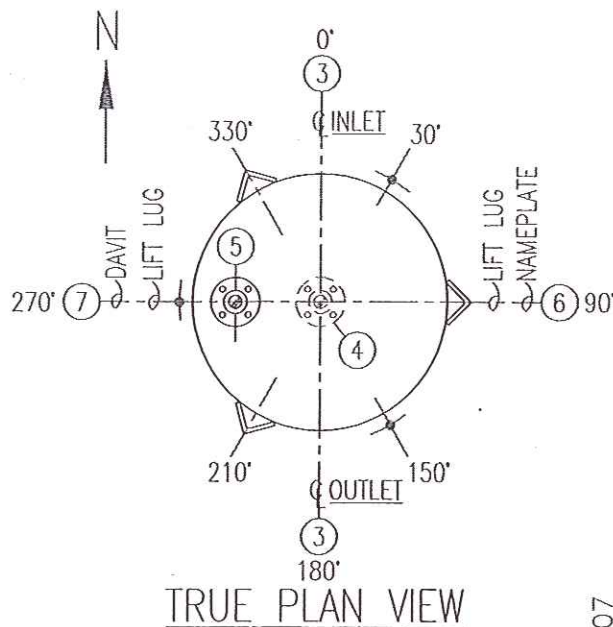

TRUE PLAN VIEW

(KEEP DAVIT 90° - 180° OPPOSITE OF ANY NOZZLE LOCATED ON CLOSURE END OF VESSEL)

- (1) (16) CAA-5015 FILTER/COALESCER ELEMENTS
- (2) 24" - 150# RFWN c/w BLIND, BOLTING & GASKET
- (3) 6" - 150# RFWN INLET/OUTLET NOZZLES (4) 1 1/2" - 300# RFLWN DRAIN NOZZLE
- (5) 1 1/2" - 300# RFLWN VENT NOZZLE (6) 3" - 150# RFWN RV NOZZLE
- (7) 2" - 300# RFLWN LG NOZZLES (8) REMOVABLE ELEMENT HOLD-DOWN SPOOL

MODEL 241VGC COALESCER

SOUTHWEST FILTER COMPANY, TULSA OKLAHOMA

DRAWN:	MWM	DATE:	8-1-06
CHECKED:		DATE:	
DRAWING NO.	A-10607	REV. 5	SHT. 100

REV. 5 CHANGED DESIGN PER CUSTOMER REQUEST. (MWM) 3-2-07
 REV. 4 CHANGED PER CUSTOMER COMMENTS. (MWM) 2-26-07
 REV. 3 CHANGED PER CUSTOMER COMMENTS. (MWM) 12-15-06
 REV. 2 ADDED P.O. NO. & PLAN VIEW. (MWM) 10-20-06
 REV. 1 REVISED NOZZLES: (MWM) 9-29-06