[illegible][illegible]

NOTES:

1. Outside projection shown in the nozzle schedule is from the vessel O.D. unless otherwise noted.
2. Inside projection shown in the nozzle schedule is minimum only.
3. All toll dimensions are from the reference line and in inches unless otherwise noted.
4. All nozzles shall be adequately protected and secured for removal.
5. Flange bolt holes to parallel vessel centerlines unless otherwise noted.
6. Hydro test with rust preventive.



PRESSURE PRODUCTS, INC.
FORT WORTH, TEXAS
(817) 560-3014

VERTICAL CHILLER FEED TANK
36" ID x 8'-0" SM/SM
GULSBY ENGINEERING, INC.
HUMBLE, TEXAS


SCALE: 1:0 P.O. NO. 9912-116-07
REVISED CWR 09/19/01 01-028-B
JMK 08/19/01 22263-000 1

106775



PV 16.504

NOTES


1. FABRICATE PER ASME BPV SECTION VIII.
2. REFERENCE DWG. D2263-000 REV. 1

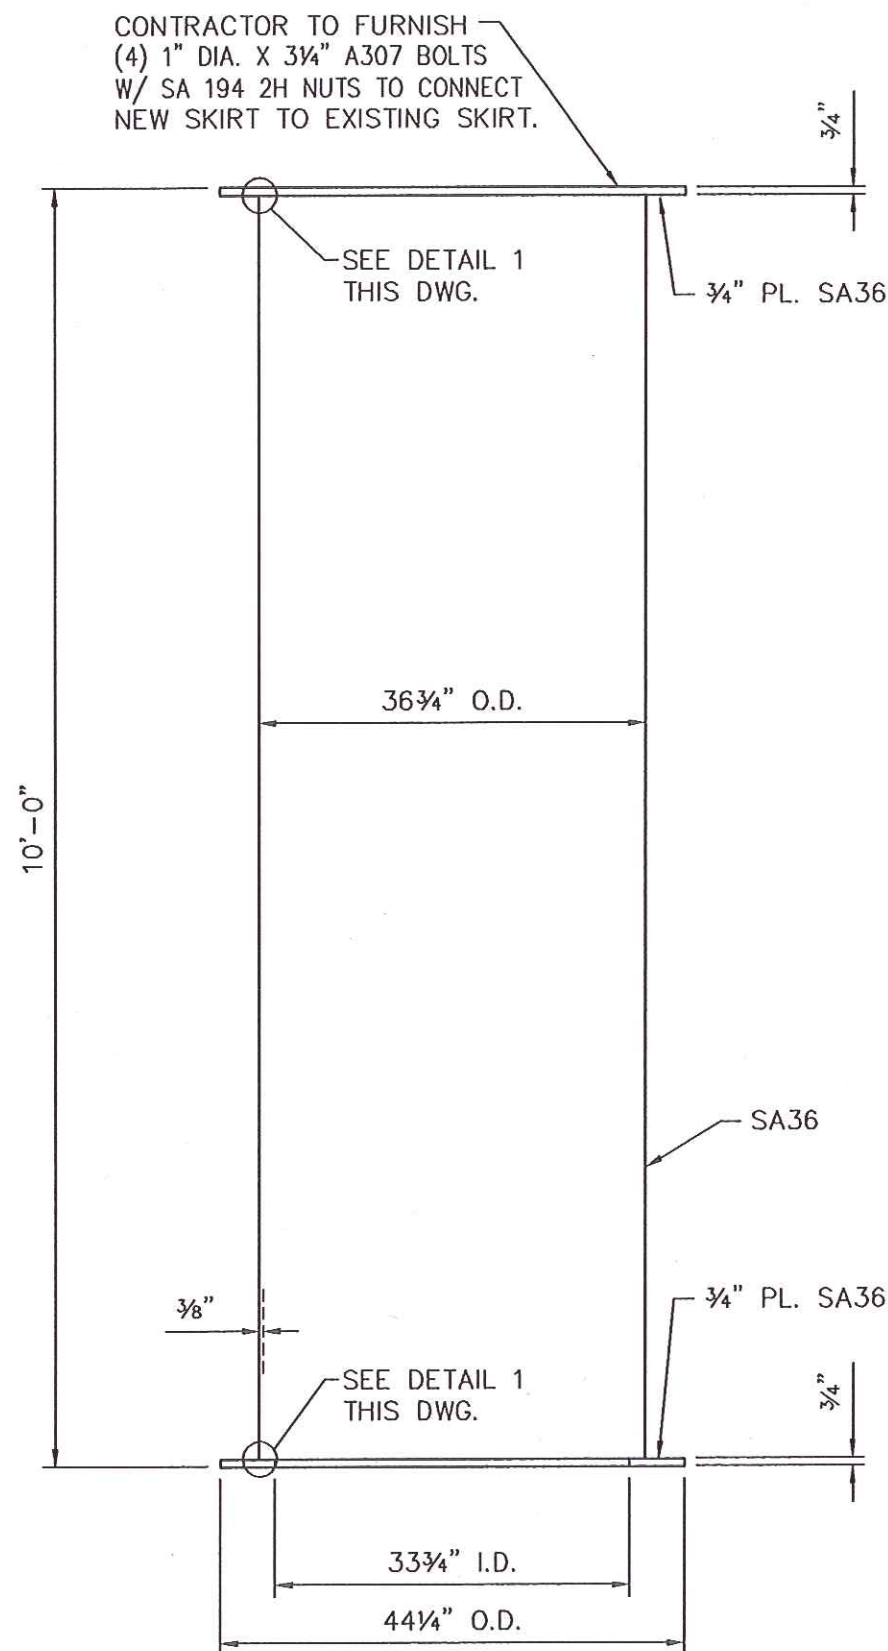

ELEVATION
SCALE: 3/4" = 1'-0"

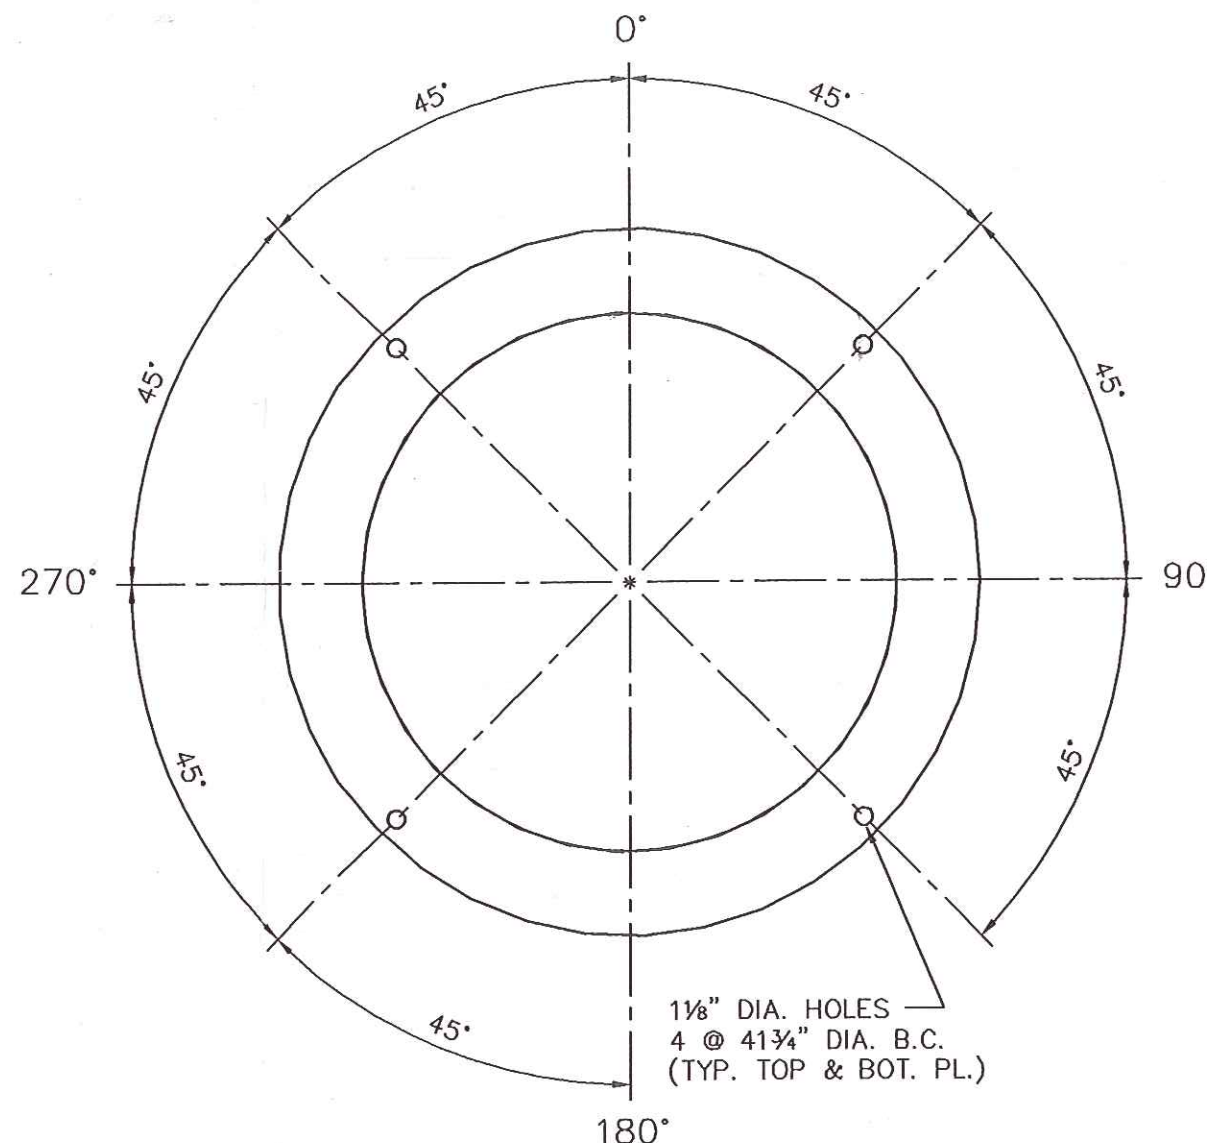

PLAN
SCALE: 1" = 1'-0"

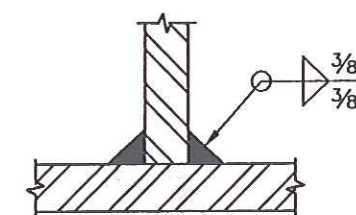

DETAIL 1
SCALE: NONE

#106775

4 FRONT ENGINEERING, L.L.C.	
ISSUED FOR APPROVAL	
Document is unchecked and not complete. Use of this document for procurement, fabrication and/or construction relieves the originator from the responsibility for errors.	
BY: <i>[Signature]</i>	DATE: 03/21/03

4 FRONT ENGINEERING JOB NO.: 23:110		4 FRONT ENGINEERING, L.L.C.	
CLIENT JOB NAME: VERTICAL CHILLER FEED TANK			
DRAWING FILE NAME: 23110-EE-01.DWG			
CADD ARCHIVE: -			
GULF LIQUIDS			
PV16.504			
VERTICAL CHILLER FEED TANK SKIRT			
PLAN & ELEVATION			
DRAWN: CC	DATE: 3/03	CHECKED: -	DATE: -
ENGINEER: -	DATE: -	APPROVED: -	DATE: -
SCALE: NONE		DRAWING NO. 23-110-EE-01	
PROJ. LOC.: -		REV.: A	

CONFIDENTIAL
THIS DOCUMENT IS PROPRIETARY TO 4 FRONT ENGINEERING, L.L.C. AND IS FURNISHED SUBJECT TO RETURN ON DEMAND AND THE CONDITION THAT THE INFORMATION AND TECHNOLOGY EMBODIED HEREIN SHALL NOT BE DISCLOSED OR USED IN ANY WAY, THIS DOCUMENT SHALL NOT BE REPRODUCED OR COPIED, IN WHOLE OR IN PART WITHOUT PRIOR WRITTEN CONSENT OF 4 FRONT ENGINEERING, L.L.C. ANY PERSON WHO MAY RECEIVE OR OBSERVE THIS INFORMATION OR TECHNOLOGY WILL BE HELD STRICTLY LIABLE FOR ANY VIOLATION WILLFUL OR NEGLIGENT.

NO.	DESCRIPTION	DWN BY	CHK'D	APPR'D	DATE
A	ISSUED FOR APPROVAL	CC	-	-	3/03