

Date: February 24, 2012

Southern Company Generation 42 Inverness Center Parkway Birmingham, AL 35242-4809

Attn: Document Control Supervisor Bin B403

P.O. No.: MPC17837-0001

Project: Kemper County IGCC Project

Alfa Laval Order No.: J-41276 (408263) Alfa Laval Serial No.: 30113-88710

Alfa Laval Inc.

5400 International Trade Drive Richmond, Virginia 23231

USA

Dean Middleton Tel: 804-236-1345 Fax: 804-236-1882

E-mail: dean.middleton@alfalaval.com

Web: www.alfalaval.com

Dear Customer:

Enclosed is the Data Book for the referenced order.

If you have any questions regarding these enclosures, please feel free to contact me or your local Alfa Laval Sales Representative, Danny Morin of Morin Process Equipment.

Sincerely, Alfa Laval Inc.

Dean Middleton Project Engineer

Enclosures

cc: Morin Process Equipment - Danny Morin

Marketing File



Southern Company Generation Kemper County MM132425 Unit 1

ALFA LAVAL INC. PO: MPC17837-0001

41276-10C Rev: 0

IGCC - COMBINED CYCLE - MULTIPAGE - VENTURI SCRUBBER PUMP AROUND

Alfa Laval Inc.



Richmond, VA

Final Customer Documentation: Table of Contents

Doc. No.	Rev.
41276-10C	0
Date	
February 2, 201	2
Page: 1 of 1	

Alfa Laval Order No.	Customer Name
41276 / 770013	Mississippi Power Company
Alfa Laval Serial No.	Customer Reference No.
30113-88710	MPC17837-0001
Alfa Laval Equipment Type	Customer Tag No.
TL35-BFD	HX1304

PLATE HEAT EXCHANGER DATABOOK

Section 1: Drawing / Plate Hanging List - Specifications

Section 2: ASME Data Report / Nameplate (Code Plate) Copy

Section 3: Calculations

- ASME Code Calculations
- Maximum Allowable Nozzle Loads

Section 4: Inspection and Test Plan

Section 5: Bill of Materials

Section 6: Material Reports –


- Frame & Pressure Plates
- Channel Plates
- Tightening Bolt / Nuts
- Stud Bolt Certificate of Conformance

Section 7: Testing

- Liquid Dye Penetrant Test Report
- Hydrostatic Test Procedure
- Hydrostatic Test Certificate

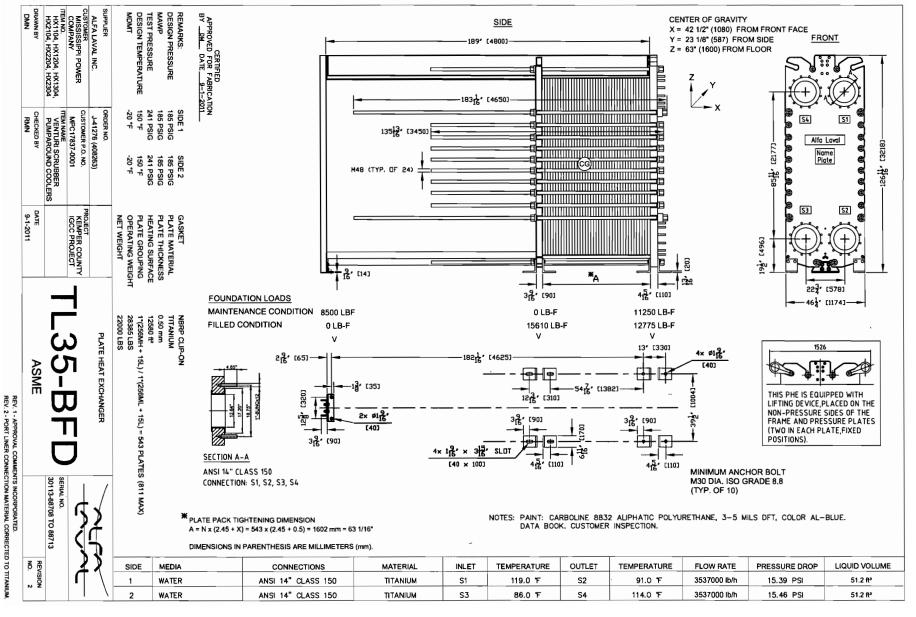Section 8: Installation & Operating Instructions (Manual)







Alfa Laval, Plate Heat Exchanger Specification **Channel Plate Installation Description**

Document: SPEC_30113-88708 Date: 9-1-2011 Rev. 2

Customer:

Mississippi Power Company

P.O. No.: MPC17837-0001

Project: Kemper County IGCC Project Item No.: HX1104, HX1204, HX1304, HX2104, HX2204, HX2304

A/L Order No: J-41276 (408263) Serial No:

30113-88708 to 30113-88713

Model Type: TL35-BFD

Plate material and Thickness:

Titanium 0.50 mm

A Dimension:

 $A = N \times (2.45 + X)$

 $A = 543 \times (2.45 + 0.5) = 1602 \text{ mm}$

Hot side

Cold side

Grouping: Sealing material: Port Locations: Connection material: 1* (256MH+15L) NBRP Clip-on S1 -> S2 Titanium

1* (256ML+15L) NBRP Clip-on S3 -> S4 Titanium

Port hole with flow on the gasketed side: U Port hole sealed with O-ring: 0

Plates are assembled with the gasket side facing the frame plate.

Plate no.	Plate code no.	Plate Patte	ern	Punched upper right	d corner of lower right	the plate lower left	upper left	Flow direction on the gasket side of the plate
				S1	S2	S3	S4	
	FRAME PLAT	E		=>=	=<=	=<=	=>=	
1	39507591 83	TL35 B2	Α	0	0	0	0	
2	39507540 03	TL35 B2	В	U	-> U	0	0	Down
3	39507539 03	TL35 B1	Α	0	0	U>	U	Up
4	39507540 03	TL35 B2	В	U	-> U	0	0	Down
5	39507539 03	TL35 B1	Α	0	0	U>	U	Up
6,	8, , 508	39507540 03	TL35 B2 B					
7,	9, , 509	39507539 03	TL35 B1 A					
510	39507540 03	TL35 B2	В	U	-> U	0	0	Down
511	39507539 03	TL35 B1	Α	0	0	U>	U	Up
512	39507540 03	TL35 B2	В	U	-> U	0	0	Down
513	39507539 03	TL35 B1	Α	0	0	U>	U	Up
514	39507539 03	TL35 B1	В	U	-> U	0	0	Down
515	39507539 03	TL35 B1	Α	0	0	U>	U	Up
516	39507539 03	TL35 B1	В	U	-> U	0	0	Down
517,	519, , 537	39507539 03	TL35 B1 A					
518,	520, , 538	39507539 03	TL35 B1 B					
539	39507539 03	TL35 B1	Α	0	0	U>	U	Up
540	39507539 03	TL35 B1	В	U	-> U	0	0	Down
541	39507539 03	TL35 B1	Α	0	0	U>	U	Up
542	39507539 03	TL35 B1	В	U	-> U	0	0	Down
543	39507591 76	TL35 B2	Α			>		Up
	PRESSURE P	LATE						•
				T1	T2	T3	T4	



Alfa Laval, Plate Heat Exchanger Specification Channel Plate Installation Description

Document: SPEC_30113-88708

Rev. 2

Plate Part No:	Quantity:	Total:
39507591 83	1	6
39507540 03	256	1536
39507539 03	285	1710
39507591 76	1	6
	543	3258

Date: 9-1-2011




_				Required by the												
				al Inc., 5400 In		(1)	lame an	d add	ress of Manu	facture	2 31		<u>=</u>			
	1			ER COMPANY		(Name	e and ad	dress	of Purchase	r)						_
	ocation of insta	llation Kem	per Coun	ty IGCC Gener	rating Fac	ility, 583			93, De Kalb Taddress)	, MS, 3	9328					—
4.	Type(Hor	Vertical	ere)		ank, sepai	Plate Heat rator, ikt. v			kh., etc.)				0113-887 g's seria			_
		N/A			3	0113-8871	0.2				31	625		2	2012	_
5.	ASME Code, S	(CRN) ection VIII, D	iv. 1	2) 010/ A11	Drawing N	lo.)		N /	,	Nat'l.	Bd. No.)		(Ye: N/A	ar buil	t)
					nd Addenda	, ,			Code Ca	ase No.		•		ce per UG	,	d)
6. S	items 6-11 incl hell (a) No. of		leted for sir N/A	ngle wall vessels		fjacketed all length:		, shell	of heat exch	angers, 0'	or ch	amber of m	ulticham	ber vesse _	Is.	
_	Course(1		Material		Thickness			ong. Joint (Cat.	<u> </u>		n. Joint (Cat. A			reatme	
No.	Diameter N/A	Length N/A	Spe	c./Grade or Type N/A	Nom N/A	_	Corr. N/A	Type N/A	Full, Spot, Non	e Eff.	Type N/A	Full, Spot, No N/A	ne Eff.	Temp.	-	me /A
7	Heads: (a)				1			(b		7						
··			o., Grade o	516-70 or Type) (H.T 1		<u> </u>			(Mat'l		_	SA-516- rade or Typ	70 e) (H. <u>T.</u>	- Time & "	Temp.)
	Location (Top, Bottom, Ends)	Thicki Min,	ness Corr.	Radiu Crown	s Knuckle	Elliptical Ratio	Conical Ang		Hemispherical Radius	Flat Diamet		le to Pressure nvex Concave	Туре	Full, Spo		e Eff.
(a)	Fixed	4.33"	0"	N/A	N/A	N/A	N//	_	N/A	127" X	_		N/A	N/	A	N/A
(b)	Movable emovable, bolts	3.54"	0"	N/A	N/A	N/A	N//	Α	N/A	127" X	46"		N/A	N/	Α	N/A
							Ja	cket	losure	(1	Descr	N/. be as ogee	\ & weld,	bar, etc.)		
	WP 185 (inter	psi	N/A (externa	•	(inte	0 °F rnai)	(ext	N/A ernal)	Min. c	(l Lesign r		be as ogee	IT DOI -20 °F	at	150 p	si
	WP 185 (intermpact test	psi rnal)	(externa	act Exemption (Indicate yes or	(inter UCS-66(a) no and the	0 °F rnai) , (b), UHA compone	(ext	N/A ernal) F-65,	Min. o	(lesign r	netal t	emp	IT DOI -20 °F	tea, aescno	150 p	
1 . H	WP	psi rnal) mb. test press,	(externa	act Exemption (Indicate yes or O at 241 psi	(inter UCS-66(a) no and the	0 °F rnai) , (b), UHA compone	(ext	N/A ernal) F-65,	Min. o	(lesign r		emp	IT DOI -20 °F	at	150 p	si
1. H	WP 185 (intermpact test	psi rnal) mb. test press, to be comple	(externa	act Exemption (Indicate yes or O at 241 psi e sections.	(inter UCS-66(a) no and the Proof te	0 °F rnai) , (b), UHA compone	(ext	N/A ernal) F-65, pact te	Min. o	(l design r	netal t	emp. at	-20 °F	at	150 p	osi N/A
1. H	WP185 (internpact test	mb. test press, to be comple	(externa NO (Imp. HYDR ted for tube N/A ry (Mat'l Spe	act Exemption (Indicate yes or O at 241 psi e sections.	(inter UCS-66(a) no and the Proof te	N/A N/A	(ext	N/A ernal) F-65, pact to	Min. c as applicab ested) N/A om. thk. N/A	(l design r	N/A N/A N/A N/A	at	-20 °F	at perature o	150 p	osi NA
1. H // 2. T	WP185 (internpact test	mb. test press, to be comple	(externa NO (Imp. HYDR ted for tube N/A ry (Mat'l Spe N/A g (Mat'l Spec	act Exemption (Indicate yes or O at 241 psi e sections.	(inter UCS-66(a) no and the Proof te	N/A bject to pre	(ext	N/A ernal) F-65, pact to	Min. o as applicab ested) N/A m. thk. N/A om. thk.	(l design r	N/A N/A N/A Corr. Al Corr. Al	at at low.	-20 °F	at perature of N/A	150 p	osi NA
1. H 2. T 3. T	WP 185 (intermpact test vydro., pneu., or corbinate stand 13 in the sheet:	mb. test press. to be comple Stational Floating Mat'l Spec	HYDR HYDR Hed for tube N/A ry (Mat'l Spec N/A g (Mat'l Spec N/A . No., Grade	act Exemption (Indicate yes or O at 241 psi e sections. c. No.)	(inter UCS-66(a), no and the Proof te	N/A Dia. N/A Dia. N/A O. D.	(ext	N/A ernal) F-65, pact to	Min. o as applicab asled) N/A m. thk. N/A m. thk. N/A m. thk.)	(lesign r	N/A N/A N/A N/A	at low.	-20 °F lest term Attach	at perature o	150 p	osi NA olted)
1. H	WP 185 (intermpact test 12 and 13 in the sheet: 14-18 incl. thell (a) No. of	mb. test press. to be comple Stational Floating Mat'l Spec to be comple course(s):	HYDR HYDR Hed for tube N/A ry (Mat'l Spec N/A g (Mat'l Spec N/A . No., Grade	act Exemption (Indicate yes or O at 241 psi e sections. c. No.) No.) or Type er chambers of j	(inter UCS-66(a), no and the Proof te Dia., (su	N/A Dia. N/A O. D. D. Sssels or call length:	(ext	N/A ernal) F-65, pact te	Min. o as applicab asted) N/A om. thk. N/A om. thk. N/A om. thk.) at exchanger N/A	(lee)	N/A N/A Corr. Al N/A NUMB	at low.	-20 °F lest tem	atat	of Noted or beent	osi NA olted)
1. H 1. 2. T 3. T	WP 185 (intermpact test sydro., pneu., or conterms 12 and 13 in the sheet: Tubes: Itubes:	mb. test press. to be comple Stational Floating Mat'l Spec to be comple course(s): s) Length	HYDR HYDR Hed for tube N/A Ty (Mat'l Spec N/A D (Mat'l Spec	act Exemption (Indicate yes or O at 241 psi e sections. c. No.) . No.)	(inter UCS-66(a), no and the Proof te Dia., (su	N/A N/A Dia. N/A O. D. Sessels or call length: Thickness	(ext	N/A ernal) F-65, pact te	Min. c as applicab ested) N/A m. thk. N/A om. thk. N/A om. thk. at exchanger	(lee)	N/A N/A N/A N/A N/A N/A N/A N/A	at low.	-20 °F lest tem Attach	at perature o N/A ment (weld- N/A Attachm	of Noted or beent	osi A/A olted)
1. H 1. 2. T 3. T	WP 185 (intermpact test sydro., pneu., or conterms 12 and 13 in the sheet: Tubes: Itubes:	mb. test press. to be comple Stational Floating Mat'l Specto be comple course(s):	HYDR HYDR Hed for tube N/A Ty (Mat'l Spec N/A D (Mat'l Spec	act Exemption (Indicate yes or O at 241 psi e sections. c. No.) No.) or Type er chambers of j	(inter UCS-66(a), no and the Proof te Dia., (su	N/A N/A Dia. N/A O. D. Sessels or call length: Thickness	(ext	N/A ernal) F-65, pact te	Min. of as applicablested) N/A om. thk. N/A om. thk. N/A om. thk.) at exchanger N/A ong. Joint (Cat.	(le)	N/A N/A N/A N/A N/A N/A N/A N/A	at low.	-20 °F lest tem Attach	atat	150 p	osi N/A olted)
1. H	WP 185 (intermpact test sydro, pneu, or column 12 and 13 includes heet: stems 14-18 incl. thell (a) No. of Course(stems N/A	mb. test press. to be comple Stational Floating Mat'l Spec to be comple course(s): s) Length N/A	HYDR HYDR Hed for tube N/A Ty (Mat'l Spec N/A No., Grade eled for inn N/A Spec	act Exemption (Indicate yes or O at 241 psi e sections. c. No.) or Type er chambers of j Material c./Grade or Type N/A	Dia., (su lacketed ve (b) Over	N/A Dia. N/A O. D. ssels or c all length: Thickness	(ext	N/A ernal) F-65, pact te No No (No	Min. c as applicab ested) N/A m. thk. N/A om. thk. N/A om. thk. N/A om. thk.) at exchanger N/A ong. Joint (Cat. Full, Spot, None N/A	design r	N/A N/A N/A N/A N/A N/A N/A Corr. Al N/A Numb	at low. Allow. Allow. A. Joint (Cat. A Full, Spot, Nor N/A	Attach	at	ed or b ent Tir NA	osi A/A olted)
1. H	WP 185 (intermpact test vydro., pneu., or conterms 12 and 13 introduced in the state of the stat	mb. test press. to be comple Stational Floating Mat'l Spec to be comple course(s): s) Length N/A Mat'l Spec. No	HYDR HYDR Inted for tube N/A Ty (Mat'l Spec N/A I) (Mat'l Spec N/A Son, Grade eled for inn N/A Spec Spec	act Exemption (Indicate yes or O at 241 psi e sections. c. No.) or Type er chambers of j Material c./Grade or Type N/A N/A r Type) (H.T T Radius	(intel UCS-66(a) no and the Proof te Dia., (su lacketed ve (b) Over Nom. N/A	N/A Dia. N/A O. D. Sessels or c all length: Thickness D. Dia. Dia. Dia. Dia. Dia. Dia. Dia.	(ext51, UN nt(s) imp	N/A ernal) F-65, pact te No No (No c of he L Type N/A (b)	Min. c as applicab ested) N/A om. thk. N/A om. thk. N/A om. thk. N/A om. thk.) at exchanger N/A ong. Joint (Cat. Full, Spot, None N/A) (Mat'l	design r	N/A N/A N/A N/A Oorr. Al N/A N/A Numb Circum Type N/A	at low. Joint (Cat. A Full, Spot, Nor N/A ade or Type e to Pressure	Attach B, & C) e Eff. N/A	at	ed or b ent Tir No	osi A/A olted)
1. H	WP 185 (intermpact test sydro, pneu, or column 12 and 13 inches terms 12 and 13 inches terms 14-18 inches te	mb. test press. to be comple Stational Floating Mat'l Spec. to be comple course(s): s) Length N/A Mat'l Spec. No Thickn Min.	HYDR HYDR Hed for tube N/A Ty (Mat'l Spec N/A No., Grade eled for inn N/A Spec Spec Spec Spec Spec Spec Spec Spec	i) act Exemption (Indicate yes or O at 241 psi e sections. c. No.) or Type er chambers of j Material c./Grade or Type N/A N/A r Type) (H.T T Radius Crown	(inter UCS-66(a) no and the Proof te Dia., (su lacketed ve (b) Over Nom. N/A	N/A bject to pre N/A Dia. N/A O. D. essels or c all length: Thickness C D. Elliptical Ratio	(ext51, UN nt(s) imp	N/A ernal) F-65, pact te No (No (No (No Type N/A (b)	Min. of as applicable asted) N/A M.A m. thk. N/A m. thk. N/A m. thk.) at exchanger N/A ong. Joint (Cat. Full, Spot, None N/A (Mat'l Hemispherical Radius	design r design r (I (I (I (I (I (I (I (I (I (N/A N/A N/A N/A Oorr. Al N/A N/A Numb Circum Type N/A	low. Joint (Cat. A Full, Spot, Nor N/A N/A ade or Type	Attach Attach B, & C) Be Eff. N/A Type	at	ed or b ent into (U) emp.) A t, None	oosi ooked)
1. H 2. T 3. T 4. S No.	WP 185 (intermpact test vydro., pneu., or conterms 12 and 13 introduced in the state of the stat	mb. test press. to be comple Stational Floating Mat'l Spec. to be comple course(s): s) Length N/A Mat'l Spec. No Thickn Min. N/A	HYDR HYDR NA NO (Imp. HYDR N/A TY (Mat'l Spec N/A No., Grade eled for inn N/A Spec Spec Spec Spec Spec Spec Spec Spec	i) act Exemption (Indicate yes or O at 241 psi e sections. c. No.) No.) or Type er chambers of j Material 2/Grade or Type N/A N/A r Type) (H.T T Radiu: Crown N/A	(intel UCS-66(a) no and the Proof te Dia., (su lacketed ve (b) Over Nom. N/A	N/A Dia. N/A O. D. Sessels or c all length: Thickness D. Dia. Dia. Dia. Dia. Dia. Dia. Dia.	(ext51, UN nt(s) imp	N/A ernal) F-65, pact te No (No (No (No Type N/A (b)	Min. of as applicablested) N/A m. thk. N/A om. thk. N/A	design r le) (I (I (I (I (I (I (I (I (I (N/A N/A N/A N/A Oorr. Al N/A N/A Numb Circum Type N/A	at low. Joint (Cat. A Full, Spot, Nor N/A ade or Type e to Pressure	Attach B, & C) e Eff. N/A	at	ed or b ent into (U) emp.) A t, None	osi A/A olted)
11. H 12. T 13. T 14. S No.	WP 185 (intermpact test sydro, pneu, or conterms 12 and 13 inches terms 14-18 inch. thell (a) No. of Course(sterms N/A coation (Top, Bottom, Ends) N/A	mb. test press. to be comple Stational Floating Mat'l Spec. to be comple course(s): s) Length N/A Mat'l Spec. No Thickn Min. N/A	HYDR HYDR NA NO (Imp. HYDR N/A TY (Mat'l Spec N/A No., Grade eled for inn N/A Spec Spec Spec Spec Spec Spec Spec Spec	i) act Exemption (Indicate yes or O at 241 psi e sections. c. No.) No.) or Type er chambers of j Material 2/Grade or Type N/A N/A r Type) (H.T T Radiu: Crown N/A	(inter UCS-66(a) no and the Proof te Dia., (su lacketed ve (b) Over Nom. N/A	N/A bject to pre N/A Dia. N/A O. D. essels or c all length: Thickness C D. Elliptical Ratio	(ext51, UN nt(s) imp	N/A ernal) F-65, pact te No No (No of he L Type N/A (b) Apex e	Min. of as applicablested) N/A m. thk. N/A om. thk. N/A	design r design r (I (I (I (I (I (I (I (I (I (N/A N//A N//A N//A N//A Corr. Al Numb Circum Type N/A N/A Sid	at low. Allow. Allow	Attach Attach B, & C) Be Eff. N/A Type	at	ed or b ent into (U) emp.) A t, None	osi A/A oolted)



					F	ORM.U-1 (BAC	CK)				N	IB Num	ber 31625		
16. MAWP _	11//		N/A (external)	N/A at max. temp. N/A (internal)				Min.	design metal tem	n metal temp. N/A		at	N/A		
Impact te	Impact test					N/A			at test temperature of N/A						
				(Indicate ye	es or no and the			ested)							
18. Hydro., p	neu., oi	r comb	o, test press.		N/A	Pro	of test			N/A					
		n, and	safety valve	penings:		(! - l'	Tu	2. (146 b d				
Purpose (Inlet, Drain, etc		No.	Diameter or Size	Flange Type	Nozzle Na	terial Flange	Nozzłe Nom.	hickness Corr.	Reinforcement Material	Nozzle	Attached Flange	Location	n (Insp. Open.		
Inlet	,	2	14"	STUDS	SA193-B7	riungo	1"	0017.		1102210	ridingo				
Outlet		2	14"	STUDS	SA193-B7		1"								
20. Supports: 21. Manufacturer N/A		(Yes o Data Re	•	(No.) entified and sign	•					Attached	B (Whe	OLTED re and h	low)		
				tes Maxim	num; Distan	ice between	Heads	= 63.1	188"; Custome ve Service On		_				
form to t	nat the she ASM	IE Cod	de for Pressu	this report a	are correct and Section VIII, D	ATE OF SHOP d that all detai Division 1. U C	ls of design	n, mater	rial, construction, ization No25	and work 017 Ex	manship o	f this ve July 5,			
Date 02	700,201	<u>-</u>	Nam <u>e</u>			facturer)			Signed _	(U	Represent	ative)			
and employed January 3 Section VIII, Di Manufacturer's	by <u>Onet</u> 0, 2012 vision 1. Data Re	Beacon , a By sigr port. For	America Insurar nd state that, to ning this certifica	nce Co. of Lynr the best of my te neither the li ner the Inspect	National Board on MA knowledge and in the manual spector for his	belief, the Manufa employer makes yer shall be liable	sure Vesse have inspacturer has any warrar	Inspectors bected the constructe ty, express iner for any	s and/or the State or pressure vessel des d this pressure vess sed or implied, conce y personal injury or p	cribed in this el in accorda erning the pr property dam 803A, VA95	s Manufactur ance with AS essure vesse age or a loss	ME Code el describ s of any ki	ed in this ind		
We certify the	at the s s of ASI	tatem	ents made in	this report a	TIFICATE OF ire correct and 1. U Certifica	that the field	assembly	constru	NCE ction of all parts		sel confor	ns with	the		
Date			Name						Signed						
		_			(Assem	nbler)	_			(Represen	tative)			
and employed	by		in this Manufac	ssued by The N	eport with the des	f Boiler and Press	sure Vesse of vessel and	Inspectors	s and/or the State or parts referred to as d	ata items					
have compared the statements in this Manufacturer's Data Report					dance with the As ertificate neither nore, neither the	SME Code, Secti the Inspector nor	ion VIII, Div his employ	sion 1. Thermakes a	e described vessel vany warranty, expres	vas inspecte sed or impli	d and subjected, concernit	ited to a ng the pre	ssure		
Pate			Signed			Cc	ommissions								
			exe; v5.0.4	(Auth	horized Inspec	ctor)		(N	at'l Board incl. endor	rsements, St	ate, Province	and No.)		

exe; v5.0.4

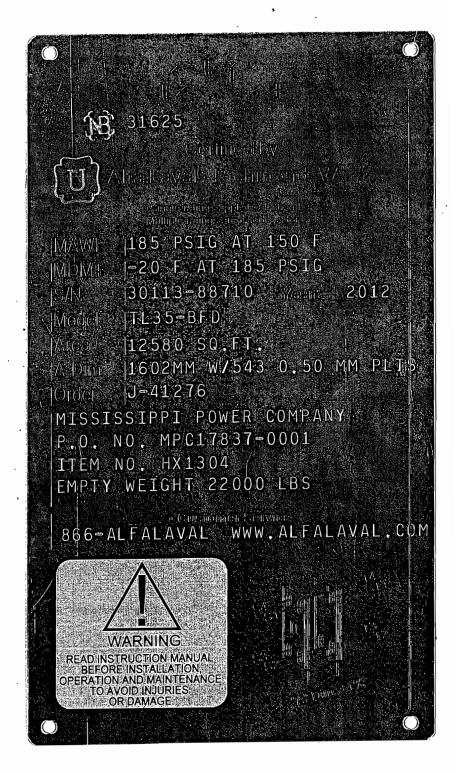U1-12









Customer: Mississippi Power Company P.O. No.: MPC17837-0001 Project: Kemper County IGCC Project Item No.: HX1104, HX1204, HX1304, HX2104, HX2204, HX2304 A/L Order No.: J-41276 (408263) A/L Serial No.: 30113-88708 to 88713 Document: PVCalc_30113-88708

Pressure Vessel Calculation of Plate Heat Exchanger

Pressure ve ssel code ASME Boiler and Pressure Vessel

Code, Section VIII, Division 1

Code edition 2010 Edition and latest addenda

Calculation form version ASMEVIII-1.PHE.02.9

Standard version ASME

Calculation drawing⁽¹⁾ no Dwg_no = 3011388708

Heat Exchanger type PHE_type = "TL35-FD"

Additional pressure due to static head of liquid $p_{stat} = 0.3 \cdot bar$

(1) Design and Arrangement drawing.

Summary

For connection standard ASME B16.5 Class 150.

Design temp.	$T_{\text{max}^{\circ}\text{C}} = 65.56 ^{\circ}\text{C}$ ($T_{\text{max}^{\circ}\text{F}}$ 150.0 °F)
MDMT	$T_{\text{min}^{\circ}\text{C}} = -29 \cdot {^{\circ}\text{C}}$ ($T_{\text{min}^{\circ}\text{F}} = -20 \cdot {^{\circ}\text{F}}$) at MAWP
MAWP	$p_{design} = 1.28 \cdot MPa$ ($p_{design} = 12.759 \cdot bar/$ $p_{design} = 185 psig$)
Test pressure	$p_{test} = 1.66 \cdot MPa$ ($p_{test} = 16.587 \cdot bar$ / $p_{test} = 241 psig$)

2	9/1/2011	Randy Neagle	9/1/2011	Dean Middleton
Rev.	Date	Prepared	Date	Approved

Alfa Laval Inc.

Quality

Revision 1 Page 1 of 11

1a Tightening bolts

Calculation drawing(1) item no.

$$No_{.tbolt} = "3"$$

The required bolt area is calculated according to appendix 2.

1a.1 Input parameters

Bolt material:

Allowable stress (table UCS-23):

$$S_{.tbolt} = 172 \cdot MPa$$

Bolt size no.1

Bolt size no.2

Bolt size (threading):

size_{.tbolt.1} = "M48"

 $size_{.tbolt.2} = "M48"$

Cross-sectional diam. of bolts at root of thread or section of least diameter

 $d_{b.tbolt.1} = 41.5 \cdot mm$

 $d_{b.tbolt.2} = 41.51 \cdot mm$

under stress, if less:

Number of bolts:

 $n_{.tbolt.1} = 24$

 $n_{.tbolt.2} = 0$

Pressure load area:

 $A_{.press} = 2370705 \cdot mm^2$

Total gasket length:

 $L_{G.tbolt} = \, 12227 \! \cdot \! mm$

Real gasket width:

 $N_{.tbolt} = 10.5 \cdot mm$

Gasket material

gasketmaterial_{.tbolt} = "Elastomer"

Calculation pressure (incl static head of liquid):

 $p=1.301 \cdot MPa$

1a.2 Gasket parameters

Table 2-5.2 gives:

Basic gasket seating width:

$$b_{0.tbolt} := \frac{N_{.tbolt}}{2}$$

 $b_{0.tbolt} = 5.25 {\cdot} mm$

Effective gasket seating width:

$$\begin{array}{cccc} b_{.tbolt} := & & b_{0.tbolt} & \text{if} & b_{0.tbolt} \leq 6 \cdot mm \\ \\ & & & & \\ 2.5 \cdot \sqrt{mm} \cdot \sqrt{b_{0.tbolt}} & \text{otherwise} \end{array}$$

 $b_{.tbolt} = 5.25 \cdot mm$

Alfa Laval Inc.

Quality

Revision 1 Page 2 of 11 Table 2-5.1 gives:

Gasket factor:

 $m_{.tbolt}=\,1.0\,$

Min design seating stress:

 $y_{.tbolt} = 1.4 \cdot MPa$

1a.3 Total bolt load

Formulas 1 and 2 of 2-5 are rewritten to fit a noncircular shaped gasket line.

$$W_{m1.tbolt} := A_{.press} \cdot p + 2 \cdot b_{.tbolt} \cdot L_{G.tbolt} \cdot m_{.tbolt} \cdot p$$

 $W_{m1.tbolt} = 3251520\,N$

$$W_{m2.tbolt} := b_{.tbolt} \cdot L_{G.tbolt} \cdot y_{.tbolt}$$

 $W_{m2.tbolt}=\,89868\,N$

1a.4 Total required bolt area (2-5 (d))

$$S_{a.tbolt} := S_{.tbolt}$$

$$\textbf{S}_{b.tboit} := \, \textbf{S}_{.tbolt}$$

$$A_{m1.tbolt} := \frac{W_{m1.tbolt}}{S_{h.tbolt}}$$

$$A_{m2.tbolt} := \frac{W_{m2.tbolt}}{S_{a.tbolt}}$$

$$A_{m1.tbolt} = 18904 \cdot mm^2$$

$$A_{m2.tbolt} = 522 \cdot mm^2$$

1a.5 Total actual bolt area

$$A_{b.tbolt} := \left. n_{.tbolt.1} \cdot \frac{\pi}{4} \cdot d_{b.tbolt.1}^{} \right.^2 + \left. n_{.tbolt.2} \cdot \frac{\pi}{4} \cdot d_{b.tbolt.2}^{} \right.^2$$

$$A_{b.tbolt} = 32479 \cdot mm^2$$

$$\boldsymbol{A}_{m1.tbolt}$$
 and $\boldsymbol{A}_{m2.tbolt}$ shall be smaller than $\boldsymbol{A}_{b.tbolt}$

$$A_{m1.tbolt} < A_{b.tbolt} = \, 1$$

$$A_{m2.tbolt} < A_{b.tbolt} = 1$$

Alfa Laval Inc.

Quality

Revision 1 Page 3 of 11

2a Frame and pressure plates

Calculaton drawing(1) it em No.

No_{.plate} = "1 (Frame pl.), 2 (Press. pl.)"

The frame an pressure plate are calculated according to part U2 (g) of the code. A finite element analysis has been made for the weakest part of the covers. The results of typical analyses have been verified by means of strain gauge tests (report TD 8001-18).

2a.1 Results from finite element analysis

Finite element analysis no:

 $FEM_{no} = "T-T-0087"$

Input data to the analysis:

 $FEM_{input} = "tl35fdasmefp_model.db"$

Loading

Pressure used in the finite element analysis:

 $p_{b.plate} = 2.075 \cdot MPa$

Effective gasket width:

(1.2 above)

 $b_{.tbolt} = 5.25 \cdot mm$

Gasket length:

(1.1 above)

 $L_{G.tbolt} = 12227 \cdot mm$

Gasket factor:


(1.2 above)

 $m_{.tbolt}=\,1.0$

Gasket line load:

 $H_{p.plate} := 2 \cdot b_{.tbolt} \cdot L_{G.tbolt} \cdot m_{.tbolt} \cdot p_{b.plate}$

Schematic sketch of the upper quarter of the plate



$$d_{1.plate} = 289 \!\cdot\! mm$$

$$d_{3,plate} = 298 \!\cdot\! mm$$

$$\mathbf{d}_{.\mathrm{plate}}$$
 is the diameter of a supposed nozzle hole.

$$d_{.plate} = 331 \cdot mm$$

$$\mathbf{t}_{\mathrm{b.plate}}$$
 is the thickness used in the analysis.

$$t_{b.plate} = 109.7 \cdot mm$$

Stresses

$$\sigma_{A.plate} = 134.8 \cdot MPa$$

$$\sigma_{B.plate} = 0 \!\cdot\! MPa$$

$$\sigma_{D.plate} = 89.1 \cdot MPa$$

$$\sigma_{D1.plate} = 73 \cdot MPa$$

$$\sigma_{D2.plate} = 0 \cdot MPa$$

$$\sigma_{D3.plate} = 72.3 \cdot MPa$$

Alfa Laval Inc.



Revision 1 Page 5 of 11

2a.2 Required thickness of plate without nozzle opening

Frame material: material.plate = "SA516-70"

Allowable primary membrane stress (table UCS-23): $S_{.plate} = 138 \cdot MPa$

Allowable primary membrane plus bending stress (UG-23 (c)): $1.5 \cdot S_{.plate} = 207 \cdot MPa$

Calculation pressure (incl static head of liquid): p = 1.301 · MPa

Pressure used in finite element analysis: $p_{b.\text{plate}} = 2.075 \cdot \text{MPa}$

The required thickness is:

 $\sigma_{\text{max.plate}} \coloneqq \text{max} \Big(\sigma_{\text{A.plate}} \,, \, \sigma_{\text{B.plate}} \Big) \\ \sigma_{\text{max.plate}} = 134.8 \cdot \text{MPa}$

 $t_{r,plate} := t_{b,plate} \cdot \sqrt{\frac{\sigma_{max,plate}}{1.5 \cdot S_{.plate}} \cdot \frac{p}{p_{b,plate}}} \cdot \frac{p}{p_{b,plate}}$

Actual thickness: $t_{a.plate} = 109.7 \cdot mm$

 $t_{r,plate}$ shall be smaller than $t_{a,plate}$ (1=true, 0=false) $t_{r,plate} < t_{a,plate} = 1$

2a.3 Reinforcement of plate with nozzle opening

The nozzle opening is reinforced according to UG-39. The total reinforcement is taken from the material of the plate above the required thickness.

Four different cross sections which may be critical are investigated:

- I/ Section through area of max stress (point D in 2.1 above)
- II / Section where the geometry may not permit full use of the allowed reinforcement diameter d:

II.a through point D1 in 2.1 above

II.b through point D2 in 2.1 above

II.c through point D3 in 2.1 above

a / Required thickness at critical locations

$$t_{\text{rh.plate}} = t_{\text{b.plate}} \cdot \sqrt{\frac{\sigma}{1.5 \cdot S_{.plate}} \cdot \frac{p}{p_{\text{b.plate}}}}$$

where σ is; $\sigma_{D.plate}$, $\sigma_{D1.plate}$, $\sigma_{D2.plate}$ and $\sigma_{D3.plate}$ for the different locations given in 2.1.

 $t_{\rm b.plate}$ is given in 2.1.

 $S_{.plate}$, p and $p_{b.plate}$ are given in 2.2.

At the different locations:

$$t_{rhD.plate} := t_{b.plate} \cdot \sqrt{\frac{\sigma_{D.plate}}{1.5 \cdot S_{.plate}} \cdot \frac{p}{p_{b.plate}}}$$

 $t_{rhD.plate} = 57\!\cdot\! mm$

$$t_{rhD1,plate} := t_{b.plate} \cdot \sqrt{\frac{\sigma_{D1,plate}}{1.5 \cdot S_{.plate}} \cdot \frac{p}{p_{b.plate}}}$$

 $t_{rhD1.plate} = 51.6 \cdot mm$

$$t_{\text{rhD2.plate}} \coloneqq t_{\text{b.plate}} \cdot \sqrt{\frac{\sigma_{\text{D2.plate}}}{1.5 \cdot S_{\text{.plate}}}} \cdot \frac{p}{p_{\text{b.plate}}}$$

 $t_{rhD2.plate} = 0 \cdot mm$

$$t_{\text{rhD3.plate}} \coloneqq t_{\text{b.plate}} \cdot \sqrt{\frac{\sigma_{\text{D3.plate}}}{1.5 \cdot S_{\text{.plate}}}} \cdot \frac{p}{p_{\text{b.plate}}}$$

 $t_{rhD3.plate} = 51.3 \cdot mm$

Alfa Laval Inc.

Quality

Revision 1 Page 7 of 11

b / Required reinforcement areas

$$A_{.plate} = 0.5 \cdot d_{.plate} \cdot t_{rh.plate}$$

(UG-39)

where d_{.plate} is the opening diameter given in 2.1.

 $t_{\text{rh.plate}}$ for the different locations are calculated in a/ above.

At the different locations:

$$A_{D.plate} := 0.5 \cdot d_{.plate} \cdot t_{rhD.plate}$$

$$A_{D.plate} = 9432 \cdot mm^2$$

$$A_{D1.plate} := 0.5 \cdot d_{.plate} \cdot t_{rhD1.plate}$$

$$A_{D1.plate} = 8537.4 \cdot mm^2$$

$$A_{D2.plate} := 0.5 \cdot d_{.plate} \cdot t_{rhD2.plate}$$

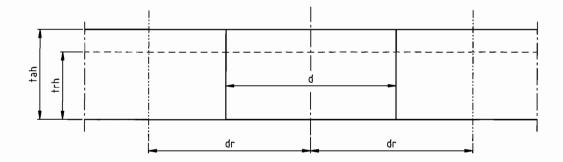
$$A_{D2.plate} = 0 \cdot mm^2$$

$$A_{D3.plate} := 0.5 \cdot d_{.plate} \cdot t_{rhD3.plate}$$

$$A_{D3.plate} = 8496.3 \cdot mm^2$$

c / Actual reinforcement areas.

(The actual reinforcement area is calculated according to UG-40.)



The figure above shows the finished nozzle hole where:

d_{.plate} is nozzle opening diameter given in 2.1

 $d_{r,plate}$ is d.plate or the smallest of $d_{1,plate}$, $d_{2,plate}$, $d_{3,plate}$ for each of the different locations given in 2.1

 $\mathbf{t}_{\mathrm{ah.plate}}$ is the actual thickness of a holed plate

$$t_{ah.plate} = 110 \cdot mm$$

 $t_{\text{th.plate}}$ is the required thickness at the different locations given in 2.3 a /

Alfa Laval Inc.

Quality

Revision 1 Page 8 of 11 The actual reinforcement area is:

$$A'_{.plate} = (t_{ah.plate} - t_{rh.plate}) \cdot (2 \cdot d_{r.plate} - d_{.plate})$$

The calculation shall be made for all four locations, see 2.3 above.

Þ

Section D:

$$A'_{D.plate} = 17546.1 \cdot mm^2$$

Section D1:

$$\text{A'}_{\text{D1.plate}} = 14428.4 \cdot \text{mm}^2$$

Section D2:

$$A'_{D2.plate} = 26730 \cdot mm^2$$

Section D3:

$$\text{A'}_{\text{D3.plate}} = \text{15545.6} \cdot \text{mm}^2$$

d / Comparison between actual and required reinforcement areas A' shall be greater than A for each of the four sections.

$$A'_{D,plate} = 17546.1 \cdot mm^2 \qquad \qquad A_{D,plate} = 9432 \cdot mm^2 \qquad \qquad A'_{D,plate} > A_{D,plate} = 1$$

$$A'_{D1,plate} = 14428.4 \cdot mm^2$$
 $A'_{D1,plate} = 8537.4 \cdot mm^2$ $A'_{D1,plate} > A_{D1,plate} = 1$

$$A'_{D2.plate} = 26730 \cdot mm^2 \qquad \qquad A_{D2.plate} = 0 \cdot mm^2 \qquad \qquad A'_{D2.plate} > A_{D2.plate} = 1$$

$$A'_{D3.plate} = 15545.6 \cdot mm^2$$
 $A_{D3.plate} = 8496.3 \cdot mm^2$ $A'_{D3.plate} > A_{D3.plate} = 1$

3a Stud bolts

$$No_{.sbott} = "6"$$

3a.1 Input parameters

$$material_{.sbolt} =$$
 "ASME SA-193 Gr.B7"

$$S_{.plate} = 138 \cdot MPa$$

$$d_{s.sbolt} = 25.4 \!\cdot\! mm$$

$$n_{.sbolt} = 12$$

$$N_{.sbolt} = 53 \cdot mm$$

$$D_{o.sbolt} = 437 \cdot mm$$

$$p = 1.301 \cdot MPa$$

3a.2 Gasket parameters

Basic gasket seating width:

$$b_{0.sbolt} \coloneqq \frac{N_{.sbolt}}{2}$$

$$b_{0.sbolt} = 26.5 \cdot mm$$

Effective gasket seating width:

$$\begin{array}{cccc} b_{.sbolt} \coloneqq & b_{0.sbolt} & \text{if} & b_{0.sbolt} \leq 6 \cdot mm \\ \\ 2.5 \sqrt{mm} \cdot \sqrt{b_{0.sbolt}} & \text{otherwise} \end{array}$$

$$b_{.sbolt} = 12.9 \cdot mm$$

Alfa Laval Inc.



Revision 1 Page 10 of 11 Gasket load reaction:

$$G_{.sbolt} := D_{o.sbolt} - 2 \cdot b_{.sbolt}$$

$$G_{.sbolt} = 411.3 \cdot mm$$

The factor/seating stress for a 1.6 mm thick mineral fiber gasket are used.

Table 2-5.1 gives:

Gasket factor:

$$m_{.sbolt}=2.75\,$$

Min design seating stress:

$$y_{.sbolt} = 26 \cdot MPa$$

3a.3 Total stud bolt load

2-5 formula 1 and 2 give:

Formula 1 (operating condition):

$$W_{m1.sbolt} := 0.785 \cdot G_{.sbolt} \cdot p + 2 \cdot b_{.sbolt} \cdot 3.14 \cdot G_{.sbolt} \cdot m_{.sbolt} \cdot p$$

$$W_{m1.sbolt} = 291673 \, N$$

Formula 2 (ga sket seating condition):

$$W_{m2.sbolt} := 3.14 \cdot b_{.sbolt} \cdot G_{.sbolt} \cdot y_{.sbolt}$$

$$W_{m2.sbolt} = 432099 \, N$$

3a.4 Required stud bolt area (2-5 (d))

$$S_{a.sbolt} := S_{.sbolt}$$

$$S_{b.sbolt} \coloneqq \, S_{.sbolt}$$

$$A_{m1.sbolt} := \frac{W_{m1.sbolt}}{S_{b.sbolt}}$$

$$A_{m2.sbolt} := \frac{W_{m2.sbolt}}{S_{a.sholt}}$$

$$A_{m1.sbolt} = 1696 \cdot mm^2$$

$$A_{m2.sbolt} = 2512 \cdot mm^2$$

3a.5 Total actual bolt area

$$A_{b.sbolt} := n_{.sbolt} \cdot \frac{\pi}{4} \cdot d_{b.sbolt}^{2}$$

$$A_{b.sbolt} = 4268 \cdot mm^2$$

$$A_{m1.sbolt}$$
 and $A_{m2.sbolt}$ shall be smaller than $A_{b.sbolt}$ (1=true, 0=false)

$$A_{m1.sbolt} < A_{b.sbolt} = 1$$

$$A_{m2.sbolt} < A_{b.sbolt} = 1$$

3a.6 Thread length in frame and pressure plate

according to UG-43(g) min thread length is:

$$L_{t.sbolt} := min \left(max \left(d_{s.sbolt}, 0.75 \cdot d_{s.sbolt} \cdot \frac{S_{.sbolt}}{S_{.plate}} \right), 1.5 \cdot d_{s.sbolt} \right)$$

$$L_{t.sbolt} = 25.4 \cdot mm$$

Actual thread length:

$$L_{ta.sbolt} = 32 \!\cdot\! mm$$

$$L_{ta.sbolt} > L_{t.sbolt} = 1$$



Maximum Allowable Nozzle Loads for Plate Heat Exchangers

Document MANL 30113-88708

Revision

<u>Date</u> 9-1-2011

This document specifies the maximum nozzle loads recommended by Alfa Laval for the Plate Heat Exchanger model listed below. As the Plate Heat Exchanger has at least four connections, the loads interact in a complex way. Therefore, if an individual value is exceeded it might be possible to increase that load component by decreasing another or simply defining the direction of the loads (+ or -).

PHE Data

Alfa Laval Model: TL35-BFD No. of Channel Plates: 543

Material of Channel Plates: Titanium Thickness of Channel Plates: 0.5 mm Carrying Bar Length: 4800 mm

Order Information

Customer: Mississippi Power Company

PO No.: MPC17837-0001

Item No.: HX1104, HX1204, HX1304 HX2104, HX2204, HX2304 A/L Order No.: J-41276 (408263) A/L Serial No.: 30113-88708 to 88713

The loads shown in the table below are for connections S1, S2, S3, S4 and are valid under only the following condtion(s).

- No other external loads such as wind or seismic load exists.
- The connections are studded ports.

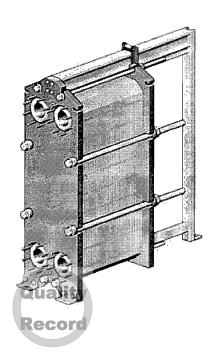
Deviations from these conditions will imply lower values.

A representative heat exchanger sketch, the directions of the coordinate system, and the table with the maximum recommended loads for the particular model are located below.

 F_X [LBF] = ± 482 F_y [LBF] = ± 482 F_z [LBF] = ± 482

 M_X [LBF-FT] = ± 2375 M_Y [LBF-FT] = ± 2375

 M_z [LBF-FT] = ± 2375









Alfa Laval Inc. 5400 International Trade Dr. Richmond, VA 23231

Date: 12/2/11 Rev.: 2

Doc. No.: ITP_30113-88708 Page 1 of 1

Customer Name: Mississippi Power

Title: Inspection and Test Plan for PHE's

PO No.: Item No.

Item No.:

MPC17837-0001

HX1104, HX1204, HX1304, HX2104, HX2204, HX2304

Model:

TL35-BFD

AL QA Contacts:

AL Order No: J-41276 (408263) Mike Pischke 804-236-1249

Serial No: 30113-88708 30113-88713 Aimee Barnard 804-236-1256

Legend

I - Inspection

R - Review Point

V - Verify W - Witness

to

O - Observation Point H - Hold Point AL - Alfa Laval Inc. AI - ASME Authorized Inspector Cust. - Customer

Activity Description	Specification/ Code Reference	Acceptance Criteria	Customer Submittal		nspecti		Comments
				AL	AI	Cust.	1
Receipt of Components	ASME VIII	Component Drawing		I, V			
Receipt of Cover Plates	ASME II	ASME II	MTR	I, V	R		
Receipt of Tightening Bolts	ASME II	ASME II	MTR	I, V	R		
Receipt of Tightening Nuts	ASME II	ASME II	MTR	I, V	R		
Receipt of Channel Plate	ASME II	ASME II	MTR	I, V	R		
Receipt of Gaskets	AL Spec.	AL Spec.		I, V			
Sandblasting	SSPC	SSPC SP-10 WI 26900		I, V		W	
Painting	Manufacturers Recommendations	WI-26001		I, V		W	
Welding	ASME IX	ASME VIII		I,V		W	Port Liners
NDE – Dye Penetrant	AL Spec.	WI-29005	Report	I,V		W	Port Liners
Assembly	AL Spec.	WI-24601		I, V		W	
Hydrostatic Testing	ASME VIII	WI-25001	Certificate	Н	Н	Н	
Air Dryng	AL Spec.	WI-24805		I,V			
Shroud	AL Spec.	Component Drawing		I,V			
Lifting Lugs	AL Spec.	AL Spec.		I,V			
Final Inspection	AL Spec.	Traveler		Н		Н	
Data Book	Cust. Spec.	AL and/or Cust. Spec.	Elec. Copy	R	R	R	
Shipment	AL Spec.	WI-28006	BOL	Н		Н	Shipping Release

Note: Customer witness/hold point notification required 10 days in advance to vendorqty@southernco.com

Prepared By: Dean Middleton Approved By: Mike Pischke Revision Description:






Plate Heat Exchanger Bill of Materials

Subject: TL30-BFD Document: BOM_30113-88708

Given are standard ASME/ASTM materials of construction.

<u>No.</u>	<u>Item</u>	Quantity Material		<u>Notes</u>	<u>Dimensions</u>
1.	Frame Plate	1	SA516-70	1	123 7/16" x 46 1/4"
2.	Pressure Plate	1	SA516-70	1	122 3/16" x 46 1/4"
3a.	Carrying Bar	1	Carbon Steel	1	4800 mm
3b.	T-Profile	1	SA479-304		
4.	Guide Bar	1	SA479-304		4800 mm
5.	Tightening Bolt	4	SA193-B7		M48 x 4650 mm
	Tightening Bolt	20	SA193-B7		M48 x 3450 mm
6.	Tightening Nut	4	SA194-2H	2	M48
	Tightening Nut	20	SA194-2H	2	M48
7.	Support Column	1	Carbon Steel	2 3 2 2 2 2	
8.	Support Foot	1	SA36	2	
9.	Frame Plate Foot	4	SA36	2	
	Pressure Plate Foot	4	SA36	2	
10.	Stud Bolt	48	SA193-B7	2	1" 8-UNC
11.	Connection Liner	4	SB265-Gr.1		
12.	Bearing Box	4	1017CS	2	
13.	Channel Plate Gasket	544	NBRP Clip-on		
14.	Channel Plate	543	SB265-Gr.1		88 1/4" x 39 1/8"
Not Sh	nown				
	OSHA Shroud	1	Aluminum		
	Tightening Bolt Cover	24	Polyethylene		
	Lifting Lugs	4	Carbon Steel		

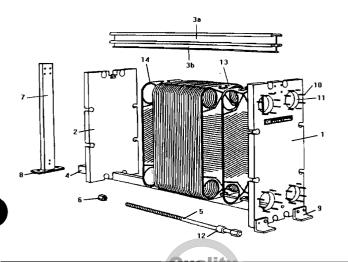Notes: (1) Painted. (2) Zinc Plated. (3) Hot Dip Galvanized. Drawing is not an accurate depiction, see GA Drawing.



Customer: Mississippi Power Company

P.O. No.: MPC17837-0001

Project: Kemper County IGCC Project Item No.: HX1104, HX1204, HX1304, HX2104, HX2204, HX2304

A/L Order No.: J-41276 (408263) A/L Serial No.: 30113-88708 to 88713

Document: BOM_30113-88708 Revision Level: 1 Date: 7/11/2011

Page 1 of 1





FRAME & PRESSURE PLATES



ARCELORMITTAL PLATE LLC

SHIP TO: ONEAL STEEL INC 1 BROAD ST CLIFTON NJ 07011 TEST CERTIFICATE

PAGE NO: 01 OF 02 FILE NO: 5985-23-53 MILL ORDER NO: 67096-002 MELT NO: C1057 SLAB NO: 5 DATE: 11/04/11

SOLD TO: O'NEAL STEEL, INC. P.O. BOX 98 BIRMINGHAM AL 35201-0098

SEND TO:

01-C

PLATE DIMENSIONS / DESCRIPTION

TOTAL QTY 1

WIDTH 96"

LENGTH DESCRIPTION

RECTANGLE

PIECE WEIGHT

30374#

CUSTOMER INFORMATION

GAUGE

4-3/8"

CUSTOMER PO: 2265350-OP-140

PART NO. 17945861

SPECIFICATION (S)

THIS MATERIAL HAS BEEN MANUFACTURED AND TESTED IN ACCORDANCE WITH PURCHASE ORDER REQUIREMENTS AND SPECIFICATION (S).

255"

ASME SA516 REV ED YR 10 GR 70 SPEC MOD FOR CARBON SPEC MOD FOR CHEMISTRY ASTM A516 10 GRADE 70 & UNS K02700 THE MANAGEMENT SYSTEMS FOR MANUFACTURE OF THIS PRODUCT ARE CERTIFIED TO ISO 9001:2000 (CERTIFICATE NO. 30130) AND ISO 14001 (CERTIFICATE NO. 009496).

CHEMICAL COMPOSITION

MELT: C1057

C MN P S .20 1.09 .015 .001

NI .10 CR .20

V TI B AL 001 .003 .0007

MANUFACTURE

MCQUAID-EHN GRAIN SIZE PER E112 - 7-8

TREAT CONDITION HEAT

MATL

OR TEST

HEAT TREAT DESCRIPTION

NOM TEMP

HOLD

PL/TEST

NORMALIZE

1650F

120

AIR COOL

Herbert Wathan

Digitally signed by Herbert Wathan DN: cn=Herbert Wathan, o, ou, com; c=US Date: 2011.12.12 10:10:14 -05'00'

WE HEREBY CERTIFY THE ABOVE INFORMATION IS CORRECT:

ARCELORMITTAL PLATE LLC QUALITY ASSURANCE LABORATORY 139 MODENA ROAD COATESVILLE, PA 19320

SUPERVISOR - TEST REPORTING

ELINORE ZAPLITNY



TEST

CERTIFICATE

PAGE NO: 02 OF 02

FILE NO: 5985-23-53

MILL ORDER NO: 67096-002

MELT NO: C1057

SLAB NO: 5

DATE: 11/04/11

TENSILE PROPERTIES

TENSILE STRENGTH PSI X 100 YIELD ELONGATION SLAB NO. STRENGTH PSI X 100 GAGE LGTH LOC DIR 2.00" 28.0 5 BOT. TRANS. 472 809

GENERAL INFORMATION

ALL STEEL HAS BEEN MELTED AND MANUFACTURED IN THE U.S.A. TEST CERTS. ARE PREPARED IN ACCORD. WITH PROCEDURES OUTLINED IN EN 10204:2004 TYPE 3.1. FOR MORE INFORMATION AND PROCESSING GUIDELINES, REFER TO WWW.ARCELORMITTAL.COM/PLATEINFORMATION

B/L #56183 LIEDTKA TRUCKING INC.

WE HEREBY CERTIFY THE ABOVE INFORMATION IS CORRECT:

ARCELORMITTAL PLATE LLC QUALITY ASSURANCE LABORATORY 139 MODENA ROAD COATESVILLE, PA 19320

SUPERVISOR - TEST REPORTING ELINORE ZAPLITNY

ARCELORMITTAL PLATE LLC

SHIP TO: ONEAL STEEL INC 1 BROAD ST CLIFTON NJ 07011 TEST CERTIFICATE

PAGE NO: 01 OF 02
FILE NO: 5985-23-53
MILL ORDER NO: 64783-003
MELT NO: C0489
SLAB NO: 8
DATE: 09/21/11

SOLD TO: O'NEAL STEEL, INC. P.O. BOX 98 BIRMINGHAM AL 35201-0098

SEND TO:

01-C

PLATE DIMENSIONS / DESCRIPTION

TOTAL PIECE WEIGHT GAUGE WIDTH LENGTH DESCRIPTION 3-3/4" 104" 210" RECTANGLE 23227#

CUSTOMER INFORMATION

CUSTOMER PO: 2261518-OP-140

PART NO. 17793684

SPECIFICATION (S)

THIS MATERIAL HAS BEEN MANUFACTURED AND TESTED IN ACCORDANCE WITH PURCHASE ORDER REQUIREMENTS AND SPECIFICATION(S).

ASME SA516 REV ED YR 10 GR 70 SPEC MOD FOR CARBON SPEC MOD FOR CHEMISTRY ASTM A516 10 GRADE 70 & UNS K02700 THE MANAGEMENT SYSTEMS FOR MANUFACTURE OF THIS PRODUCT ARE CERTIFIED TO ISO 9001:2000 (CERTIFICATE NO. 30130) AND ISO 14001 (CERTIFICATE NO. 009496).

CHEMICAL COMPOSITION

SI .20 MN P S .93 .012 .006 MELT: C0489

.001 .002 .0004 .026 .001 MELT: C0489

MANUFACTURE

MCQUAID-EHN GRAIN SIZE PER E112 - 7-8

HEAT TREAT CONDITION

MATL TEST

HEAT TREAT DESCRIPTION

NOM TEMP

HOLD MINS 129

COOL MTHD

PL/TEST

NORMALIZE

1650F

AIR COOL

Herbert Wathan.

Digitally signed by Herbert Wathan DN: cn=Herbert Wathan, o, ou, email=herbert.wathan@alfalaval. email=herbert.mus com, c=US Date: 2012.01.16 10:44:22 -05'00'

WE HEREBY CERTIFY THE ABOVE INFORMATION IS CORRECT:

ARCELORMITTAL PLATE LLC QUALITY ASSURANCE LABORATORY 139 MODENA ROAD COATESVILLE, PA 19320

SUPERVISOR - TEST REPORTING

ELINORE ZAPLITNY

TEST CERTIFICATE

PAGE NO: 02 OF 02

FILE NO: 5985-23-53

MILL ORDER NO: 64783-003

MELT NO: C0489

SLAB NO: 8

DATE: 09/21/11

TENSILE PROPERTIES

> ELONGATION GAGE LGTH % YIELD TENSILE STRENGTH PSI X 100 STRENGTH PSI X 100 SLAB NO. LOC DIR BOT. 778 2.00" 26.0 8 TRANS. 482

GENERAL INFORMATION

ALL STEEL HAS BEEN MELTED AND MANUFACTURED IN THE U.S.A. TEST CERTS. ARE PREPARED IN ACCORD. WITH PROCEDURES OUTLINED IN EN 10204:2004 TYPE 3.1. FOR MORE INFORMATION AND PROCESSING GUIDELINES, REFER TO WWW.ARCELORMITTAL.COM/PLATEINFORMATION

B/L #51948 LIEDTKA TRUCKING INC.

WE HEREBY CERTIFY THE ABOVE INFORMATION IS CORRECT:

ARCELORMITTAL PLATE LLC **QUALITY ASSURANCE LABORATORY** 139 MODENA ROAD COATESVILLE, PA 19320

SUPERVISOR - TEST REPORTING **ELINORE ZAPLITNY**

Record



CHANNEL PLATES



注 文 者 MITSUI BUSSAN SHIPPER CO.LID. 注文者源台番号: REFERENCE No. 519 -10419 契 約 番 号: CONTRACT No. 1-972-RR-5-9- 衛 品 名.	INSPECTION CERT		第万日本製練券末で輸記 Nippen Steel Corporation 本
COMMODITY TITANIUM SHEE 規格: ASME SB265 GR. SPECIFICATION ALTIT 4890-63	DE1 CUSTOMER ALFA LAVAL E10, AL1010310 ASTORAGE SONCP-95716	ROVED ACC. TO PED	証明日番号 頁 CERTIFICATE No. TC110891 PAGE 1F 発行年月日 DATE OF ISSUE 2011-09-08
打器 寸 法 員数 LIEW S I Z E QUANTITY No. MM	質量 管理 番号 引張 試M A S S 検査番号 溶解番号 コイル番号 耐力 引張強さ Y S I S KG INSPECTION No. HEAT No. COIL No. 12/3	硬さ 曲げ 野屋 エリクセン	化学成分
01 0 5X1000X2600 99	18-T7156 N14432 90-5428 TL A 181 32	1 4956 113 G 4 7 3467 7 4657 112 G 5	1
201	1. 173 1. 173 1. 173 18-17157 N14448 90-5440 1. 180 31 1. 174 200 30		
その他試験 寸法検査 表面検査 DESCRIPTION CIMENSIONAL SURFACE INSPECTION INSPECTION G G	注 款 G:含含 Good, 正丁 1:頂釘 Ti NOTES 正丁 J I S (5.No.5, B:No.13B) *9:X10	pp, M.中央部 Middle, B:底部 Bottom,	io, GSN. Grain Size Number, ER; Erichsen, 、 三氏 L.庄廷万向 Longitudinal。 I.蓝魚万向 Transverse、W·西万向 L&T、 ト分析 Ingol Analysis、P:製品分析 Product Analysis、単位 unit:IMPa=IN/mm²
	上配注文品は、御指定の規格または仕様に従って製造され、その要求率 WE HEREBY CERTIFY THAT THE MATERIAL BEEN MADE IN ACCORDANCE WITH THE RULI	多項を満足していることを証明します。	·



SH 注文 REEI 契 CON	文 者: MITSI IPPER CO 者照合番号: BENCE.No. 51.9 約 番 号: 1-97			品 検 PECTI								チャ	/ 麻滋知光	Nippc 社:〒 55. 16.	In Ste	743-8510	Soratio 代田医丸の MECHYODA WC母学市		4348		
規 SPEC	器 名: AMODITY TITAL A ASME CIFICATION ALII N I S H VACUL	\$B265 GRA 4890-63R	DE 1 RE10, AL101		นิลห์สิ่งอัซย์นี้.	家: CALFA CATECESTE	· UM	CP - 95		OVED A		1'0	PED		CERTIF		TC_1	10875 1-09-		頁 PAGE	: 1E
打翻 (TEM No.	寸 法。 S i Z, E MM	員 数 QUANTITY	質 型 MASS NET KG	管 CON 検査器号 IMSPECTION No.	理 番 TROL 溶解器号 HEAT No.	号	TEME	引 LE TEST 耐 対 Y S MPA	試 (GL: 2 引銀強さ TS	験 i N C H)	硬さ HARD- NESS HV	曲げ	結晶 エリクセン 粒度 GSN E R		H * 9	O *10	CHEMIC	学成AL COMPOS Fe C -10 *1	ITION	Part of the calls of the calls	% Ti
0.1	0.5X1000X2600	160		18-77155		90-542	TTA	178 202 181	310 321	3 3 6 5 4 9 5 6	1 1.3			On al ter Harrisalenia	I 1 P 2 I 1 P 2	.54	0	3	0		BAL.
	TOT	200	1,173									100 mm and				A					
												To the second se									Manager de la company de la co
DES	の他試験 寸法検達 CRIPTION DIMENSIONA TEST INSPECTION	SURFACE INSPECTION			注 NOT		Good	l, 🕦 T: :No.5, B:: *{	雅部 Top No.13B), 9:X.1.0	x, M:中央章 - ASTM 00 *1(3 Middl (A :1/2").) : X 1 0	e, B::	R: Yield Rati 感部 Bottom.	. 2	1. 压氮方	🗎 Longitu	dinal, 7	: 蓝角方向	Transverse	·、W:商方向 unit:1MPa=	L&T, ={N/mm²
ALAMADIAN	·		į.	£記注文品は、後 WE HEREB BEEN MADE				遠され,そ	の要求事		ている	ことを!			光 DE	タン事業 テタン管理 (PARTME)	部 ピグルーフ IT MANA	a yax			-



注文 BEEE	PPER 者頭合番号 RENCE.No 約 番 号 FRACT No.	<u>CO., LT</u>	BUSSAN D. -10419 RR-5-9-4	4			品 検 PECTION								本 HEAD OF テタン専実的 HIKARI TITA	Nip FICE 社	pon S	i tzel C 6071 東京 GNOUCHI2	株式会社 Orporatio 都千代E区丸。 GHOMECHIYOD 8510 山口県光T LTITANIUM GHVI ARESHLYAMAC	別 カ内二丁目 A-KUTOKYO	6 計 1 号 3 100-807 UAPA 3 4 3 4 計助 INUAPAN
規 SPEC	MODITY 格 IEICATION	TITANI ASME S ALIII	UM SHEET B265 GRA 4890-63R	DE1 E10, AL101	0310	结	家: ER ALFA OTRONO E EN10				OVED A	.cc.	TO PE	0	CERT 発行	年 月	No.	<u> </u>	191	頁 PAGE	: <u>1</u> E
行语		法	員数	質 量	管	晋 平	号		引 張	試	験	硬さ	曲げ給品	ニリクセン	-		化		成 分		%
I TEM	S I		ÇQUANTITY	MASS NET KG	C D N 検査番号 INSPECTION No.	溶解番号	N o . コイル番号 COIL No.		YS	引張強さ T_S	俳 U maxii	HARD-	BEND G S	1 1	*		N	the state that character a matter water		er afrigues and a property of the control of the co	A ha ha ha a children and a second se
01	0.5X100	0X2600	96		18-11156	W14432	90-542	8 T.L.A	1.81	321		113	3 G	4		1	4 0	3	0.		BAL.
			104			N14448	90-544	AIT AITO AIT	180	307 317 304	3 4 6 7 4 6 5 7	112	2 G	5	P II P	2 1 2	5 0	2	0		BAL.
Am. archard		TOTAL	200	1, 173																	
			200	1,173	18-11157	N14448	90-544	0 T L A T T A 		317 304	4657 3366		2 G	5	P	2	5 0	2	0		BAL.
	Control of the state of the sta		1				· · · · · · · · · · · · · · · · · · ·		<u> </u>												AND
			-					1						1			}				
DES)他試験 CRIPTION TEST	寸法檢查 CIMENSIONAL INSPECTION G	表面検査 SURFACE INSPECTION G			注 NOT	釈 G:合格	Good	t. III T: 5:No.5, B:1 *	頂部 To No.13B). 9・X10	p. M.中央截	5 Midd (A:1/2") }: X 1 (le, B進動 100	Gottom,		药商 Lon	gitudmat.	丁:面角	ichsen, 方向 Transvers I Analysis, 用负		
v. o			U		・記注文品は、8 WE HEREB BEEN MADE	Y CERTI	FY THAT	THE	進され、そ MATEI	の要求事 RIAL	項を満足し DESCRI	ている IBED	ことを証明 HEREI	N HAS		テタン! 光テタン DEPARTI	野業 記 管理グル MENT M/	ープリー ANAGER.			



関 約 番 号。 CONTRACT NO. 1-972-RR-5-9-4152	,	本 社:〒100-8071 東京都千代田医丸の内二丁目6番1号 HEAD OFFICE :61.MARINGUCHIC-CHONECHIYODA ANATOKYO 1038671JAPA チタン再製出売チラン管理グループ:〒743-8510 山口県北市大学島田3 4 3 4 巻地 HIKARH TITAHUM GUALTY CONTROL DEPL.TITAHUM DIVISION ・ ソ地がHIMATA HIKARI-SHI YAMAGUCHI 745-5510JAPAA 証明日示号: 西 CERTIFICATE No. IC110875 PAGE 1E
t I N i S H VACUUM ANNEALED TTB 寸 法 員数 質 量 ITEM S I Z E QUÄNTITY MASS 核	特 記 NOTE EN10204 3.1 / APPROVED ACC. TO PED 管理 番号 引張 試験 硬さ曲げ結晶 リックセン な で ACC NOTROL No. TENSILE TEST (QL. 2.1 NCH) お の は ACC NCH ARD BEND GSN E R Y S. T.S. EL IVR NESS TEST	発 打 年 月 日: DATE OF ISSUE 2011-09-01 化 学 成 分 CHEMICAL COMPOSITION H O N Fe C Ti *9 *10 *10 *10 *10 *10
01 0. 5×1000×2600	TT1155 N14216 90-5315TLA 178 329 4754 118 G 4 TT1A 202 310 3365 N14432 90-5428TLA 181 321 4956 113 G 4	1
TOTAL 200 1.173	TTA 20.6 30.7 34.67	
その他試験 寸法検査 表面検査	GL:總点距離 Gauge Length (D:4-/So, E:5.55-/So), YR: Yield Ratic 注 积 G:合格 Good, GTT T: 頂部 Top, M:中央部 Middle, B:维约 Bottom,	, GSN: Grain Size Number, ER: Erichsen. 正式 L:圧転対向 Longitudinal, T. 西角方向 Transverse, W:西方向 L&T.
ž.	NOTES	分析 Ingot Analysis、P・製品分析 Product Analysis、単位 unit・1MPa=1N:mm* E 0 3 I. Takayama チタン 事裏 部 光テタン管理がループリーダー DEPARTMENT MANAGER.



注 7 TRA	た者: DER	ALC	ONIX COI	RPORATI	ON					チ	タ	ン類	製品	検査	話記	明	書							鞣和				
	番号 : CONTRA		7C10-0 0	1			_		TIT	ANI	UM	IN:	SPEC'	MOIT	I CE	RTI	FICATE	•						KOB! M古川等		EL,		
	引名: MMODITY		<u>NIUM</u> SH	EET				無 要		: .		ALF	A LAVAL	AB										1, Kanaza			a-city, v	Jag
	各名 CIFICATIO	AL11	1 4890-6	3 REV.10	G1_			需要家注 CUSTOM				ОМО	P-92580										月書 番 号 TIFICATE		KT0994		頁: PAGE	1
仕 _ FINI	とげ: SH	ANN	ealed <u>a</u>	ND PICKL	.ED			注文仕 PURCHAS	羡書 No. SE SPEC	: FICA	TION	AL11 No.	1 4890-	63R10		_							f年月日 E OF ISS		2011~05	-02_		
番号 ·		寸 法 SIZE		員数	質 MA		cc	理番 ONTROLIN 品番	号	番号 .	*				引 ENSILI 耐力	張 E TES	T 引張強さ	※ 1(0		- 1	硬: HARDI	VESS	曲げ BEND TEST	結晶 粒度 GSN	エリクセン ER	法	外観	
ITEM No.		UNIT	:SPACE	QUAN- TITY	ACT K	UAL G	[] -	roduct No イル番 COtl No.	号门	ITEM No.	2	3		0,25 MP			T.S.	比 YR %	EL %	\dashv	(H) ※4 HV 5KG	※ 4	R=1.0T (S)※5 105°	% 8 A		Dimensional	Visual	
1	0.6	(1000 x 2	600	8		56	Q T3	367 014 552000)		1	T B	L L	MIN. MAX.	170 - 290 187 180	7		240 390 300 301	75 62 60			140 111 112		G G	4.0 7.0 6.5 6.5		G	G	
										1	T B	T	MIN. MAX.	190 290 231 231	7		240 390 301 297	79 78	25 36 38				G G					
番号				化	学		成 AL COMP		分 		96						備考 Remar											
ITEM No.	 2	H ※7 ×1000	0 ×100	N × 100	Fe × 100	C ×100						Ea	Other ch To	otal	Ti		THIS MA				JIVALENT 2010 GI	то						
1	MIN. MAX, T B	13 2 2		3	6 2 2	5 1 1									RE. RE.													
	WE MAD	HEREBY E TO TH	CERTIFY E APPLIC	THAT TH	E MATER	NAL DESC	製造され、 CRIBED H TESTED SATISFAC	EREIN HA	S BEEN RDANCE	足して	ている	。 こと	を証明し	ます。				_				MA	J.	Shi				10000000000000000000000000000000000000

NOTES: YR:Yield/Tensile Ratio, ER:Erichsen, G:合格Good.

※1: 得点距離 Gauge Length····A:50.0mm, B:50.8mm, C:5,65√Somm, D:11.3√Somm.

※2 T:頂部Top, M:中央部Middle, B:底部Bottom. ※3 L:圧延方向Longitudinal, T:直角方向Transverse.

※4:測定位置 Measuring Point D:断面Center of cross section,

S:表層Surface of cross section, H:表面Surface.

※5:表裛区分 Surface or Backface S:表Surface, B:裹Backface, W:表裹Both surface and backface.

※6:GSN Grain Size Number A:ASTMNo, H:比較法Comparison, J:実測Actual, N:NFNo. ※7 製品分析Product Analysis.



TRAE 製作i	者: DER 手号: CONTRA	10-37	NIX COF	RPORATIO	N		_						製品 SPEC				Ē				-	•	加古川乳 KOBi	は 鉄所加古 E STE	川市全 EL,	次町1番井
	名: MODITY	TTTAI	VIUM SHE	EET			*	票 要 CUSTO		: .		ALFA	LAVAL	AB		 _								AWA WOF wa-cho, Ka		a-city. Jap
規格	名; CIFICATIŌ		1 4890-6	3 REV.10	G1			需要家注	文番号			омс	P-92580									自書番号 TIFICATE		KT09945		頁:1 PAGE
	.げ:		ALED A	ND PICKL	ED		;	主文 仕 和 PURCHAS	t書 No.	:			1 4890-6	3R10							発行	年月日 E OF ISS	:	2011-05		
TITEM No. 合理	単位 INCH:".F	寸 法 SIZE UNIT EET∵.mm: : 1000 x 2		員数 QUAN- TITY 424 29 453		SS UAL	及 現 Pr [コ 1 AT3:	理 番 NTROL N 品 番 roduct No 、ル 番 COIL No. 367 001- 52000)	o. 号 · 号]	番号 .ON MILEM No. 1	7 B		MIN. MAX. MIN. MAX.		NSILE T 耐力 Y.S.	試 T.S. MPA 240 390 296 304 240 390 291 298	※1(C 降伏 比 YR % 75 59 59	伸び EL % 25 49 49 25	(+	硬d HARDN () ※4 HV 5KG 140 105 117		曲If BEND TEST R=1.0T (S)※5 105°	結晶 粒度 GSN *6 A 4.0 7.0 6.5 6.5	ER	†法 puolsusui() G	外観 lensiA G
春号				化	学		成 AL COMP		分		%					 備塊 Remai			_	l			1		ــــــــــــــــــــــــــــــــــــــ	L
ITEM No.	 <u></u> ※2	H ※7 ×1000	O ×100	N ×100	Fe × 100	C × 100		30111011				Ea	Other och T	otal	т	THIS MA	TER	IAL IS ME SB2			то					
1	MIN. MAX. T B	13 2 3		3	6 2 2	5 1 1									RE. RE.									6		-
	WE MAI	HEREBY DE TO TH	CERTIFY E APPLI	Eの規格す THAT TI CABLE SE ENTS OF	HE MATER	RIAL DES	CRIBED H	EREIN HA	RDANCE	Ē	てい	ること	き証明し	ます。							M	Z.	She B 質 OF QUA	LITY SES		

NOTES: YR:Yield/Tensile Ratio, ER:Erichsen, G:合格Good.

※1: 標点距離 Gauge Length…A:50.0mm, B:50.8mm, C:5.65√Somm, D:11.3√Somm.

※2 T: 頂部Top, M:中央部Middle, B:底部Bottom, ※3 L:圧延方向Longitudinal, T:直角方向Transverse.

※4:測定位置 Measuring Point D:断面Center of cross section,

S:表層Surface of cross section, H:表面Surface.

※5: 表裏区分 Surface or Backface S:表Surface, B:表Backface, W:表裏Both surface and backface.

※6:GSN Grain Size Number A:ASTMNo, H:比较法Comparison, J:英測Actual, N:NFNo. ※7 製品分析Product Analysis.





TIGHTENING BOLTS/NUTS



Date Folio Author 05/05/2011

1/1

APLATTEEUW

Certificat d'essais / Test Certificate NFEN 10204.3.1

NR 11098/36 - 2002/125 - 15023

ALFA LAVAL AB VMI

RUDEBOKSVAGEN P.O BOX 74

SE-221 00 LUND (SWEDEN)

VOTRE/YOUR REF N°

OMCF-147993/10

Poste/item Qte/Qty

500

NUT M48 (80X70)ASME SA194 2H ENISO

898-2 CL8 ADW7

COAT:ZN 20 MICRONS Plan 323242001-02 REV08

NUTS M48

Coulée : 1093310

Normes/Standard: ASME SA194 GRADE 2H ED 98+ADD07/99+07/2000

ANALYSE/HEAT ANALYSIS

С	Mņ	Si	s	Р	i	
0.45	0.55	0.18	0.019	0.008		

CARACTERISTIQUES MECANIQUES/MECHANICAL TEST

REV. T° C	HB-24H 540°C	НВ/ нв		
600	241/248	255/269		

Delivery state: quenched and tempered

Proof load test : not required

Juali

Visual and dimensional control : conform/

Marks on nuts: BC- 2H-8+ Heat code(FVG)+ STAMP TUV

We the undersigned, BECK CRESPEL, hereby certify that the supplied products are fully in accordance with the requirments of the order

This test certificate applies only the items, designation and quantities as described above

EN ISO 9001:2008 LRQA CERTIFICATION N°9105038300

BP 69 59427 ARMENTIERES CEDEX FRANCE TEL 03 20 77 78 88 FAX 03 20 77 82 39

Date Folio Author 05/05/2011 1/1

APLATTEEUW

Certificat d'essais / Test Certificate NFEN 10204.3.1

NR 11098/36 - 2002/125 - 15025

ALFA LAVAL AB VMI

RUDEBOKSVAGEN P.O BOX 74

SE-221 00 LUND (SWEDEN)

VOTRE/YOUR REF N°

OMCF-147993/10

Poste/item Qte/Qty

1 500 NUT M48 (80X70)ASME SA194 2H ENISO

898-2 CL8 ADW7

COAT:ZN 20 MICRONS Plan 323242001-02 REV08

NUTS M48

Coulée : 1093310

Normes/Standard : EN ISO 898-2 CLASSE 8 ADW7

ANALYSE/HEAT ANALYSIS

С	Mn	Si	s	P	
0.45	0.55	0.18	0.019	0.008	

CARACTERISTIQUES MECANIQUES/MECHANICAL TEST

НВ / нв			
255/269			

Delivery state: Quenched and Tempered

Proof load test: Not required Drift test: Not required

Visual and dimensional control : conform

Marks on nuts : BC 2H 8 : Heat code FVG + STAMP TUV

SEE PV 3 2 N°10001/58/13-a

Record

We the undersigned, BECK CRESPEL, hereby certify that the supplied products are fully in accordance with the requirments of the order

This test certificate applies only the items, designation and quantities as described above

EN ISO 9001:2008 LRQA CERTIFICATION N°9105038300

BP 69 59427 ARMENTIERES CEDEX FRANCE TEL 03 20 77 78 88 FAX 03 20 77 82 39



Certificat d'essais / Test certificate EN 10204.3.2

NR 10001/58/13-a

TUV RHEINLAND FRANCE

VOTRE/YOUR REF. NO: STOCK BC

MATIÈRES NORMES / MATERIAL SPECIFICATION : STEEL EN ISO898/2 CLASSE 8 ADW7

DÉSIGNATION / DESCRIPTION : 3164 NUTS M48 Drawing 323242001-02/8

ANALYSE / HEAT ANALYSIS

Dimensions Section

coulée

Heat

Si

NUTS M48

1093310

,450 ,180 ,550 ,019

BACHT N°

FVG

RÉSULTATS DES ESSAIS / TEST RESULTS

Dimensions

Hardness

Proof load

DRIFT TEST

Section

NUTS M48

Delivery condition

test

,008

68

on 20 nuts

255/269HB

NOT REQUIRED

NOT REQUIRED

Delivery state : Quenched and tempered Visual and dimensional control : Conform marks : BC-8-2H-FVG + STAMP TUV



KARRENBAUER 73060408/10001/58/13-4

We the undersigned, BECK CRESPEL, hereby certify that the supplied products are fully in accordance with the requirements of the order.

This test certificate applies only to the items, designation and quantities as described above. The original certificate carries a green stamp.

BP 69 59427 ARMENTIERES CEDEX FRANCE TEL. 03:20.77.78.88 FAX 03:20.77.82.39



Certificat de Réception 3.1 / EN 10204

SWISS STEEL

Providing special steel solutions



Client

154231

Cousin Malicet SA

Imprimé le

26.01.2010

Rue Bernissieux 23 FR-08120 Boony sur Meuse ALC:

	, , , , , , , , , , , , , , , , , , , ,	bogny sur me	4436			1000	45 E 63
Données du c	lient		Données de la c	ommande:		Données acier:	
N° Article			N° bon de livra	dson 25	175556	Nº matiére SWST	2645
Nuance	C45		Date de livrais	on bo	n de livraison	N° coulée	1093310
Commande	6668/5		N° client		025972	Ordre de productio	•
Destinataire			N° commande		115062	N° article	61063541
ARDENACIE	R Dépôt		Poids		132 KG	Diamètre / mm:	64.000
							
Analyse chin	•	9/	Essal de tract			Spéciale	
C Si	0.45	% %	Rp02	766	MPa MPa	, , , , ,	69 -
Min	0:18 0:55	%	Rm A5	855	wra %	HB (calc) 1	99
P	0:008	%	Essal de tracti	16.3 Ion traitó N		ĺ	
S	0:008	%	Rp02	532	MPa	l	
Ni Ni	0.07	%		635	MPa	ł	
Cr	0.08	%	Rm A5	24.6	%		
Mo	0.08	%	Résilience ISO				
Cu	0.14	%	KV1	68.00	J	j	
Sn	0.01	%	KV2	70 00	j ,	1	
Αſ	0.002	%	KV3	83.00	j		
V	0.002	%	KV-avg	74.00	j		
N	0.010	%	Résilience ISO			1	
14	0.010	, ,	KV1	117.00	.z - z 0		
			KV2	118.00	j	1	
			KV3	115.00	J	1	
			KV-avg	117.00	j		
			An Pri voi TÜ	lage uf/Fabr. m 01. (V Rheir	zum Nr. 13060 03 - 2011 Iland Indust	Zertifikat (08/4000/ rie Service	158/13-4

Conventions d'ordre:

Demarche qualité: Dr R. Saggau

Nous certifions que ces produits livrés sont conformes aux présciptions de la commande.

Imprimé electroniquement sans signature conforme EN 10204:2004 Remarque:

Nr 1: 850°C/30'/W/600°C/60' et résiliences KV1 à -20°C Nr 2: 850°C/30'/W/700°C/60' et résilences KV2 à 20°C

Fin de document





Date Folio Author

08/06/2011

1/1

APLATTEEUW

Certificat d'essais / Test Certificate NFEN 10204.3.1

NR 11098/37 - 2004/159 - 16184

ALFA LAVAL AB VMI

RUDEBOKSVAGEN P O BOX 74

SE-221 00 LUND (SWEDEN)

VOTRE/YOUR REF N°

OMCF-147994/10

Poste/item Qte/Qty

500

NUT M48 (80X70)ASME SA194 2H ENISO

898-2 CL8 ADW7

COAT:ZN 20 MICRÔNS Plan 323242001-02 REV08

NUTS M48

Coulée: 1093310

Normes/Standard: ASME SA194 GRADE 2H ED. 98+ADD07/99+07/2000

ANALYSE/HEAT ANALYSIS

С Si s Р Mn 0.019 0.008 0.45 0.55 0.18

CARACTERISTIQUES MECANIQUES/MECHANICAL TEST

HB/ REV. HB-24H 540°C 575 241/241 241/269

Delivery state: quenched and tempered

Proof load test: not required

Visual and dimensional control: conform

Marks on nuts: BC- 2H - 8 + Heat code GAC) STAMP TUV

We the undersigned, BECK CRESPEL, hereby certify that the supplied products are fully in accordance with the requirments of the order.

This test certificate applies only the items, designation and quantities as described above.

EN ISO 9001:2008 LRQA CERTIFICATION N°9105038300

BP 69 59427 ARMENTIERES CEDEX FRANCE TEL 03 20 77 78 88 FAX 03 20 77 82 39

SQ 058



Date 08/06/2011 Folio 1/1 Author **APLATTEEUW**

Certificat d'essais / Test Certificate NFEN 10204.3.1

NR 11098/37 - 2004/159 - 16185

ALFA LAVAL AB VMI

RUDEBOKSVAGEN P.O. BOX 74

SE-221 00 LUND (SWEDEN)

800.0

VOTRE/YOUR REF N°

OMCF-147994/10

Poste/item

NUT M48 (80X70)ASME SA194 2H ENISO

Qte/Qty

500

898-2 CL8 ADW7 COAT:ZN 20 MICRONS Plan 323242001-02 REV08

NUTS M48

Coulée : 1093310

0.45

Recor

ANALYSE/HEAT ANALYSIS С s P

0.019

CARACTERISTIQUES MECANIQUES/MECHANICAL TEST

0.18

Normes/Standard: EN ISO 898-2 CLASSE 8 ADW7

241/269

Delivery state: Quenched and Tempered

0.55

Proof load test: Not required

Drift test: Not required

Visual and dimensional control: conform

Marks on nuts : BC 2H 8 : Heat code GAC + STAMP TUV SEE PV 3 2 N°11001/58/5-a

We the undersigned, BECK CRESPEL, hereby certify that the supplied products are fully in accordance with the requirments of the order

This test certificate applies only the items, designation and quantities as described above

EN ISO 9001:2008 LRQA CERTIFICATION N°9105038300

BP 69 59427 ARMENTIÈRES CEDEX FRANCE TEL 03 20 77 78 88 FAX 03 20 77 82 39



Certificat d'essais / Test certificate EN 10204.3.2

NR 11001/58/5-a

TUV RHEINLAND FRANCE

VOTRE/YOUR REF. NO: STOCK BC

MATIÈRES NORMES / MATERIAL SPECIFICATION: STEEL EN ISO898/2 CLASSE 8 ADW7

<u>DÉSIGNATION / DESCRIPTION</u>: 2757 NUTS M48

Drawing 323242001-02/8

ANALYSE / HEAT ANALYSIS

Dimensions coulée

Section Heat C Si Mn S P

NUTS M48 1093310 ,450 ,180 ,550 ,019 ,008

BACHT N° GAC

RÉSULTATS DES ESSAIS / TEST RESULTS

Dimensions Hardness Proof load DRIFT TEST

Section Delivery condition test 6%

on 20 nuts

NUTS M48 241/269HB NOT REQUIRED NOT REQUIRED

Delivery state : Quenched and tempered Visual and dimensional control : Conform marks : BC-8-2H-GAC + STAMP TUV

IIU

QUALITY CONTROL
ASSISTANTIANAGER
A. EVATPEEUW

re the undersigned, BECK CRESPEL, hereby certify that the supplied products are fully in

accordance with the requirements of the order.

This test certificate applies only to the items, designation and quantities as described above. The original certificate carries a green stamp.

BP 69 59427 ARMENTIERES CEDEX FRANCE TEL. 03.20.77.78.88 FAX 03.20.77.82.39

Certificat de Réception 3.1 / EN 10204 Nº 154231

SWISS STEEL

Providing special steel solutions



Client

Cousin Malicet SA

imprimé le

26.01.2010

Rue Bernissieux 23 FR-08120 Boony sur Meuse

阿斯斯 Main

	FR-08120	Bogny sur M	euse			Dill.	
Données du c	llent:		Données de la	commande	:	Données acier:	
N° Article			N° bon de livr	raison 2	5175556	Nº matiére SWST	2645
Nuance	C45		Date de livrai	son þ	on de livraison	N° coulée	1093310
Commande	6668/5		N° client		0025972	Ordre de product	•
Destinataira			N° commande		1115062	N° article	61053541
ARDENACIE	R Dépôt		Polds		4132 KG	Diamètre / mm:	64.000
Analyse chin	nique		Essal de trac	tion traité	Nr. 1	Spéciale	
C	0.45	%	Rp02	758	MPa	1 '	269 -
Si	0.18	%	Rm	855	M₽a	HB (calc.)	199
Mn	0 55	%	A5	163	%	, , , , , , , ,	
P	0.008	%	Essal de tract	lon traité	Nr. 2	1	
S	0 0 1 9	%	Rp02	532	MPa	ł	
Ni	0.07	%	Rm	635	MPa		
Cr	80.0	%	A5	24.6	%		
Мо	0.01	%	Résillence ISC		√r.1 -20 °C		
Cus	0.14	%	KV1	68.00	J		
Sn	0.01	%	KV2	70 00	J		,
AI	0.002	%	куз	83.00	3	}	
V	0.00	%	KV-avg	74.00	4		
N	0 010	%	Résilience ISC)-V traitó N	lr.2 -20 °C	}	
			KV1	117.00	J		
			KV2.	118.00	J		
			KV3	115.00	, J		
			KV-avg	117 00	J	ì	
]	
		1]	
		1				1	
		j				1	
		İ				ľ	
		1				İ	
		ŀ					
		i				Į	
		{					
		i					
		ĺ			•	1	
						1	
		J				1	

Conventions d'ordre:

Nous certifions que ces produits livrés sont conformes aux présciptions de la commande

Imprimé electroniquement sans signature conforme EN 10204:2004 Remarque: Nr 1: 850°C/307/W/600°C/60' et résiliences KV1 à -20°C

Démarche qualité: Dr R Saggau

Nr 2: 850°C/30'/W/700°C/60' et résilences KV2 à -20°C

Anlage 1 zum Zertifikat
Pruf/Fabr. Nr. 13060408/11001/58/5d
vom 11-05-2011
TÜV Rheinland Industrie Service



February 2, 2012



Alfa Laval Inc. 5400 International Trade Drive Richmond, VA 23232 USA Tel: +1 804-222-5300

Tel: +1 804-222-5300 www.alfalaval.com

Reference:

Alfa Laval Order:

Serial Number: Model No.

Customer PO Number Cust. Item No

30113-88710 TL35-BFD

MPC17837-0001

41276 / 7646938

No HX1304

THREADED ROD & NUTS CERTIFICATE OF CONFORMANCE

Alfa Laval herby states that the threaded rod & nuts used to fabricate tightening bolts for the plate heat exchanger(s) referenced in the above P.O. have been verified to be of B7 carbon steel material. Additionally, if an ASME code stamp has been applied to the equipment, we hereby state that the threaded rod meets the applicable requirements of ASME Section VIII, Div.1.

Sincerely,

Aimee Barnard Quality Assurance

A. Barnard

Alfa Laval





PORT CONNECTIONS



January 27, 2012



Alfa Laval Inc. 5400 International Trade Drive Richmond, VA 23232 USA

Tel: +1 804-222-5300 www.alfalaval.com

Reference:

Alfa Laval Order:

Serial Number:

Customer PO Number

Model No. Cust. Item No 41276 / 408263

30113-88710 MPC17837-0001

TL35-BFD HX1304

PORT STUD CERTIFICATE OF CONFORMANCE

Alfa Laval herby states that the port studs used to fabricate the plate heat exchanger(s) referenced in the above P.O. have been verified to be of B7 carbon steel material. Additionally, if an ASME code stamp has been applied to the equipment, we hereby state that the threaded rod meets the applicable requirements of ASME Section VIII, Div.1.

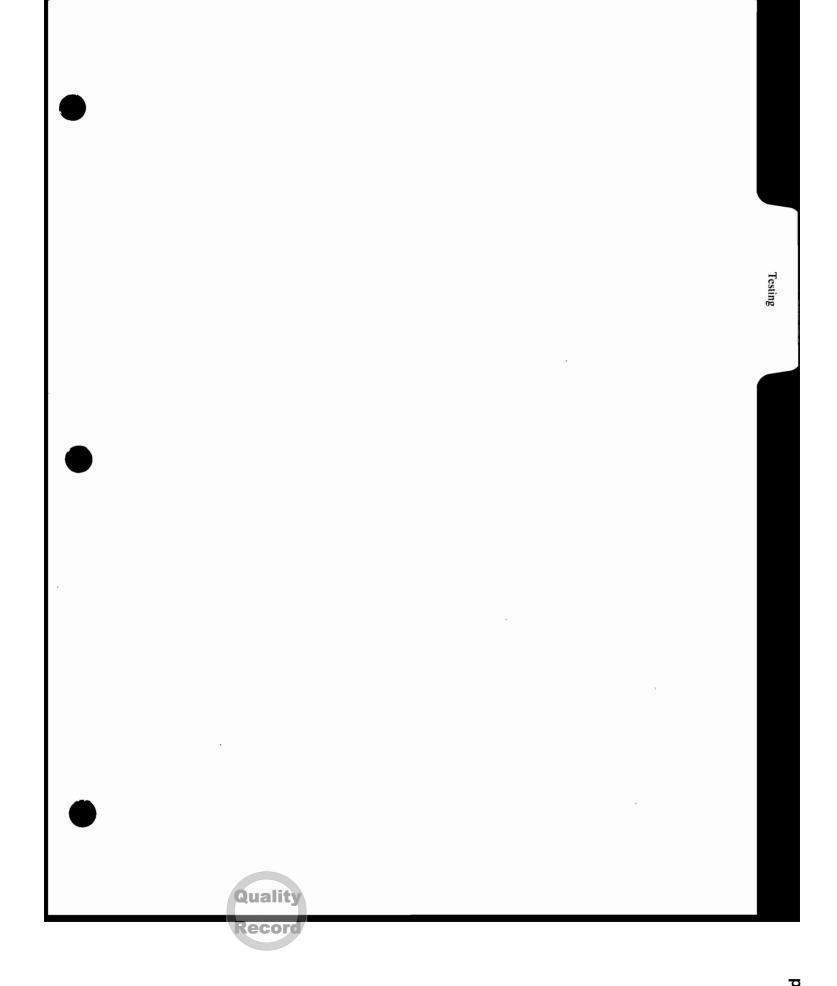
Sincerely,

Aimee Barnard Quality Assurance

A. Barnard

Alfa Laval







41276-87201-87215

Alfa Laval Inc. 5400 International Trade Dr. Richmond, VA 23231

Mississippi Power

Date: 4/6/10

Customer Name

Rev.: 5

Title: Liquid Penetrant Inspection Report


AL Order No.

Add Mat'l grade & thickness.

Doc. No.: Form 29006

Page 1 of 1

Serial Number	30113-88710	Item or Tag Number	HX1304
QUANTITY & DESCRIF	PTION OF ITEMS RECEIV	/ING DYE PENETRANT INSPECT	TION
-			
Performed By	Ron LaGrant	Qualified Level	2
Procedure Number	VVI 29005	Revision Level	12
Liquid Penetrant Type	Spot Check	Penetrant Designation	SKL-SP
Lighting Equipment	Flashlight	 Light Meter Reading	Exceeds FT. CND.
Material Grade	Titanium	Material Thickness	1mm and 2mm
Air Temperature	72	 Date/Time	1/19/2012
Results: _x _ No * Description & Location		itions were Relevant*	Non-relevant
* Description of Repair	s Made:		
* Repaired by		* PT Re-Performed by	
Witnessed by AI (if req	'd)		
	gitally signed by Aime		
Approved by QA Da	te: 2012.02.23 13:19:4	19 -05'00' Date	
Prepared By: Stacey F		Approved By: Mike Piso 2003 Addenda Section V, T-692 Rev 4	



Scope

This instruction describes the standard testing of all plate heat exchangers to meet the requirements of ASME Section VIII, Div.1 UG 99.

IMPORTANT: Failure to follow this procedure may cause permanent damage of the pressure vessel being tested and may result in injury.

Responsibilities

It is the responsibility of the Quality Designee to assure that this instruction is followed. The Authorized Inspector or Designated Inspector verifies the testing of U-Stamped vessels.

Definitions

MAWP – Maximum Allowable Working Pressure Test Pressure – 1.3x MAWP

Step-by-Step Instructions

- 1. Install test flanges or plugs at the appropriate inlet and outlet connections; refer to the GA drawing if needed. Some models are parallel flow, others are diagonal flow. As an option, flanges may be installed on all 4 ports. IMPORTANT: All necessary nuts, bolts, washers, gauges, and fittings must be attached to the vessel and properly tightened prior to testing.
- 2. Verify test gauges are in calibration. Record gauge numbers on the Traveler. NOTE: Dial indicating pressure gauges used in testing shall be graduated over a range of about double the intended maximum test pressure, in no case shall the range be less than 1.5 nor more than 4 times the maximum test pressure.
- 3. Refer to the Traveler for the MAWP and Test Pressure.
- 4. Fill single side of vessel with water, purge air, and pressurize to water supply pressure. As an option, if flanges are installed on the untested sides, fill that side with water, purge air and verify that the pressure is zero.
- 5. For U-1 vessels, notify the Authorized Inspector prior to the start of the hydrostatic test.

6. BEGIN HYDROSTATIC TEST

- a. Slowly pressurize the **first single** side of the PHE to **Test Pressure**.
- Maintain Test Pressure on the first side until verified by the AI or Designated Inspector for U-Stamped Units or the Quality Designee for UM Stamped vessels.
- c. When directed, reduce pressure on the first side to MAWP and inspect vessel for leaks. Maintain MAWP for a minimum of 10 minutes and until completion of the visual inspection.
- d. Release pressure on the first side until it reaches zero.
- e. If required, remove test flanges or plugs from the first side and install these test flanges or plugs on the second side of the PHE.
- f. Fill second single side of PHE with water, purge air, and pressurize to water supply pressure.
- g. Repeat steps a through d for the second single side.
- Release the pressure and drain PHE.

Record

HYDROSTATIC TEST ENDS HERE

7. Upon completion of a successful test, the Quality Designee shall complete the hydrostatic test portion of the traveler. The Authorized Inspector will show acceptance by signing off the traveler. The ASME Data Report will reference design and test pressures.

Forms/Records

Traveler ASME Data Report

Prepared By: Tommy Cashin	Approved By: Mike Pischke
Quality	



Alfa Laval Inc. 5400 International Trade Dr. Richmond, VA 23231

Date: 1/6/12

Rev.: 7

Title: Hydrostatic Test Certificate

Doc. No.: Form 25002

Page 1 of 1

CUSTOMER	Mississippi Power
P.O. NO.	MPC17837-0001
ALFA LAVAL NO	J-41276 / 770013
SERIAL NO.	30113-88710
ITEM NO. or MODEL TYPE	HX1304

ASME Hydrostatic Test No.	ا ان ان 🏖 🖟 Revision No.	*.*	
WI 25001		8	

	Test Pressure	Holding Time	A.I. Witness
Single	195 PSIG / 150 PSIG	2 MIN / 10 MIN	Herb Wathan
Single	195 PSIG / 150 PSIG	2 MIN / 10 MIN	Herb Wathan

C.I. Hydrostatic Test No.	Revision No.	
WI 25001	8	

	Test Pressure	Holding Time	Customer Witness
Single	195 PSIG / 150 PSIG	2 MIN / 10 MIN	Dan Sloan
Single	195 PSIG / 150 PSIG	2 MIN / 10 MIN	Dan Sloan

This hydrostatic pressure test was performed successfully with no visible internal or external leakage from the heat exchanger. Testing was witnessed as noted above.

APPROVED BY: Jason Gunnoe (QA Technician)

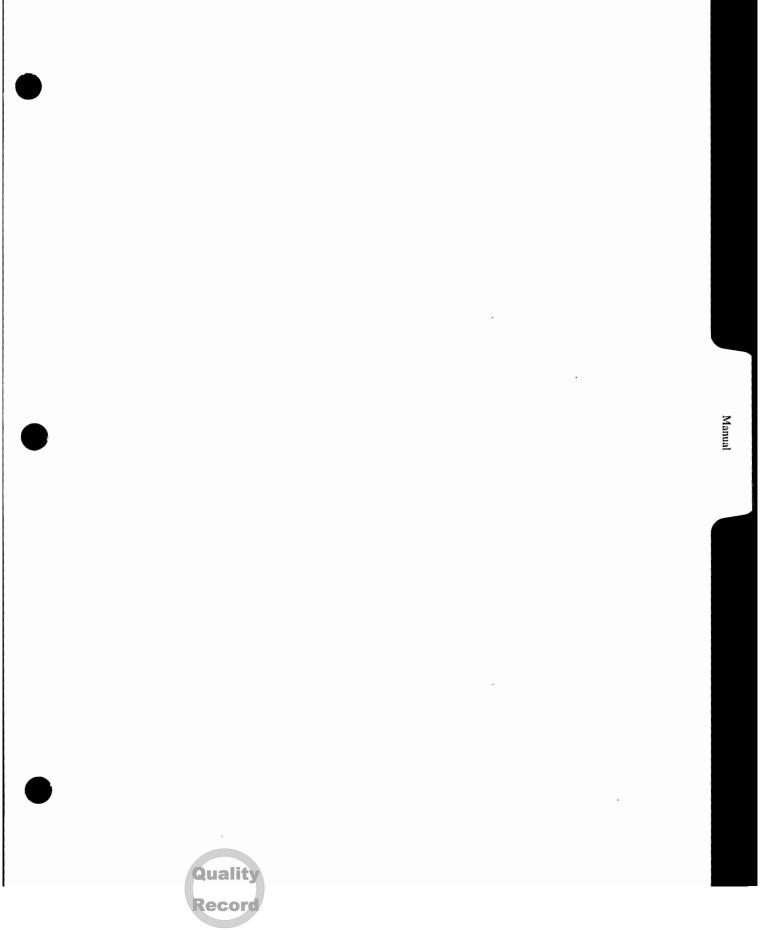
DATE OF ASME CODE TEST: 1/30/2012

DATE OF CUSTOMER WITNESS: 1/31/2012

Prepared By: Jason Gunnoe Approved By: Mike Pischke

Revision Description: Rev 7: Add sign off for CI inspection.

Record








Customer: Mississippi Power Company P.O. No.: MPC17837-0001 Project: Kemper County IGCC Project Item No.: HX1104, HX1204, HX1304, HX2104, HX2204, HX2304 A/L Order No.: J-41276 (408263) A/L Serial No.: 30113-88708 to 88713

Instruction Manual Plate Heat Exchangers

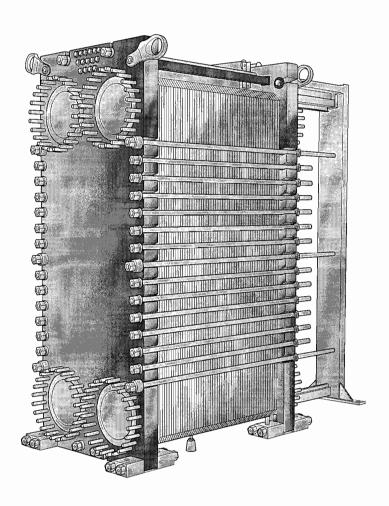TL35



Part number 34505491-01 uality 2010-11 Record



Table of Contents



Description	5
Main components	5
Function	
Identification of plate side	
Installation	7
Before installation	7
Requirements	7
Lifting	9
Operation	11
Start-up	11
Unit in operation	12
Shut-down	
Maintenance	13
Cleaning-In-Place (CIP)	
Manual cleaning	
Closing	19
Pressure test after maintenance	
Regasketing	

Original instructions
© COPYRIGHT Alfa Laval Lund AB 2010









Preface

This manual provides information needed to install, operate and carry out the maintenance of the Plate Heat Exchanger (PHE).

Safety considerations

The Plate Heat Exchanger shall be used and maintained in accordance with Alfa Laval's instructions in this manual. Faulty handling of the Plate Heat Exchanger may result in serious consequences with injuries to persons and/or property damage. Alfa Laval will not accept responsibility for any damage or injury that has resulted from not following the instructions in this manual.

The Plate Heat Exchanger shall be used in accordance with the specified configuration of material, media types, temperatures and pressure for the specific Plate Heat Exchanger.

The following models are covered in this manual:

TL35

Warranty conditions

The warranty conditions are usually included in the signed sales contract prior to the order of the delivered PHE. Alternatively, the warranty conditions are included in the sales offer documentation or with a reference to the document specifying the valid conditions. If faults occur during the specified warranty period, always consult your local Alfa Laval Representative for advice.

Report the date when the Plate Heat Exchanger was put into operation to the local Alfa Laval Representative.

Advice

Always consult your local Alfa Laval Representative for advice on:

- New plate pack dimensions if you intend to change the number of plates
- Selection of gasket material if operating temperatures and pressures are permanently changed, or if another medium is to be processed in the PHE.

Definitions of expressions



Warning!

Type of hazard

WARNING indicates a potentially hazardous situation that, if not avoided, could result in death or serious injury.



Caution!

Type of hazard

CAUTION indicates a potentially hazardous situation that, if not avoided, may result in minor or moderate injury.



Note!

NOTE indicates a potentially hazardous situation that, if not avoided, may result in property damage.

PHE drawings






Plate Heat Exchanger

34505491-01 rev 2010-11



Storage of the PHE

Alfa Laval delivers the PHE ready to be put into service upon arrival if nothing else has been agreed.

Regarding storage for longer periods of time, one month or more, certain precautions should be made to avoid unnecessary damage to the PHE.



Note!

Alfa Laval and its representatives reserve the right to inspect the storage space and/or equipment whenever necessary until the date of expiry of the warranty period stipulated in the contract. Notification has to be given 10 days prior to the date of inspection.

If there is any uncertainty about the storage of the PHE, consult an Alfa Laval Representative.

Storage

If the nature of storage after the delivery of the PHE is known in advance inform Alfa Laval when ordering the PHE to ensure that it will be properly prepared for storage.

Indoor storage

- Store inside a room with the temperature between 15 and 20°C (60 - 70°F) and humidity around 70%. For outdoor storage read "Outdoor storage" on this page.
- To prevent damage to the gaskets, there should not be any ozone-producing equipment in the room such as electric motors or welding equipment.
- To prevent damage to the gaskets, do not store organic solvents or acids in the room and avoid direct sunlight, intensive heat radiation or ultraviolet radiation.
- The tightening bolts should be well covered with light grease coating.

Outdoor storage

If the PHE has to be stored outdoors, all the precautions mentioned in the section "Indoor storage" on this page should be taken. Also, protection against climate is very important.

The stored PHE shall be visually checked every third month. The check includes:

- Greasing of the tightening bolts
- Port covers
- · Protection of the plate pack and gaskets

Taken out of service

If, for any reason, the PHE is shut down and taken out of service for a long period of time, follow the same advice as in the previous section "Indoor storage" on this page. Although before storage following actions has to be done.

- Check the measurement of the plate pack (measure between frame and pressure plate, A dimension).
- · Drain both media sides of the PHE.
- Depending on the media, the PHE should be rinsed and then dried.
- The connection should be covered if the piping system is not connected. Use a plastic or plywood cover for the connection.
- Cover the plate pack with non-transparent plastic film.

Installation after long-term storage

In cases when the PHE has been taken out of service for an extensive period of time, i.e. longer than one year, the risk of leakage when starting up increases. To avoid this problem it is recommended to let the gasket rubber rest and regain most of its elasticity.

- 1. If the PHE is not in position, follow the instructions "Installation" on page 7.
- 2. Note the measurement between frame and pressure plate (A dimension).
- 3. Remove feet attached to the pressure plate.
- Loosen the tightening bolts. Follow the instructions "Opening" on page 14. Open the PHE until the measure is 1.25A.
- Leave the PHE between 24-48 hours, the longer the better, for gaskets to relax.
- Re-tighten according to the instructions "Closing" on page 19.
- 7. Alfa Laval recommends a hydraulic test to be carried out. The media, usually water, should be entered at intervals to avoid sudden shocks to the PHE. It is recommended to test up to the Design Pressure, refer to PHE drawing.







Environmental compliance

Alfa Laval endeavours to perform its own operations as cleanly and efficiently as possible, and to take environmental aspects into consideration when developing, designing, manufacturing, servicing and marketing its products.

Unpacking

Packing material consists of wood, plastics, cardboard boxes and, in some cases, metal straps.

- Wood and cardboard boxes can be reused, recycled or used for energy recovery.
- Plastics should be recycled or burnt at a licensed waste incineration plant.
- · Metal straps should be sent for material recycling.

Maintenance

- All metal parts should be sent for material recycling.
- Oil and all non-metal wear parts must be taken care of in agreement with local regulations.

Scrapping

At end of use, the equipment shall be recycled according to relevant, local regulations. Besides the equipment itself, any hazardous residues from the process liquid must be considered and dealt with in a proper manner. When in doubt or in absence of local regulations, please contact the local AlfaLaval sales company.

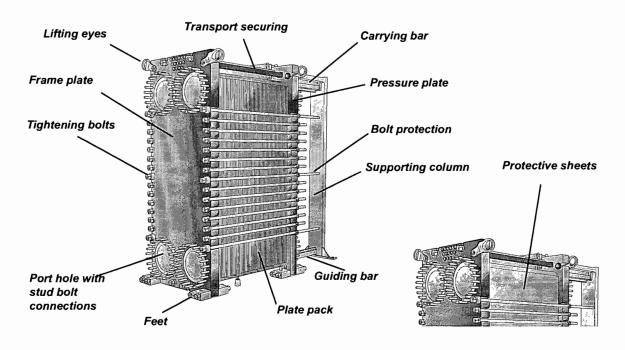




Description



Main components



Bolt protection	Plastic tubes that protect the threads of the tightening bolts.		
Carrying bar	Carries the plate pack and the pressure plate.		
Frame plate	Fixed steel plate with a number of port holes for the connection of the piping system. The carrying and guiding bars are supported by the frame plate.		
Guiding bar	Keeps the channel plates and the pressure plate in line at their lower end.		
Plate pack	Heat is transferred from one medium to the other through the plates. The plate pack consists of channel plates, end plates, gaskets and, in some cases, transition plates. The measure of the plate pack is the A dimension, i.e the measurement between frame and pressure plate. Refer to PHE drawing.		
Port holes with stud bolt connections	Port holes through the frame plate allow the media to enter into or exit from the Plate Heat Exchanger. Different types of connections can be used to connect the piping system to the apparatus. Threaded stud bolts around the port holes secure the connections to the apparatus. The port holes may be protected against corrosion by metal or rubber linings. The PHE can be equipped with different connection types. For details refer to PHE drawings.		
Pressure plate	Moveable steel plate that can contain a number of port holes for the connection of the piping system.		
Protective sheets	Cover the plate pack. Mandatory in the USA. Optional in other countries.		
Supporting column	Supports carrying and guiding bars.		
Tightening bolts	Compress the plate pack between the frame and pressure plate.		
Lifting eyes	Used for lifting and transport securing.		
Transport securing	Locking device fastened between the frame and the pressure plate.		

Quality Record

Plate Heat Exchanger

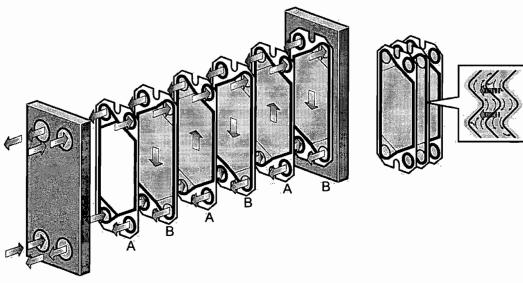
EN -5



Function

The Plate Heat Exchanger (PHE) consists of a pack of corrugated metal plates with port holes for input and output for the two separate fluids. The heat transfer between the two fluids will take place through the plates.

The plate pack is assembled between a frame plate and a pressure plate and compressed by tightening bolts. The plates are fitted with a gasket that seals the channel and directs the fluids into alternate channels. The plate corrugation promotes fuid turbulence and supports the plates against dfferential pressure.




Principle of plate pack arrangement

Identification of plate side

Identification stamp

Material stamp







Installation



Before installation

To consider before installation

- Before connecting any piping, make sure all foreign objects have been flushed out of the piping system that should be connected to the PHE.
- Before start-up, check that all tightening bolts are firmly tightened and that the correct measurements of the plate pack are used. Refer to PHE drawing.
- When connecting the piping system make sure the pipes do not subject the PHE to stress or strain.
- To avoid water hammer, do not use fast-closing valves.
- Safety valves should be installed according to current pressure vessel regulations.
- If the PHE surface temperature is expected to be hot or cold, the PHE should be insulated.
- It is recommended that protective sheets are used to cover the plate pack.
- For each model, design pressures and temperatures are marked on the identification plate.
 These must not be exceeded.

Requirements

Space

Please refer to the delivered drawing for actual measurements.

- A minimum free space (1) is needed for lifting plates in and out.
- A free space (2) is needed underneath lower tightening bolts for maintenance (a free space equal to the minimum length of the tightening bolts is an alternative).
- The maximum height (3) of the foundation bolts at the pressure plate may be limited.
- Supports (4) for the guiding bar may be needed.

Foundation

Install on a foundation giving enough support to the frame.

Elbow

To make it easier to disconnect the PHE, an elbow should be flanged to the connection in the pressure plate, directed upwards or sideways, and with another flange located just outside the contour of the Plate Heat Exchanger.

Shut-off valve

To be able to open the PHE, shut-off valves should be provided in all connections.

Drip tray (optional)

Depending on the type of fluid in the PHE and the type of installation, a drip tray (drairage box) may be

necessary to avoid injury to personnel and damage to equipment.

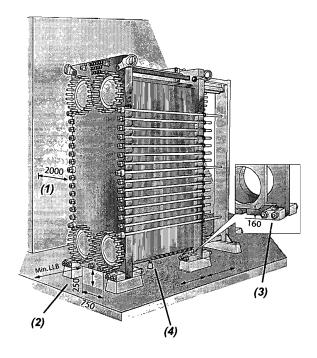


Note!

Put the drip tray in place before positioning the PHE.

Connections in the pressure plate

It is important that the plate pack has been tightened to the correct dimension A (check against PHE drawing) before the piping system is connected.








Lifting

ΕN


Straps should be used when lifting the PHE. Place straps according to picture.

The straps shall be attached according to the figures and with a minimum angle of 45°. Refer to the figure below.





Lifting device TL35 PHE.



For detailed information, contact an Alfa Laval Sales Representative for the document "Cargo Securing Instructions" (3490003791, 3490003792, 3490003793).





Operation

Start-up

During start-up, check that no visible leakages appear from the plate pack, valves or piping system.



Note!

If several pumps are included in the system, make sure you know which one should be activated first.




Note!


Adjustments of flow rates should be made slowly in order to avoid the risk of pressure surge (water hammer).

Water hammer is a short-lasting pressure peak that can appear during start-up, or shut-down of a system, causing liquids to travel along a pipe as a wave at the speed of sound. This can cause considerable damage to the equipment.

Before start-up check that all tightening bolts are firmly tightened and that the dimension A is correct. Refer to PHE drawing.



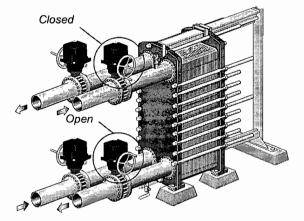
Check that the valve is closed between the pump and the unit controlling the system flow rate.




If there is a valve at the exit, make sure it is fully open.



Open the air vent and start the pump.



Open the valve slowly.






Notel

Avoid rapid temperature changes in the PHE. With media temperatures over 100°C, slowly increase the temperature preferably at least for one hour.

6

When all air is expelled, close the air vent.



Repeat steps 1-6 for the second media.





ΞN

Unit in operation

Adjustments of flow rates should be made slowly in order to protect the system against sudden and extreme variations of temperature and pressure.

During operation, check that media temperatures and pressures are within the limits stated on the PHE-drawing and identification plate.


Shut-down



Note!

If several pumps are included in the system, make sure you know which one should be stopped first.

Slowly close the valve controlling the flow rate of the pump you are about to stop.




When the valve is closed, stop the pump.

Repeat steps 1–2 for the other side for the second media.



If the PHE is shut down for several days or longer, it should be drained. Draining should also be done if the process is shut down and the ambient temperature is below the freezing temperature of the media. Depending on the media processed, it is also recommended to rinse and dry the PHE plates and connections.





Maintenance

To keep the Plate Heat Exchanger in good condition regular maintenance is required.

The plates need to be cleaned on a regular basis. The frequency depends on several factors such as type of media and temperatures. Three methods can be used to perform cleaning. Refer to "Cleaning-In-Place (CIP)" on page 13, "Manual cleaning" on page 14 or a reconditioning at an Alfa Laval service center.

After a longer period of use, it may be required to regasket the PHE by exchanging the gaskets. Refer to "Regasketing" on page 21.

Other maintenance that should be performed regularly:

- Keep carrying bar and guiding bar cleaned and greased
- Keep the tightening bolts cleaned and greased.

Cleaning-In-Place (CIP)

The Cleaning-In-Place (CIP) equipment permits cleaning of the PHE without opening it. The results of cleaning with CIP are as follows:

- Cleaning of fouling and descaling of lime deposits
- Passivation of cleaned surfaces to reduce susceptibility to corrosion
- Neutralization of cleaning liquids before draining. Follow the instructions of the CIP equipment.



Warning!

Corrosive cleaning liquids can cause serious injuries to skin and eyes!




Alfa Laval guarantees that plates, gaskets or glue are not damaged if the procedures given and cleaning agents prescribed are followed.

The CIP equipment will be specifically engineered for each individual set of process. Contact your local Alfa laval representative for firm quotation.

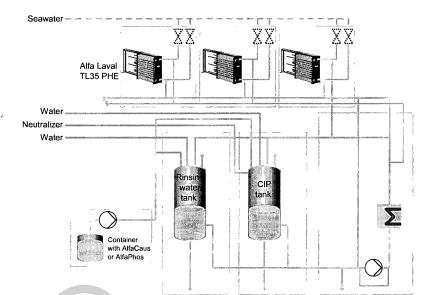
A general view of the main CIP-process is shown in the picture below.

If CIP cannot be done, cleaning must be done manually. Refer to section "Manual cleaning" on page 14.









34505491-01 rev 2010-11

Plate Heat Exchanger

IN -13





Cleaning liquids

Liquids	Description
AlfaCaus	A strong alkaline liquid, for removing paint, fat, oil and biological deposits.
AlfaPhos	An acid cleaning liquid for removing metallic oxides, rust, lime and other inorganic scale. Contains repassivation inhibitor.
AlfaNeutra	A strong alkaline liquid for the neutralization of AlfaPhos before drainage.
Alfa P-Neutra	For the neutralization of Alfa P-Scale.

Liquids	Description
Alfa P-Scale	An acidic powder cleaner for the removal of of primary carbonate scale but also other inorganic scale.
AlfaDescalent	A non-hazardous acidic cleaning agent for the removal of inorganic scale.
AlfaDegreaser	A non-hazardous cleaning agent for the removal of oil, grease or wax deposits. Additionally prevents foaming when using Alpacon Descaler.

Manual cleaning

To perform manual cleaning it is required to open the PHE and lift out the plates to clean them.

1

Drain the Plate Heat Exchanger.

Opening



Notel

Before opening the PHE check the warranty conditions. If in any doubt, contact an Alfa Laval sales representative. Refer to "Warranty conditions" on page 2.



Warning!

If the Plate Heat Exchanger is hot, wait until it has cooled down to about 40°C (104°F).






Warning!

If necessary, use proper protective equipment, such as safety boots, safety gloves and eye protection, depending on type of media in the PHE.










2

Inspect the sliding surfaces of the carrying bar and clean and grease it.











Plate Heat Exchanger


34505491-02 rev 2010-11



Mark the plate assembly on the outside with a diagonal line (alternative wait for the plate pack to be opened and then mark each plate at the top end area in numerical order).



Measure and note the dimension A.




Note!

Brush the threads of the tightening bolts with a steel wire brush and then grease before loosening them.

5

For loosen and remove the feet of the pressure plate refer to. "Procedure of opening and removing of the TL35, pressure plate" on page 16 Keep the six bolts in position, according to the figure below. Loosen the other bolts and remove them.






The remaining six bolts are opened alternately and diagonally in two steps, see figures below.

Be careful to ensure that the frame plate and pressure plate are always in parallel. Skewing of the pressure plate during opening must not exceed 10 mm (2 turns per bolt) across the width and 25 mm (5 turns per bolt) vertically.

Step	Bolt No.	To dimension	
1	1-2-3-4-5-6	1.05A	
2	1 - 2 or 3 - 4	Opening	

Step 1: Loosen the six bolts alternately and diagonally until the place package measures 1.05A.










Step 2: Remove bolt 5 and 6 completely. Loosen the two diagonal pairs of bolts alternately, as shown in the figure below.



Open the plate pack by letting the pressure plate glide on the carrying bar.



Caution!

To avoid hand injuries from sharp edges, protective gloves should always be worn when handling plates and protective sheets.







Note!

Plates should be numbered, do this before removing the plates.


Plates do not need to be removed if cleaning is done using only water, i.e. without cleaning agent.




ing" on page 14.




Remove the nuts of the foundation bolts located at the outside



Remove the nut / the bolt that connected the feet against the pressure plate



Remove the outer feet.





Warning!

The plate pack may still contain a small residual amount of liquid after draining. Depending on the type of product and type of installation, special arrangements, e.g. drainage box, may be necessary to avoid injury to personnel and damage to equipment.








2

Lifting of a single plate shall be in a controlled way.



Insert the plates with the herring bone pattern positioned in alternate directions and with the gaskets turned towards the frame plate.




Removal, lifting and insertion of plates in the field

Open the plate pack by letting the pressure plate glide on the carrying bar.

Each plate shall be removed one by one, preferably by one person on each side of the plate.

The plate package shall be pressed towards the frame plate in steps, preferably by using a Pusher towards theupper part of the plate.





Warning!

If hard winds or risk of contamination of the plates the removal shall be made in restricted and safe envitonment.

To avoid sharp edges protective gloves should always be worn.

Lifting in edges around the ports shall be avoided.







Manual cleaning of opened units



Caution!

Never use hydrochloric acid with stainless steel plates. Water of more than 330 ppm Cl may not be used for the preparation of cleaning solutions. It is very important that carrying bars and support columns in aluminium are protected against chemicals.



Note!

Be careful not to damage the gasket during manual cleaning.

Deposits removable with water and brush


Plates do not need to be removed from the PHE during cleaning.




Warning!

If necessary, use proper protective equipment. Consider risks like loose particles and what kind of media has been used in the PHE.

Start cleaning when the heating surface is still wet and the plates are hanging in the frame.





Rinse with water using a high pressure hose.



Deposits not removable with water and brush

Plates must be removed from the PHE during cleaning. For a choice of cleaning agents, refer to "Cleaning liquids" on page 14.



Warning!

Use proper protective equipment, such as safety boots, safety gloves and eye protection, when using the cleaning agents.










Warning!

Corrosive cleaning liquids can cause serious injuries to skin and eyes!




1

Brush with cleaning agent.



2

Rinse immediately with water.





Note!

Long exposure to the cleaning agents can damage the gasket glue.

EN -18



Plate Heat Exchanger

34505491-02 rev 2010-11




Closing

Follow the instructions below to ensure that the Plate Heat Exchanger will be properly closed.

Check that all the sealing surfaces are clean.

Brush the threads of the bolts clean, using a steel wire brush or the Alfa Laval thread cleaner. Lubricate the threads with a thin layer of grease, e.g. Gleitmo 800 Lubriplate or equivalent.




Attach gaskets to the plates or check that all the gaskets are properly attached.



If the gasket is wrongly positioned, it will show by the fact that it rises out of the gasket groove or that it is positioned outside the groove.

Insert the plates in alternate directions and with the gaskets turned towards the frame plate or pressure plate as specified on the plate hanging list. Use the marked line that was done when the PHE was opened (alternative use the numbers that was marked when the PHE was opened). Refer to step 3 in "Opening" on page 14.



If the plates are correctly assembled, the edges form a "honeycomb" pattern, see picture below.






6 Press the plate assembly together. Tightening is done in three steps, see figures below. Be careful to ensure that the frame plate and the pressure plate are always in parallel.

Step	Bolt No.	To dimension
1	1-2-3-4	1.20A
2	1-2-3-4	1.10A
3	1-2-3-4-5-6	Α

Step 1: Tighten the two diagonal pairs of bolts alternately until the plate package measures 1.20A.

Be careful to ensure that the frame plate and pressure plate are always in parallel. Skewing of the pressure plate during opening must not exceed 10 mm (2 turns per bolt) across the width and 20 mm (4 turns per bolt) vertically.









ΞN

Step 2: Tighten the two diagonal pairs of bolts alternately until the plate package measures 1.10A.

Be careful to ensure that the frame plate and pressure plate are always in parallel. Skewing of the pressure plate during opening must not exceed 10 mm (2 turns per bolt) across the width and 20 mm (4 turns per bolt) vertically.



Step 3: After that, bolts are tightened alternately and diagonally, as shown in the figure below. Check the dimension A during tightening at the positions of the bolts that are being used.



Note!

The final tightening to reach dimension A is recommended to be divided into steps.

Max tightening torque

When a pneumatic tightening device is used, see table below for maximum torque. Measure dimension A during tightening.

Bolt size	Bolt with bearing box		Roll with wash		washers
	N·m	kpm	N·m	kpm	
M39	1300	130	2000	200	
M48	2100	210	3300	330	
M52	2100	210	3300	330	

For manual tightening, the tightening torque has to be estimated.

If dimension A cannot be reached

- · Check the number of plates and the dimension A.
- Check that all the nuts and bearing boxes are running freely. If not, clean and lubricate, or replace.

Place the other bolts in position.

- · Inspect the washers.
- When fully tightened, the bolts should all be equally tensioned.
- Assembly the feet to the pressure plate.



Pressure test after maintenance



Before start-up of production, whenever plates or gaskets have been removed, inserted or exchanged, it is strongly recommended to perform a pressure test to confirm the internal and external sealing function of the PHE. During this test, one media side at a time must be tested with the other side open to the ambient pressure.

Caution!

The pressure testing shall be performed at a pressure equal to the operating pressure of the actual unit, but never above the design pressure as stated on the nameplate.

The recommended test time is 10 minutes for each

Please note that PHE units for refrigeration applications and units with media not mixable with water must be dried after hydrostatic pressure testing.

Please consult the local office/representative of the supplier for advice on the pressure testing procedure.

Regasketing

The procedures below relate to Field gaskets, Ring gaskets and End gaskets.



Note!

Before removing the old gaskets check how they are attached.

Clip-on


Open the PHE, [refer to "Opening" on page 14] and remove the plate that is to have a new gasket.



Note!


Before opening the PHE check the warranty conditions. If in any doubt, contact an Alfa Laval sales representative. Refer to "Warranty conditions" on page 2.

- Remove the old gasket.
- Ensure that all sealing surfaces are dry, clean and free of foreign matter such as fat, grease or similar.
- Check the gasket and remove rubber residual before attaching it.





Attach the clip-on gasket to the plate. Slip the gasket prongs under the edge of the plate.






Note!

Make sure the two gasket prongs are in the correct position.

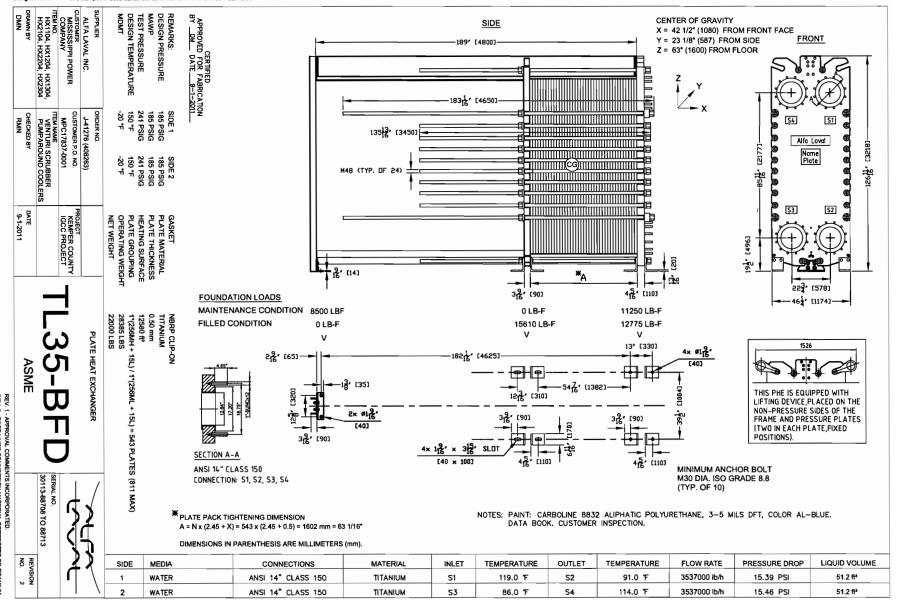6 Repeat the procedure until all plates that are needed to be regasketed are done. Close the PHE according to "Closing" on page 19.








Only to the extent expressly agreed by us this document may constitute a contractual obligation on our part.

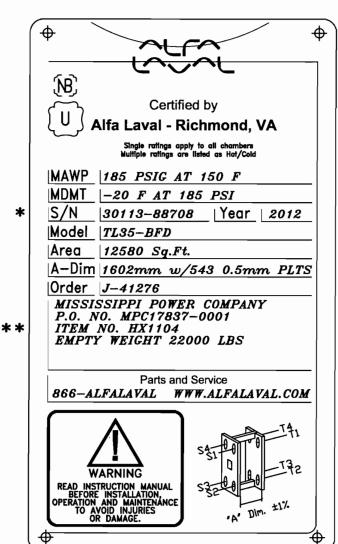This document and lits contents are the exclusive property of Alfa Laval Thermal AB and must not be copied, reproduced, transmitted or communicated to any other party or used for purposes not expressly permitted by us.



Record

Kanter brutna Grader avl(gsnade Ytj(mnhet Ra Edges broken Burrs removed Surface roughn. In Ra Toleranser d(r e) annat angetts. Avser sp)navskil, bearbetn, kilppta eller stan-sade ytor. Tolerances where not stated. Chip cutting, shearing or punching. Basm)tt Tol. Basic size 6 : 0.2 (1) (6) 30 ± 0.5 (30) 120 : 0.8 315 : 1.2 (120) (315) 1000 : 2 (1000) 2000 : 3 (2000) 4000 : 4

SIRSKILDA KRAV
SPEC. REQUIREMENTS

*30113-88709 30113-88710 30113-88711 30113-88712 30113-88713

**HX1204 HX1304 HX2104 HX2204 HX2304

	₽ ₀			32380175	-01	AS	ME NAM	E PLATE	SA240-	-316		
\vdash	<u> </u>	Qty	Item	Article No.		'	Name/Designation		Material (final condition)/Blank		Note	
	Descr		No.	Dept. Product Engineering	1/16/	/12	NTS	Title A	SME NAN	ME PLAT	LE	
	scription			DM DM	Approved RM	7	Third angle projection ISO nethod E					
				DESIGN NOTIFICATION Project No.: Change Level:				Ta Laval Drawing No. Thermal AB NP-887		8708	Rev. No. 2	
	ρ	— მ		Text				Richmon	d, VA			
	ř											
	date			Quality								




Plate Heat Exchanger Bill of Materials

Subject: TL30-BFD Document: BOM_30113-88708

Given are standard ASME/ASTM materials of construction.

<u>No.</u>	<u>ltem</u>	Quantity	<u>Material</u>	<u>Notes</u>	<u>Dimensions</u>
1.	Frame Plate	1	SA516-70	1	123 7/16" x 46 1/4"
2.	Pressure Plate	1	SA516-70	1	122 3/16" x 46 1/4"
3a.	Carrying Bar	1	Carbon Steel	1	4800 mm
3b.	T-Profile	1	SA479-304		
4.	Guide Bar	1	SA479-304		4800 mm
5.	Tightening Bolt	4	SA193-B7		M48 x 4650 mm
	Tightening Bolt	20	SA193-B7		M48 x 3450 mm
6.	Tightening Nut	4	SA194-2H	2	M48
	Tightening Nut	20	SA194-2H	2	M48
7.	Support Column	1	Carbon Steel	3 2	
8.	Support Foot	1	SA36	2	
9.	Frame Plate Foot	4	SA36	2	
	Pressure Plate Foot	4	SA36	2	
10.	Stud Bolt	48	SA193-B7	2	1" 8-UNC
11.	Connection Liner	4	SB265-Gr.1		
12.	Bearing Box	4	1017CS	2	
13.	Channel Plate Gasket	544	NBRP Clip-on		
14.	Channel Plate	543	SB265-Gr.1		88 1/4" x 39 1/8"
Not Shown					
	OSHA Shroud	1	Aluminum		
	Tightening Bolt Cover	24	Polyethylene		
	Lifting Lugs	4	Carbon Steel		

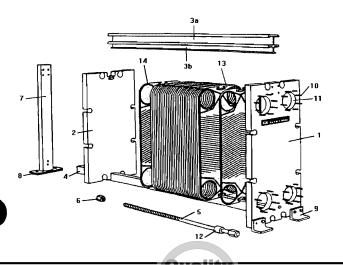Notes: (1) Painted. (2) Zinc Plated. (3) Hot Dip Galvanized. Drawing is not an accurate depiction, see GA Drawing.



Customer: Mississippi Power Company

P.O. No.: MPC17837-0001

Project: Kemper County IGCC Project Item No.: HX1104, HX1204, HX1304, HX2104, HX2204, HX2304

A/L Order No.: J-41276 (408263) A/L Serial No.: 30113-88708 to 88713

Document: BOM_30113-88708 Revision Level: 1 Date: 7/11/2011 Page 1 of 1

Alfa Laval, Plate Heat Exchanger Specification Channel Plate Installation Description

Document: SPEC_30113-88708
Pate: 9-1-2011
Rev. 2

Customer: Mississippi Power Company

P.O. No.: MPC17837-0001

Project: Kemper County IGCC Project Item No.: HX1104, HX1204, HX1304, HX2104, HX2304

A/L Order No: J-41276 (408263) Serial No: 30113-88708 to 30113-88713

Model Type: TL35-BFD

104 HX1204 HX1304

Plate material and Thickness: Titanium 0.50 mm

A Dimension: $A = N \times (2.45 + X)$

 $A = 543 \times (2.45 + 0.5) = 1602 \text{ mm}$

Grouping: 1* (256MH+15L) 1* (256ML+15L)
Sealing material: NBRP Clip-on NBRP Clip-on
Port Locations: S1 -> S2 S3 -> S4
Connection material: Titanium Titanium

Port hole with flow on the gasketed side: U
Port hole sealed with O-ring: O

Plates are assembled with the gasket side facing the frame plate.

Plate no.	Plate code no.	Plate Pattern	Punched upper right	l corner of lower right	the plate lower left	upper left	Flow direction on the gasket side of the plate
			S1	S2	S3	S4	
	FRAME PLATE		=>=	=<=	=<=	=>=	
1	39507591 83	TL35 B2 A	0	0	0	0	
2	39507540 03	TL35 B2 B	U	>- U	0	0	Down
3	39507539 03	TL35 B1 A	0	0	U>	U	Up
4	39507540 03	TL35 B2 B	U	> U	0	0	Down
5	39507539 03	TL35 B1 A	0	0	U>	U	Up
6,	8, , 508	39507540 03 TL35 B2 B	;				•
7,	9, , 509	39507539 03 TL35 B1 A					
510	39507540 03	TL35 B2 B	U	> U	0	0	Down
511	39507539 03	TL35 B1 A	0	0	U>	U	Up
512	39507540 03	TL35 B2 B	U	> U	0	0	Down
513	39507539 03	TL35 B1 A	0	0	U>	U	Up
514	39507539 03	TL35 B1 B	U	> U	0	0	Down
515	39507539 03	TL35 B1 A	0	0	U>	U	Up
516	39507539 03	TL35 B1 B	U	> U	0	0	Down
517,	519, , 537	39507539 03 TL35 B1 /	Α				
518,	520, , 538	39507539 03 TL35 B1	В				
539	39507539 03	TL35 B1 A	0	0	U>	U	Up
540	39507539 03	TL35 B1 B	U	> U	0	0	Down
541	39507539 03	TL35 B1 A	0	0	U>	U	Up
542	39507539 03	TL35 B1 B	U	> U	0	0	Down
543	39507591 76	TL35 B2 A			>	-	Up
	PRESSURE PL	_ATE					
			T1	T2	Т3	T4	



Alfa Laval, Plate Heat Exchanger Specification Channel Plate Installation Description

Document: SPEC_30113-88708
Date: 9-1-2011 Rev. 2

Plate Part No:	Quantity:	Total:
39507591 83	1	6
39507540 03	256	1536
39507539 03	285	1710
39507591 76	1	6
	543	3258





Customer: Mississippi Power Company

P.O. No.: MPC17837-0001

Project: Kemper County IGCC Project Item No.: HX1104, HX1204, HX1304 HX2104, HX2204, HX2304

PHE Model: TL35-BFD

Serial No.: 30113-88708 to 88713 Order No.: J-41276 (408263)

Date: 7/11/2011

ALFA LAVAL INC. PLATE HEAT EXCHANGER SPARE PARTS LIST

Document: SPL_30113-88708

Revision: 1

Part Description	Part Number	Total Qty. Per Unit	Cost Each
NBRP Clip-on Channel Plate Gasket	39007015 06	544	\$110.00 USD

Alfa-Laval recommends 5% to 10% extra gaskets be kept as spare parts for startup and commissioning and two years of operation. Prices shown are valid for thirty days from the date above.

If you wish to order special tools at a later date, please contact one of our After-Sales Service Centers.

Alfa-Laval Inc. Richmond Service Center 5400 International Trade Drive Richmond, VA 23231

Phone: 804-236-1273 Fax: 804-236-1360 Alfa-Laval Inc. Parts & Services Northwoods Industrial Park 12249A FM529 Houston, TX 77041 Phone: 713-896-4491

Fax: 713-896-9892

