



SCHEMATIC - WYE CONN 3-LEAD

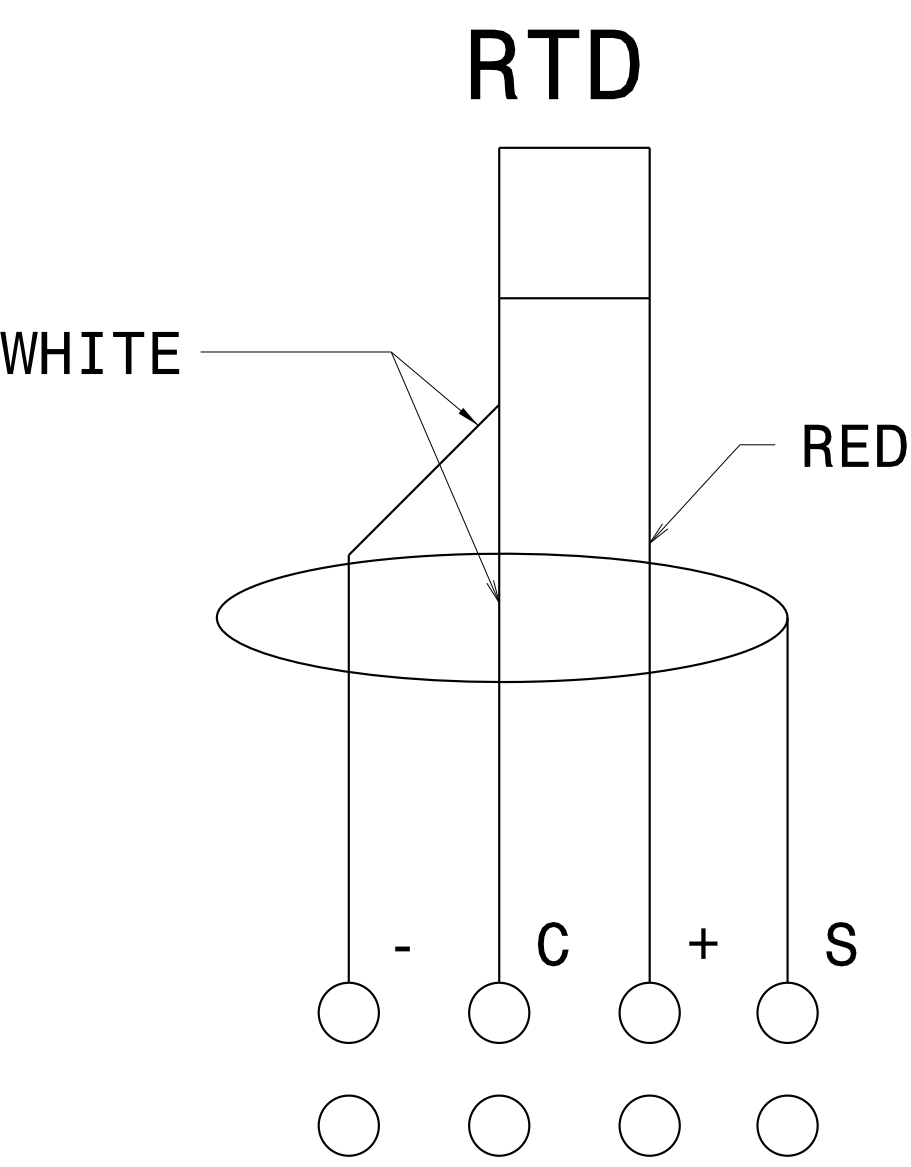


TYPICAL STATOR TEMPERATURE DETECTOR

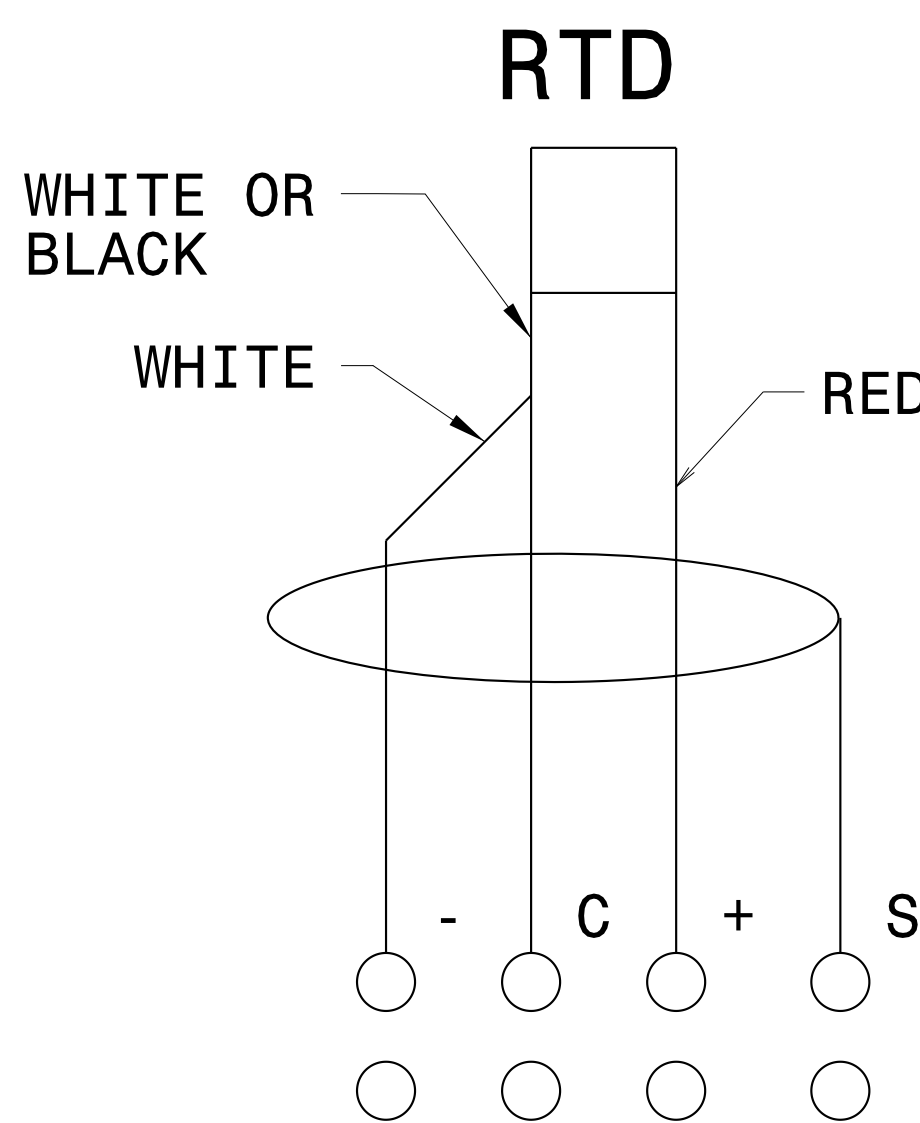


TYPICAL BEARING TEMPERATURE DETECTOR

Serial No: P269C021-1-2-3  
Customer: MISSISSIPPI POWER COMPANY  
Project: Kemper County IGCC  
PO No: MPC10024810  
Pump Item No: 01G-HE-PU-6032, 6033, 6034  
Motor Item No: 01G-HE- MO-6032, 6033, 6034  
Service: GI Closed Loop Cooling Water Pump


L1 L2  
POWER SUPPLY

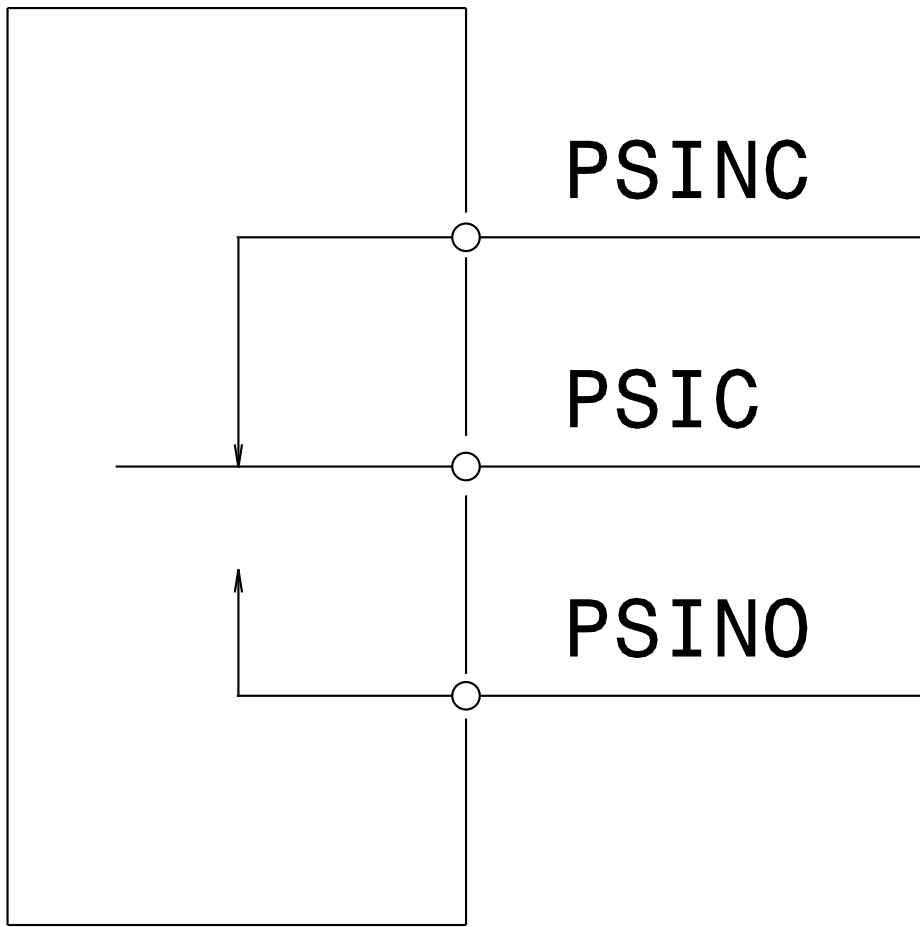

DIFFERENTIAL PRESSURE SWITCH SCHEMATIC  
(WITH POWER SUPPLY)

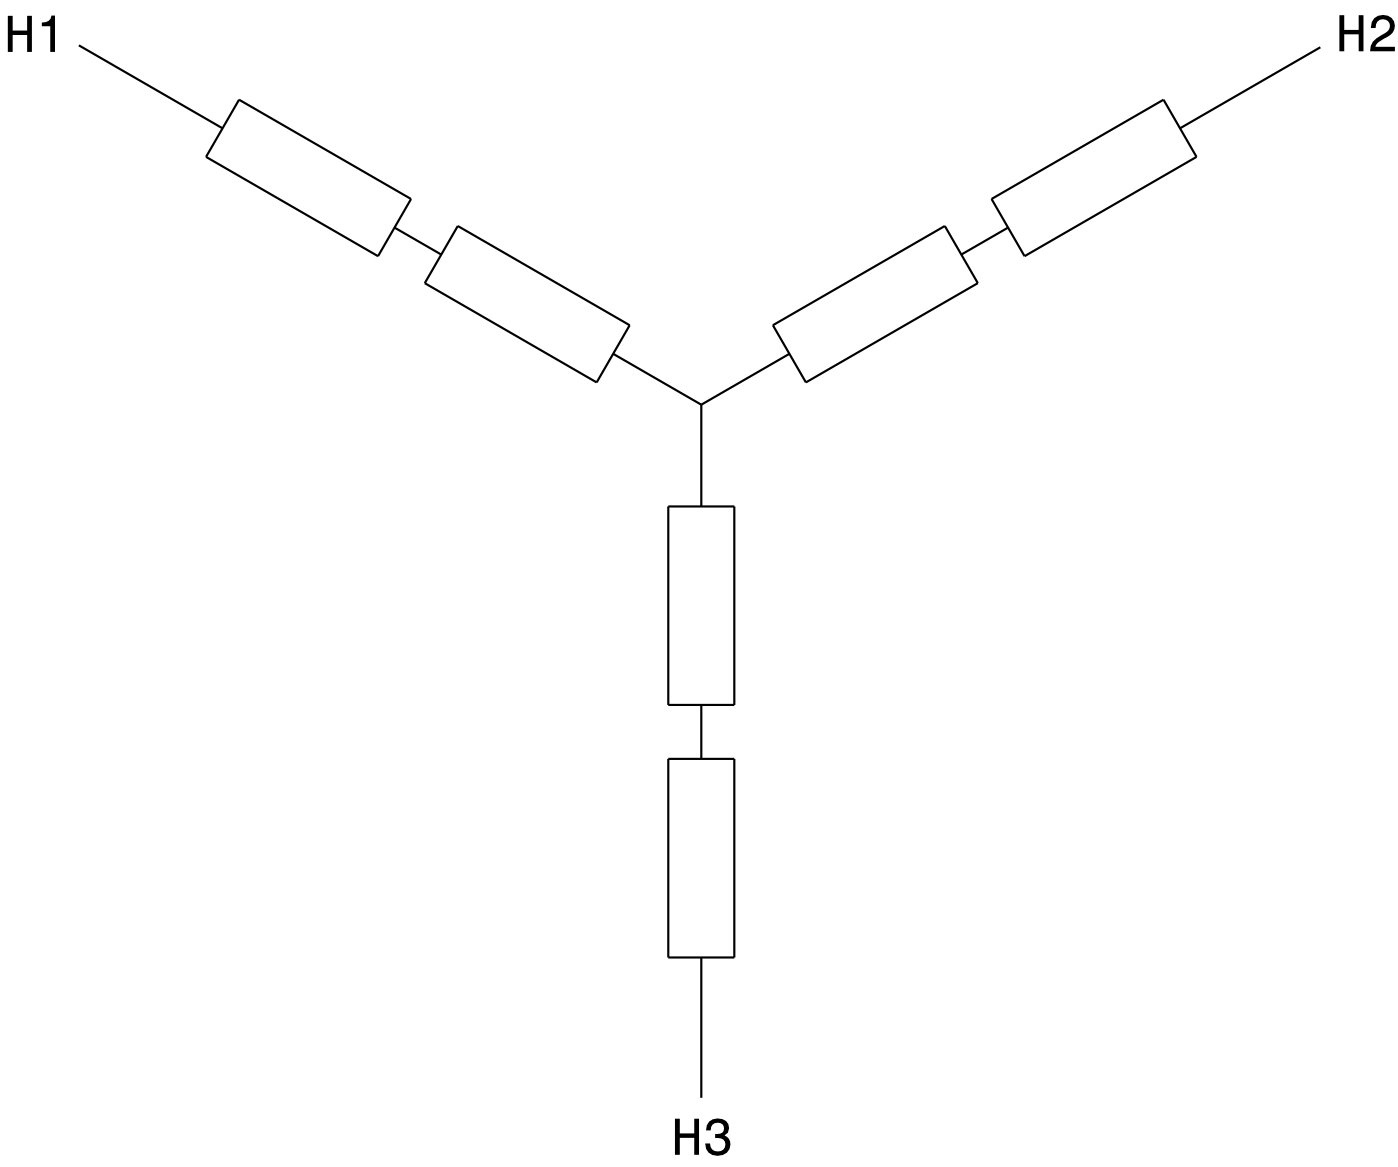


SPACE HEATER SCHEMATIC DIAGRAM  
480V, 1500WW, 3PH

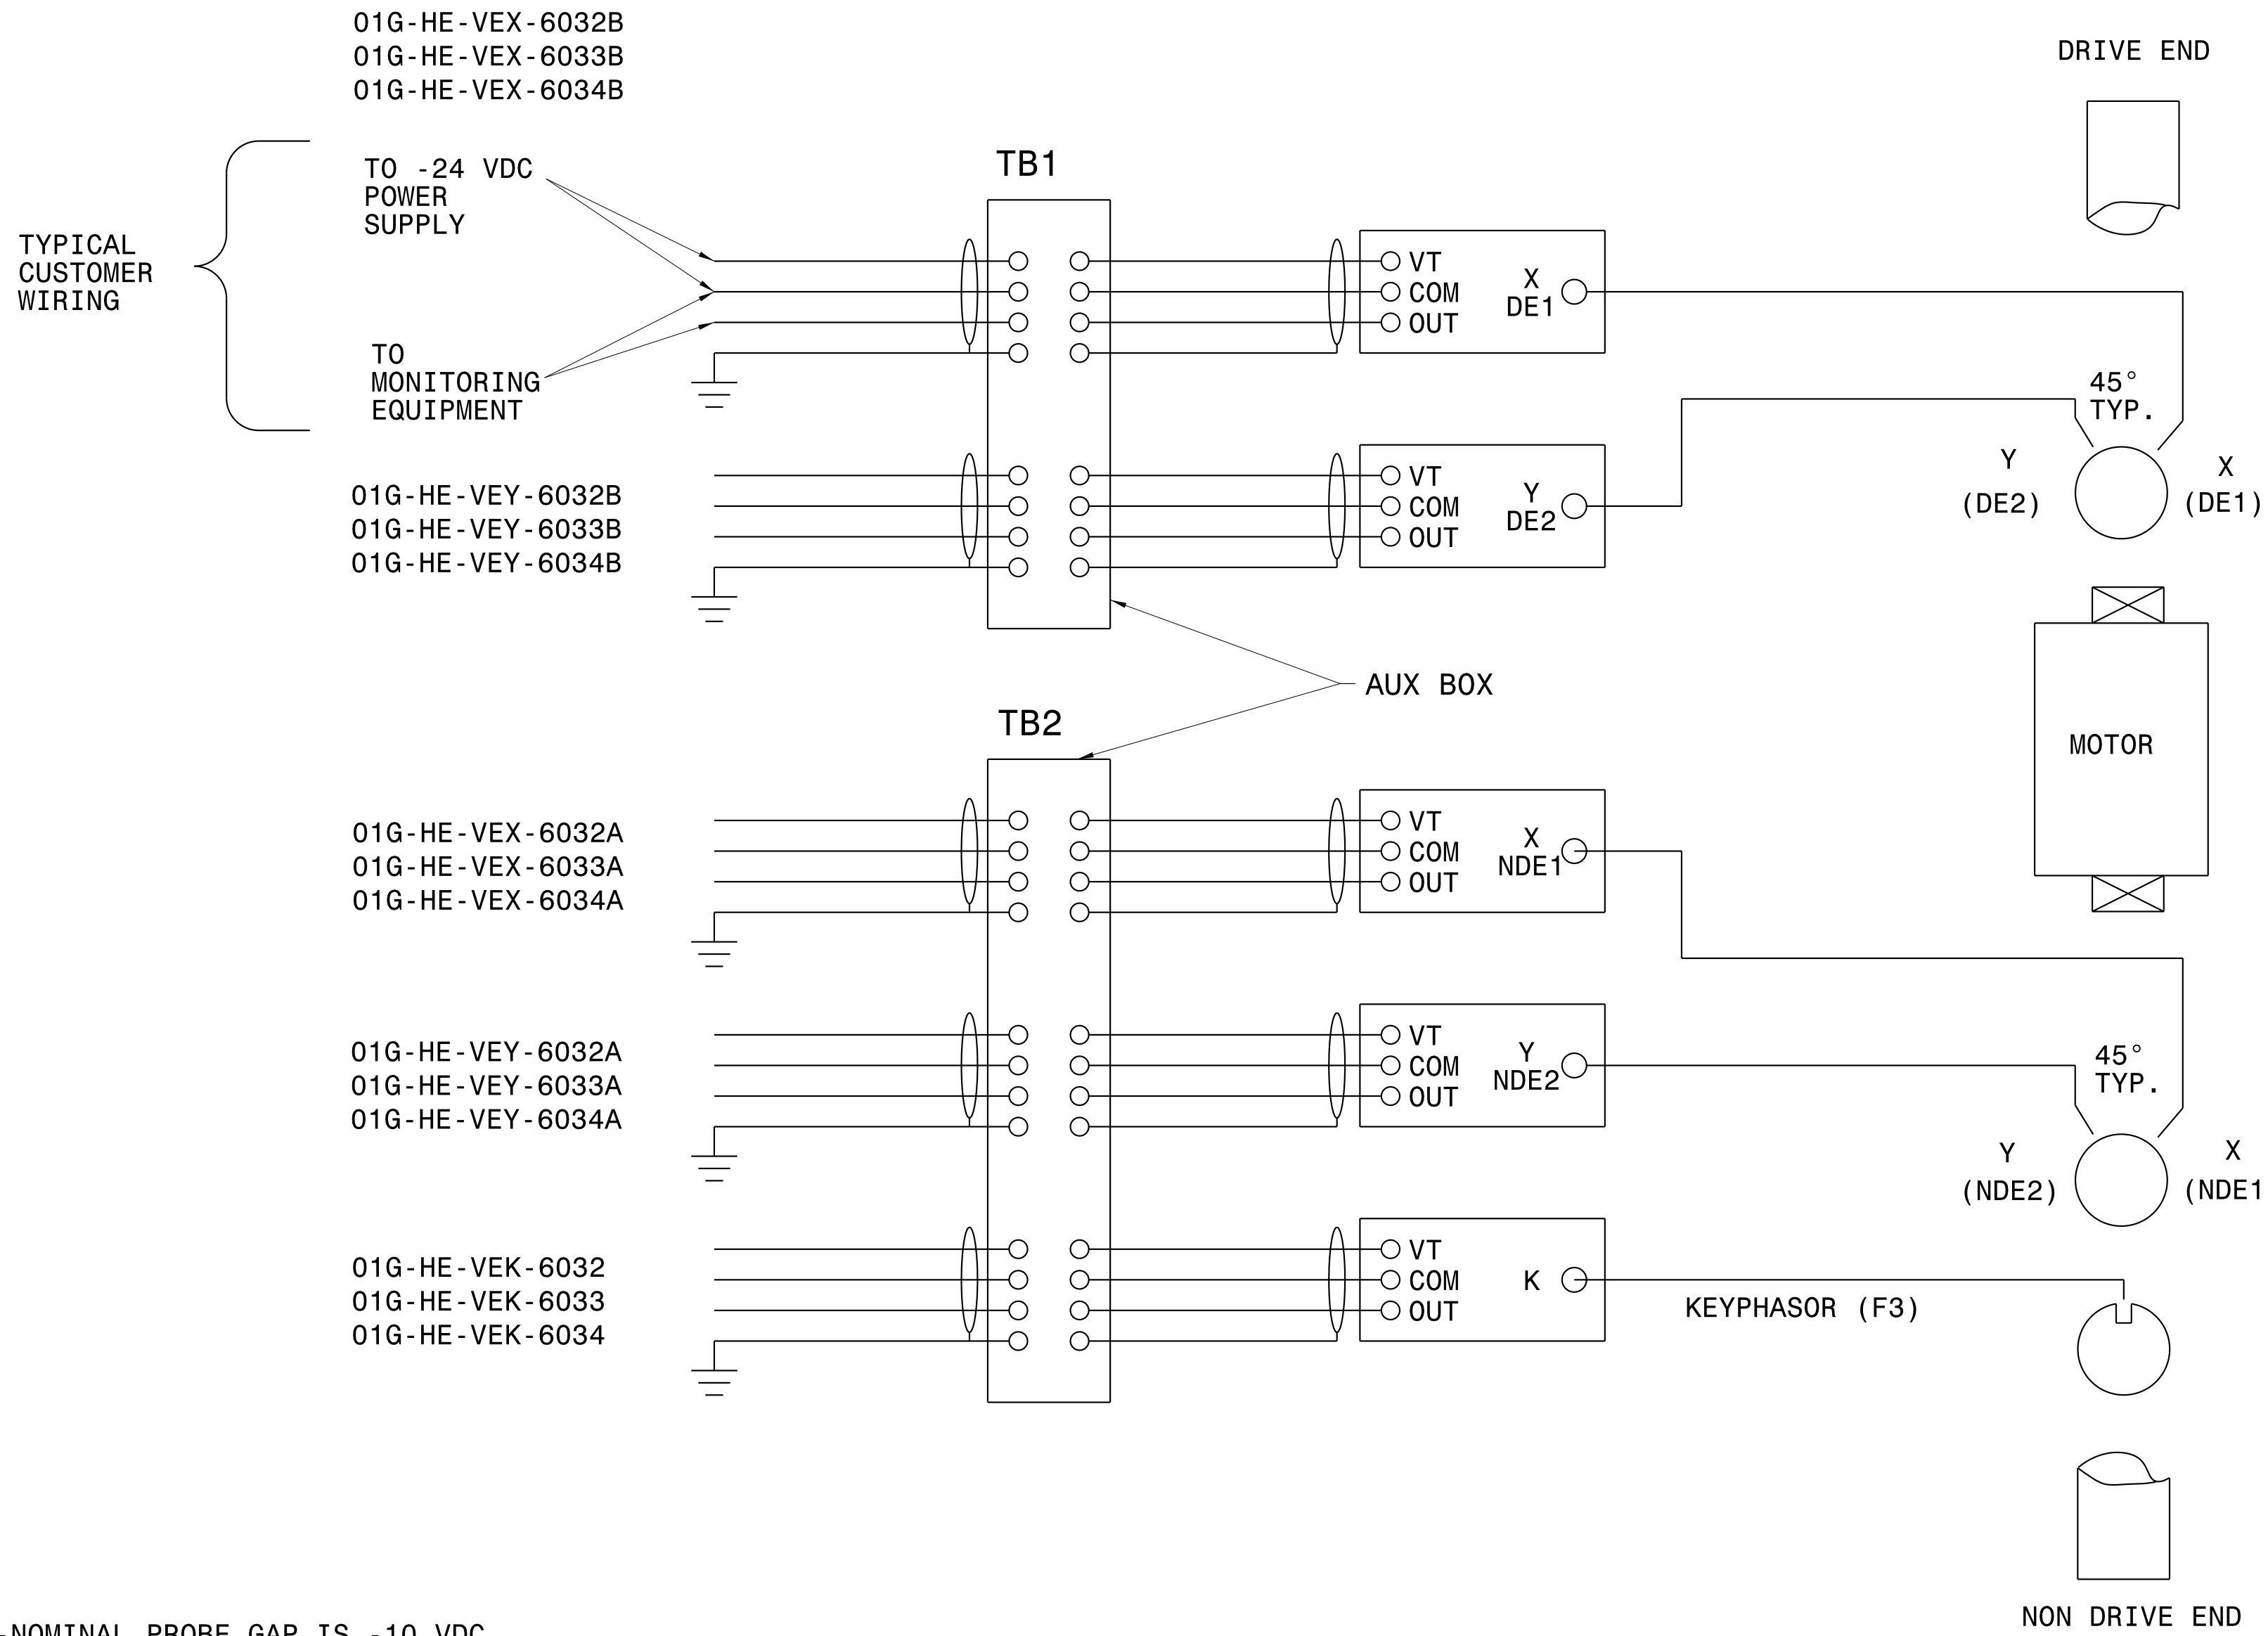

-NOMINAL PROBE GAP IS -10 VDC.  
- (REF. .050" AWAY FROM SHAFT SURFACE).  
-USE PLASTIC FEELER GAUGE TO SET  
GAP IF VOLT METER IS NOT AVAILABLE.  
WARNING: DO NOT CONTACT SHAFT WITH  
PROBE TIP. DAMAGE TO PROBE  
TIP COULD OCCUR.

SCHEMATIC VIBRATION PROBE W/KEY PHASOR

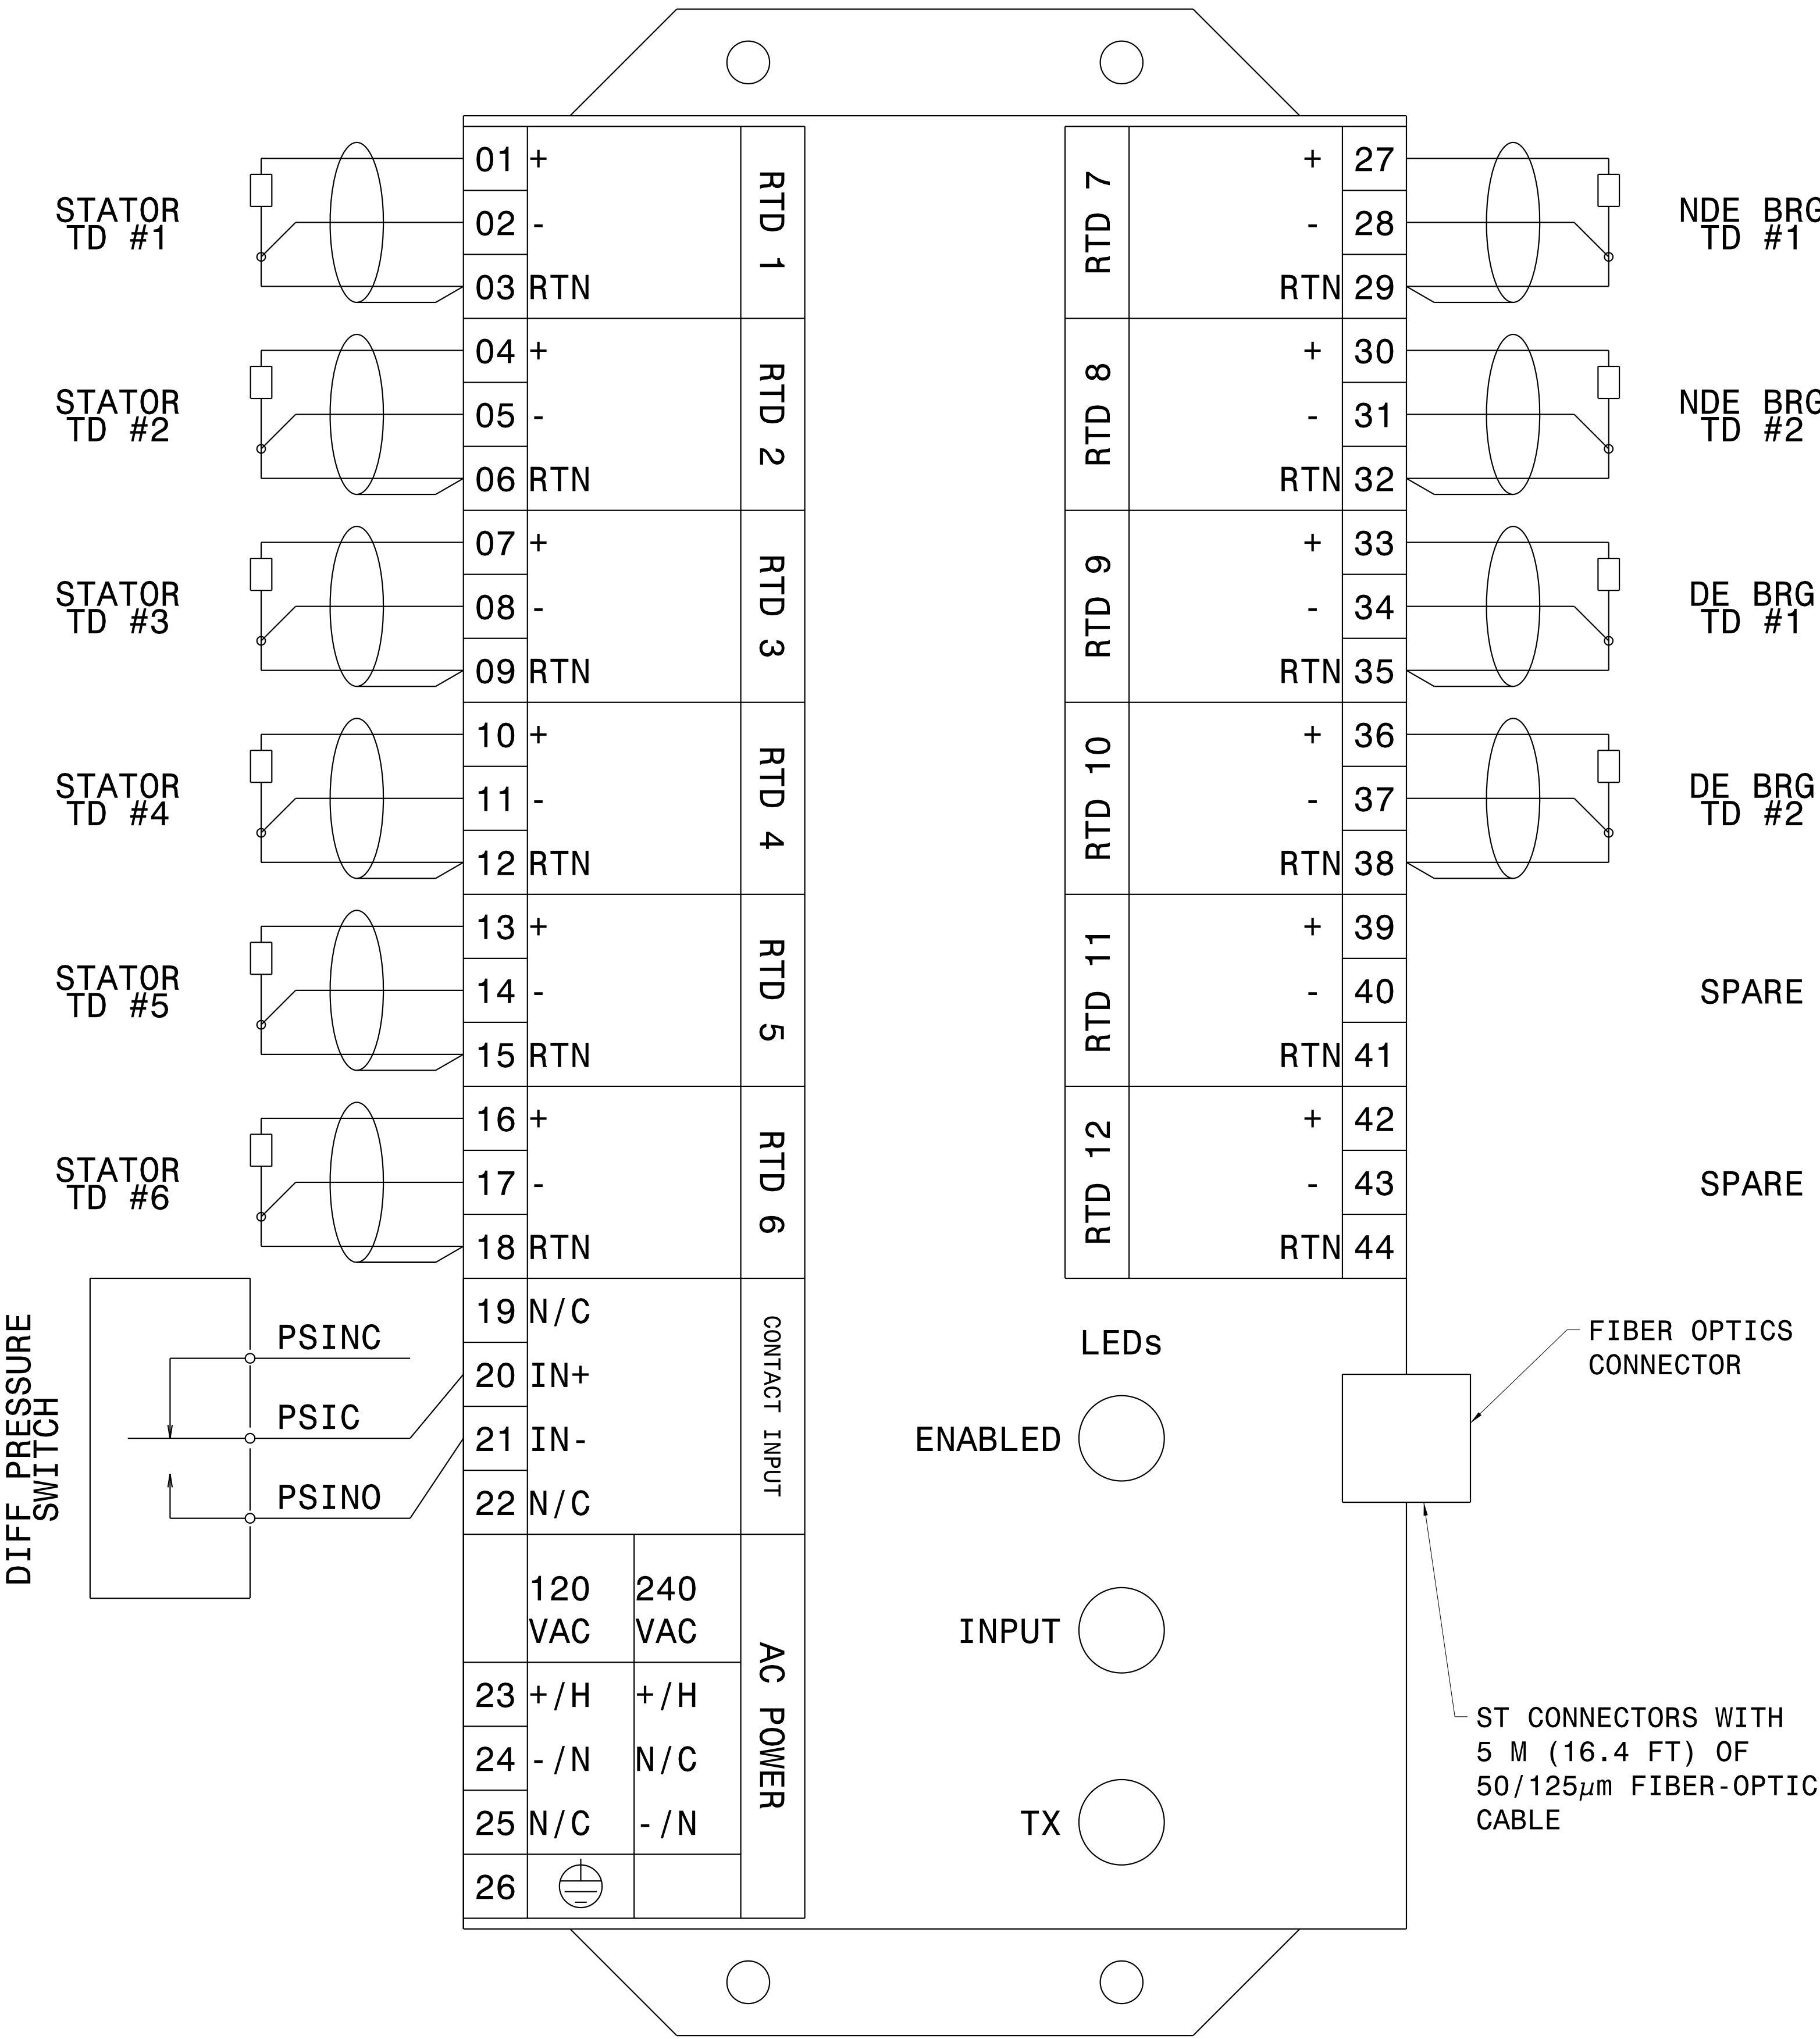

SCHWEITZER SEL-2600A01 RTD MODULE  
N=NEUTRAL, N/C=NO CONNECTION, RTN=RETURN

REV DATA	SEE SHEET 1.	
APPROX WEIGHTS: LBS	TECO-WESTINGHOUSE MOTOR COMPANY	REV NO
FRAME & STATOR 3910	TITLE OUTLINE	03
ROTOR 4190	WORLD SERIES, HORIZONTAL, AC INDUCTION MOTOR	
BRGS. & BRKTS. 1066	DIMENSIONS IN INCHES-SCALE NTS	
VENTILATION BOX 820	DFTR P. LAN 20110211 APPD L. OKOYE 20110211	
CONDUIT BOXES 275	CHKD APPD R. GLOVER 20110214	C9983AA
TOTAL WT. 12261	APPD APPD P. HOLLAND 20110211	SHEET 2 OF 2
	TECO-WESTINGHOUSE MOTOR COMPANY	ROUND ROCK, TEXAS USA