
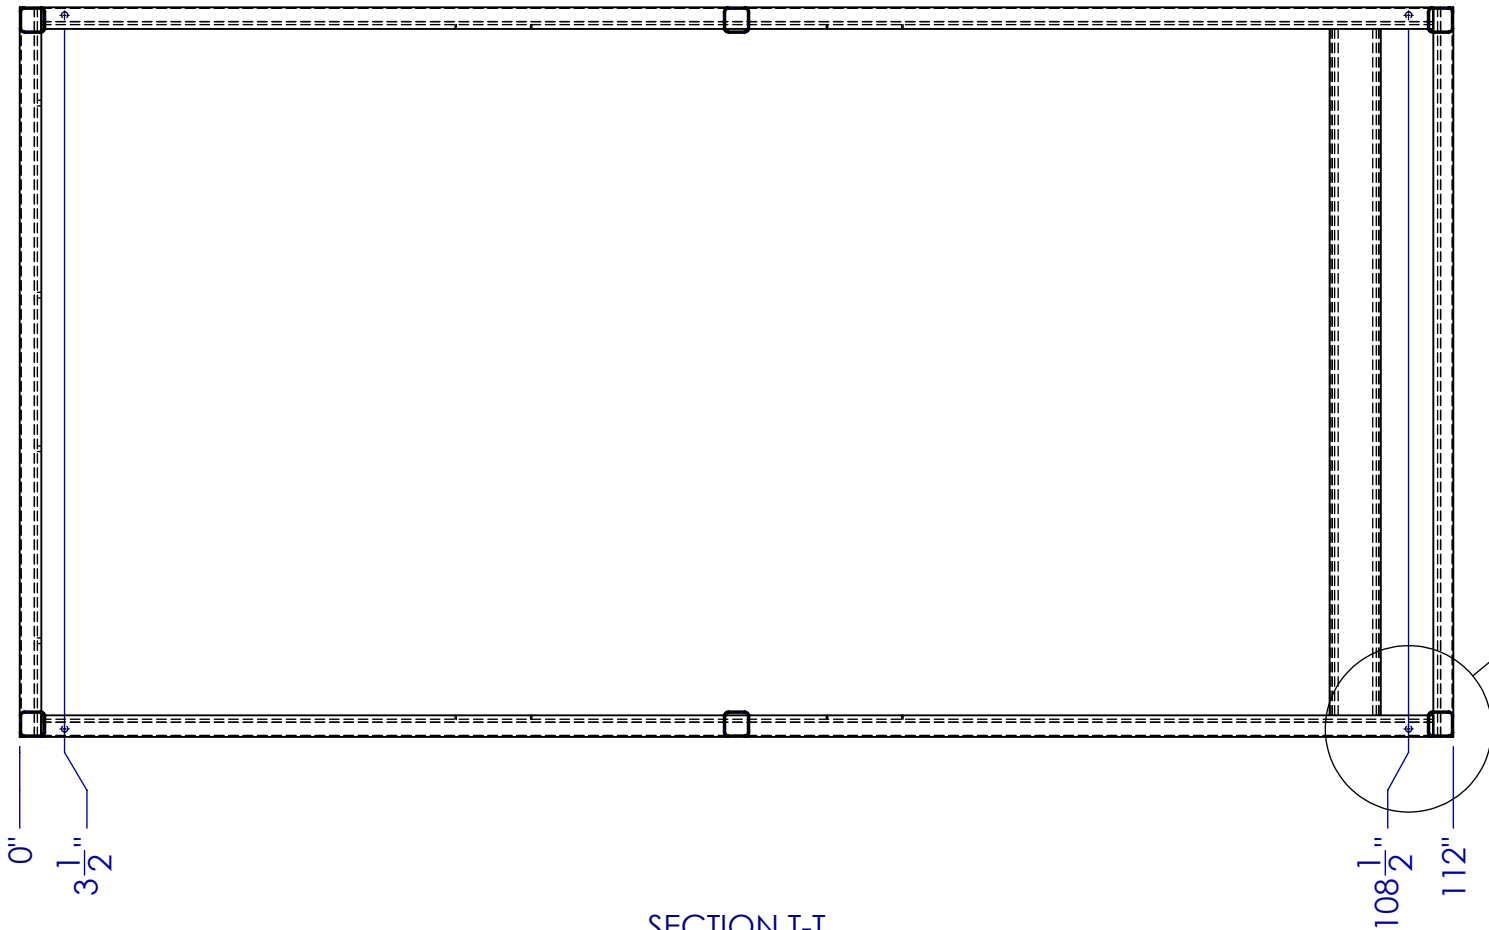
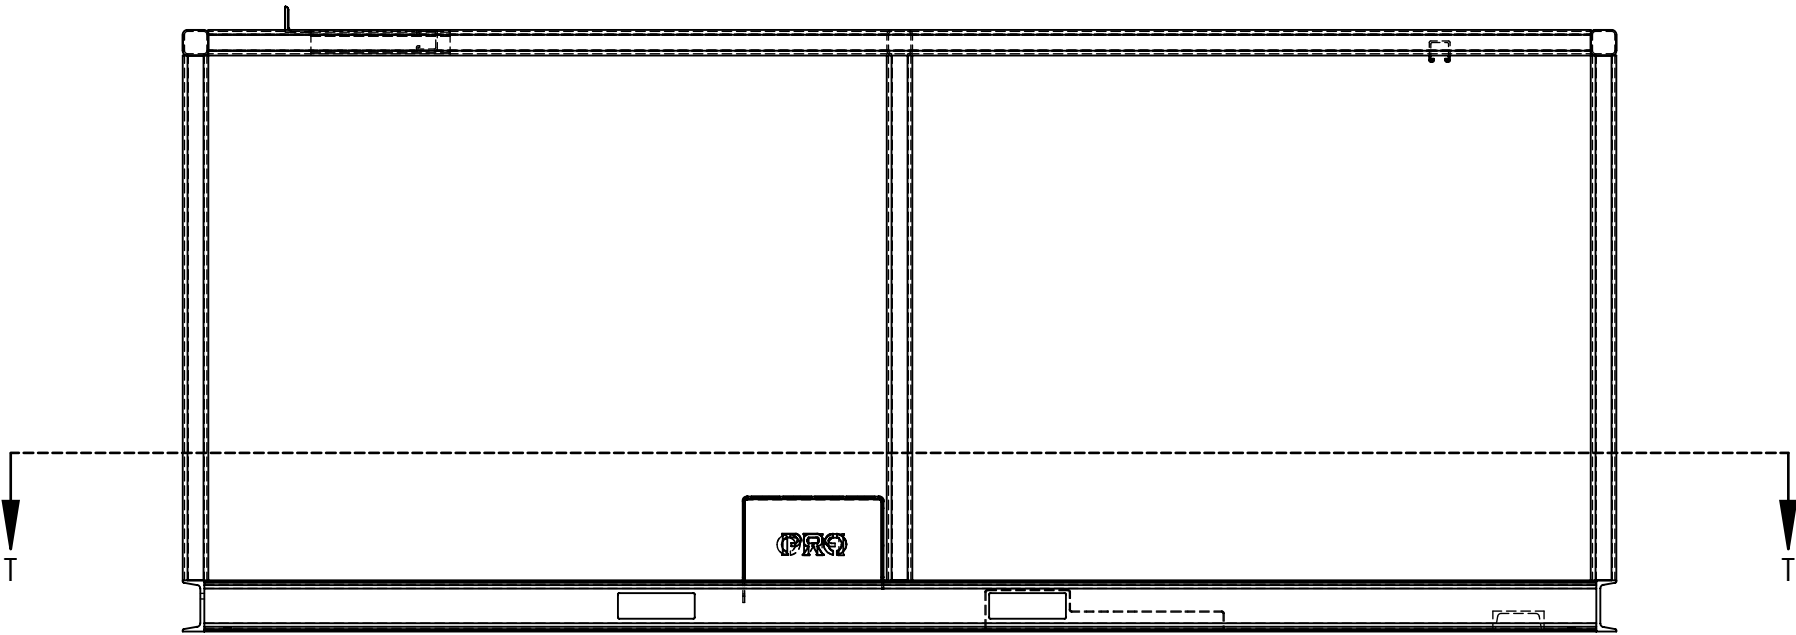


PLEASE NOTE OPTIONS ADDED TO THE CHILLER (PUMPS, HEAT RECOVERY, TANK SIZE, ETC.) MAY AFFECT THE EQUIPMENT CONFIGURATION (I.E. WEIGHT, DIMENSIONS, ELECTRICAL REQUIREMENTS, ETC.) PLEASE VERIFY FINAL CONFIGURATION OF EQUIPMENT.


ETHYLENE GLYCOL TO BE USED
ELLIOT CHILLER MONITORING PACKAGE (WIFI)



Customer:		
MSP INDUSTRIAL REFRIGERATION - SOFIX		
Mfg. Order No.:		
204475		
Model:		
PS215B98R4200-V-VD		
Drawn By:		
AC		
Date:		
8/14/20		
Rev.	Date	Description
△	-	-
Notes:		
PRO Refrigeration, Inc. 326 8th Street SW Auburn, WA 98001 T: (253) 735-9466 / F: (253) 735-2631 www.prochiller.com		
		



SECTION T-T
SCALE 1 : 15

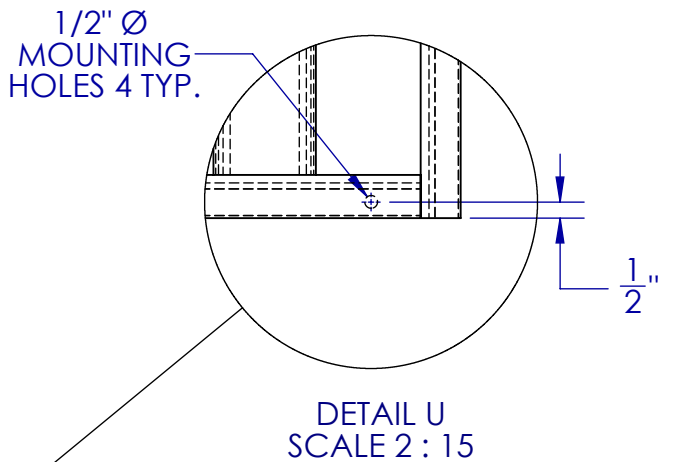

Customer:
MSP INDUSTRIAL REFRIGERATION
- SOFIX

Mfg. Order No.:
204475

Title:
**MOUNTING
LOCATIONS**

Drawn By:
AC

Date:
8/14/20

Rev.	Date	Description
△ -	-	-

Notes:

1. Note 1
2. Note 2
3. Note 3

PRO Refrigeration, Inc.
326 8th Street SW Auburn, WA 98001
T: (253) 735-9466 / F: (253) 735-2631
www.prochiller.com

