


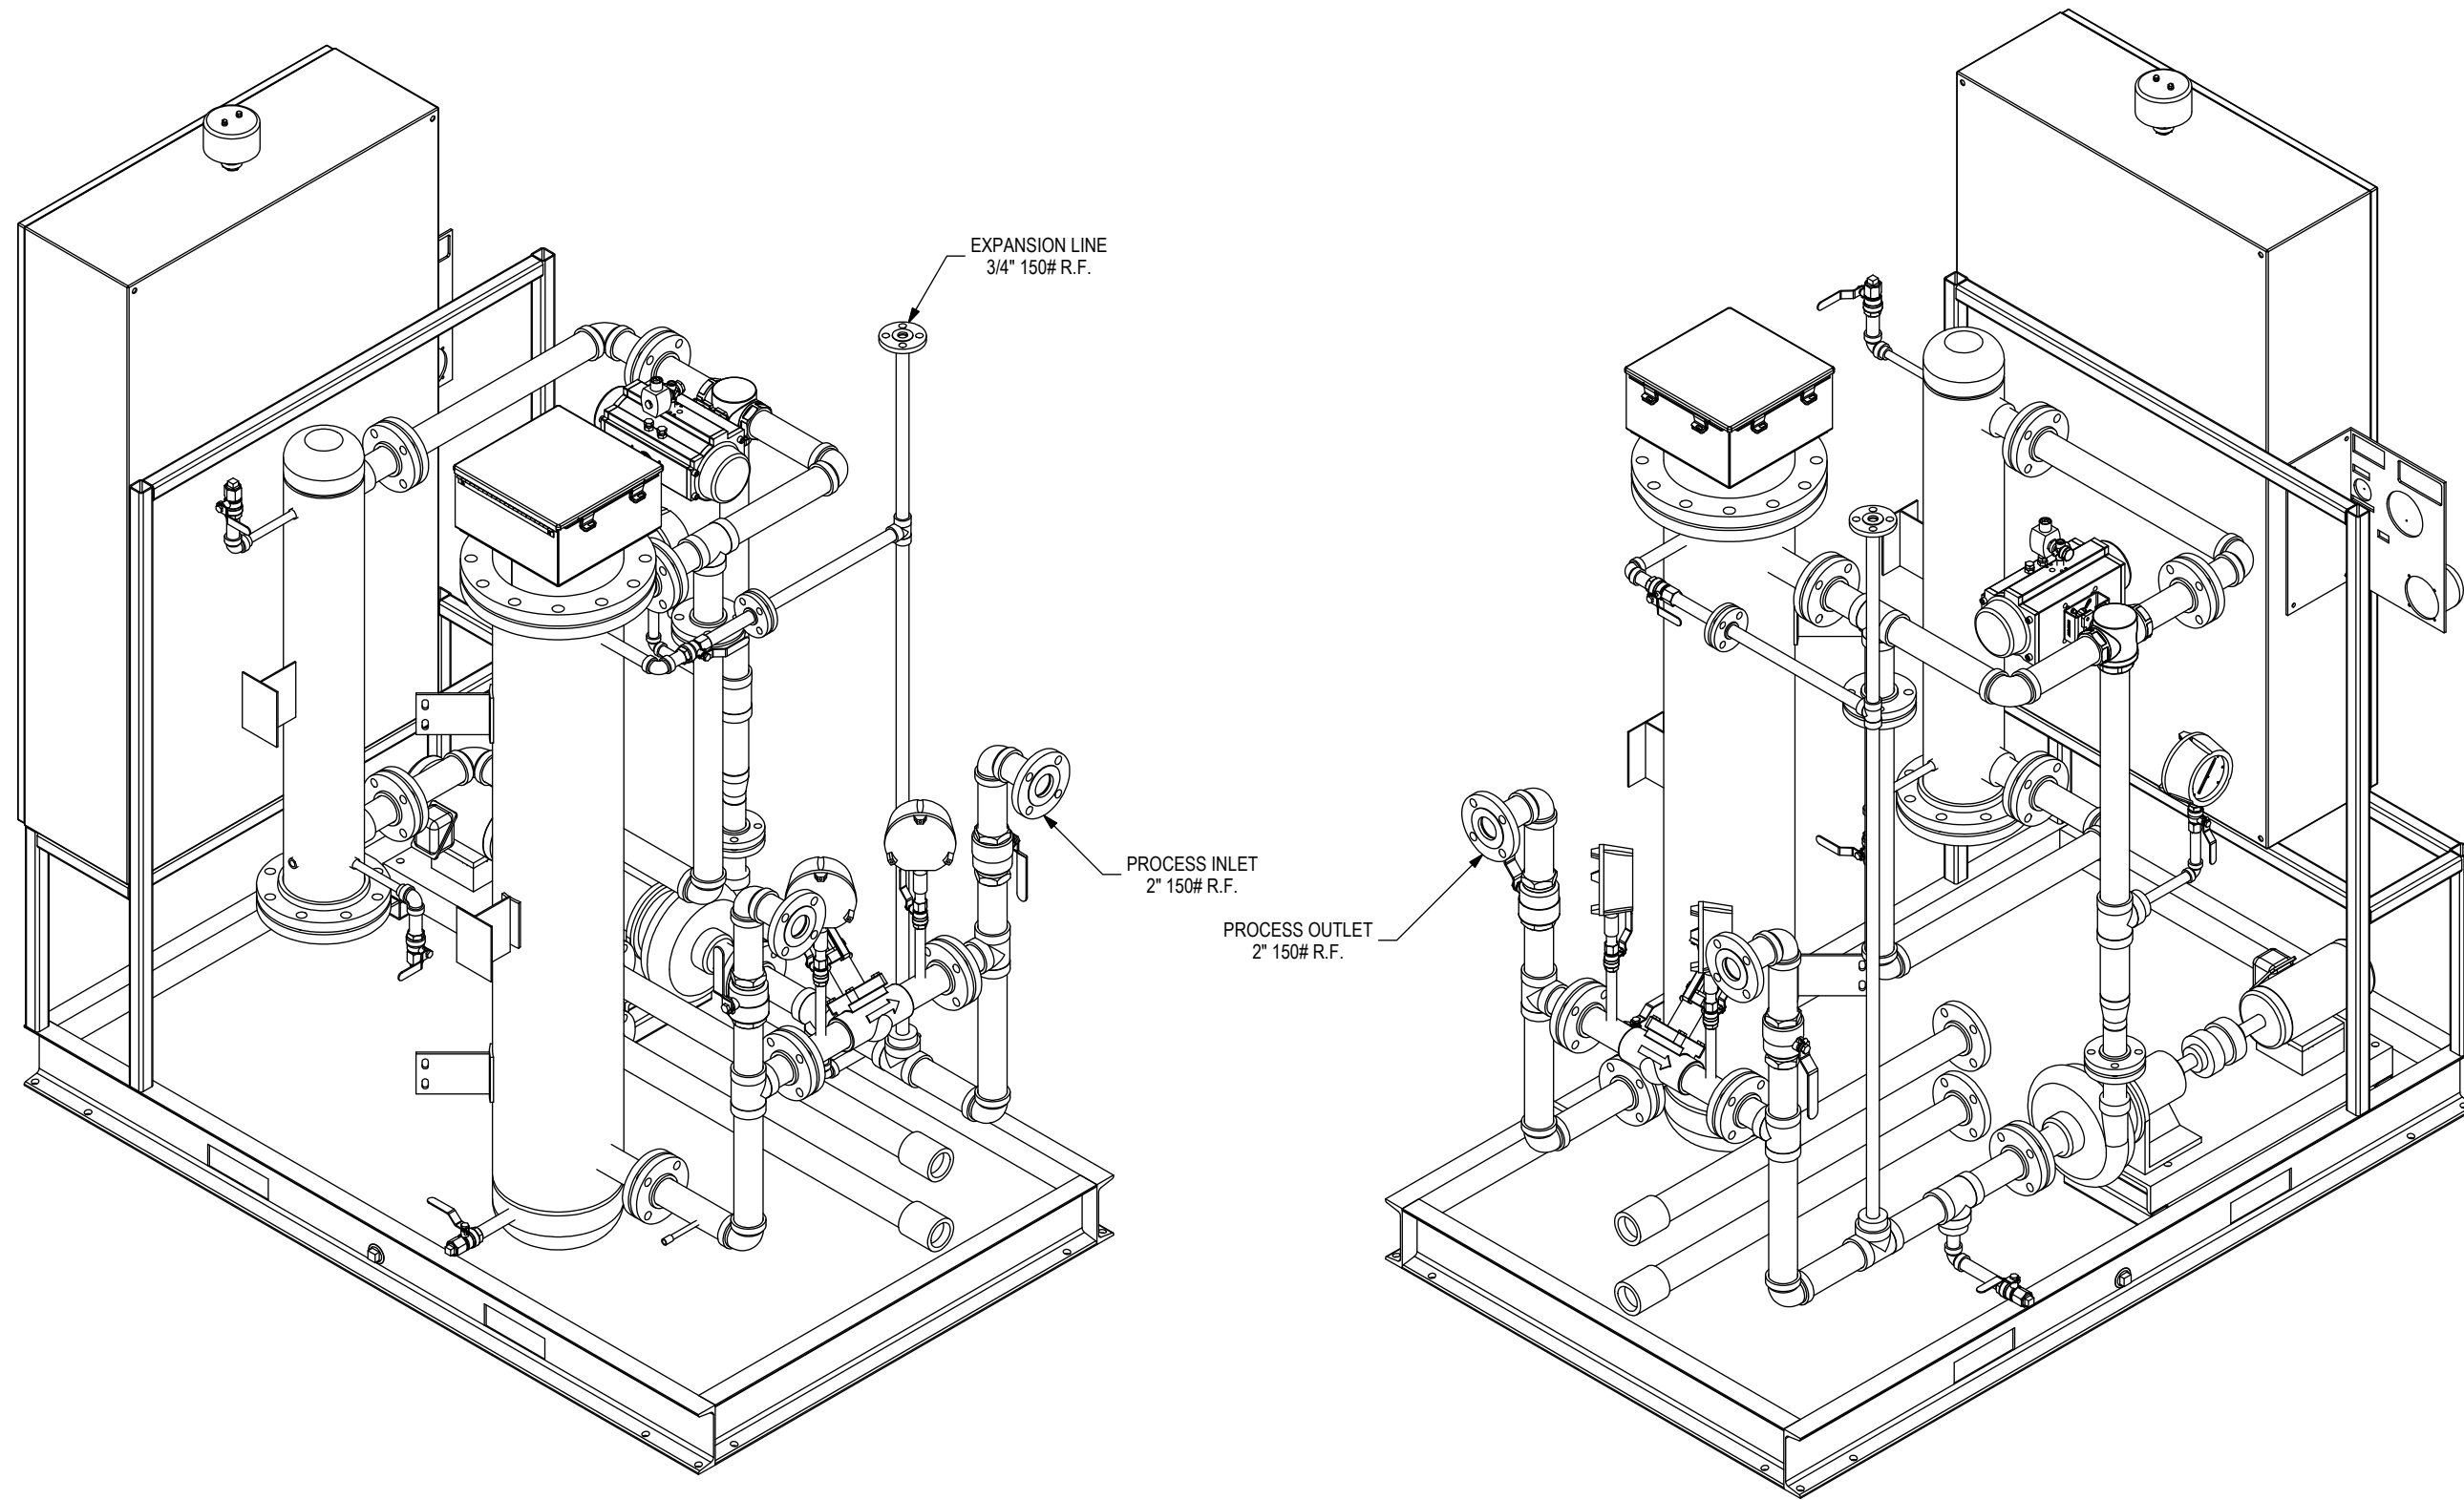

				GENERAL NOTES		SYSTEM DATA		DRAWING DESCRIPTION		TOL.		HEAT HEAT EXCHANGE AND TRANSFER, INC 500 SUPERIOR STREET - CARNEGIE, PA 15106 PHONE: 412-276-3388 FAX: 412-276-3397 WWW.HEAT-INC.COM				
1. REMOTE MOUNTED EXPANSION TANK SUPPLIED BY HEAT INC. SHIPPED LOOSE INSTALLED BY OTHERS.				2. SKID MOUNTED NEMA 4 CL.1 DIV.2 GRP C&D CONTROL CENTER AND TERMINAL HOUSING.		EMPTY WEIGHT: (LBS)		1800	GENERAL ARRANGEMENT		FRACTIONS: ±1/8 DECIMALS: ± .125 ANGLES: ±1°					
3. POWER SUPPLY: 480VAC, 3PH, 60HZ, 252FLA; 400AMP SERVICE REQUIRED.						FLUID CAPACITY: (GAL)		29			ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED					
4. PROCESS INSULATION TO BE FIBERGLASS WITH PVC.						DESIGN TEMP.: (°F)		250								
5. DESIGN FLUID: WATER/GLYCOL; SYSTEM TO BE RUN TESTED WITH WATER/GLYCOL.						DESIGN PRESS.: (PSIG)		150			PROPRIATARY/CONFIDENTIALITY NOTE:		HEAT APPROVALS			
6. SYSTEM TO BE PAINTED IN ACCORDANCE WITH HEAT, INC. CORPORATE STANDARD: "HEAT GREEN" COLOR.						RATING: (KW)		200			THIS DRAWING AND DESIGN, INCLUDING ALL PATENTED OR PATENTABLE FEATURES SEPARATELY OR COLLECTIVELY SHOWN, ARE THE PROPERTY OF HEAT EXCHANGE AND TRANSFER INC., AND ARE NOT TO BE REPRODUCED IN WHOLE OR PART NOR EMPLOYED FOR ANY PURPOSE OTHER THAN SPECIFICALLY PERMITTED IN WRITING BY HEAT EXCHANGE AND TRANSFER INC.		PROJECT LEAD: ADW			
7. HEATER CHAMBER AND EXPANSION TANK ASME CODE DESIGNATED.						VOLTAGE: (VAC)		480			DRAWN BY:		INITIALS		DATE	
						PHASE:		3			CHECKED BY:		CDW		12/3/2020	
				FREQUENCY: (HZ)		60	APPROVED BY:									
				CONTROL VOLTAGE: (VAC)/(VDC)		120VAC										
</																