





TIC1101

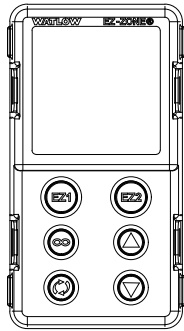


PLW1101




PLW1102




TAH1101




LAL1101




HSB1101




PBB1101




PBG1101




PLA1101



PLB1101




PBR1101




HSB1101



ES1101



HM1101

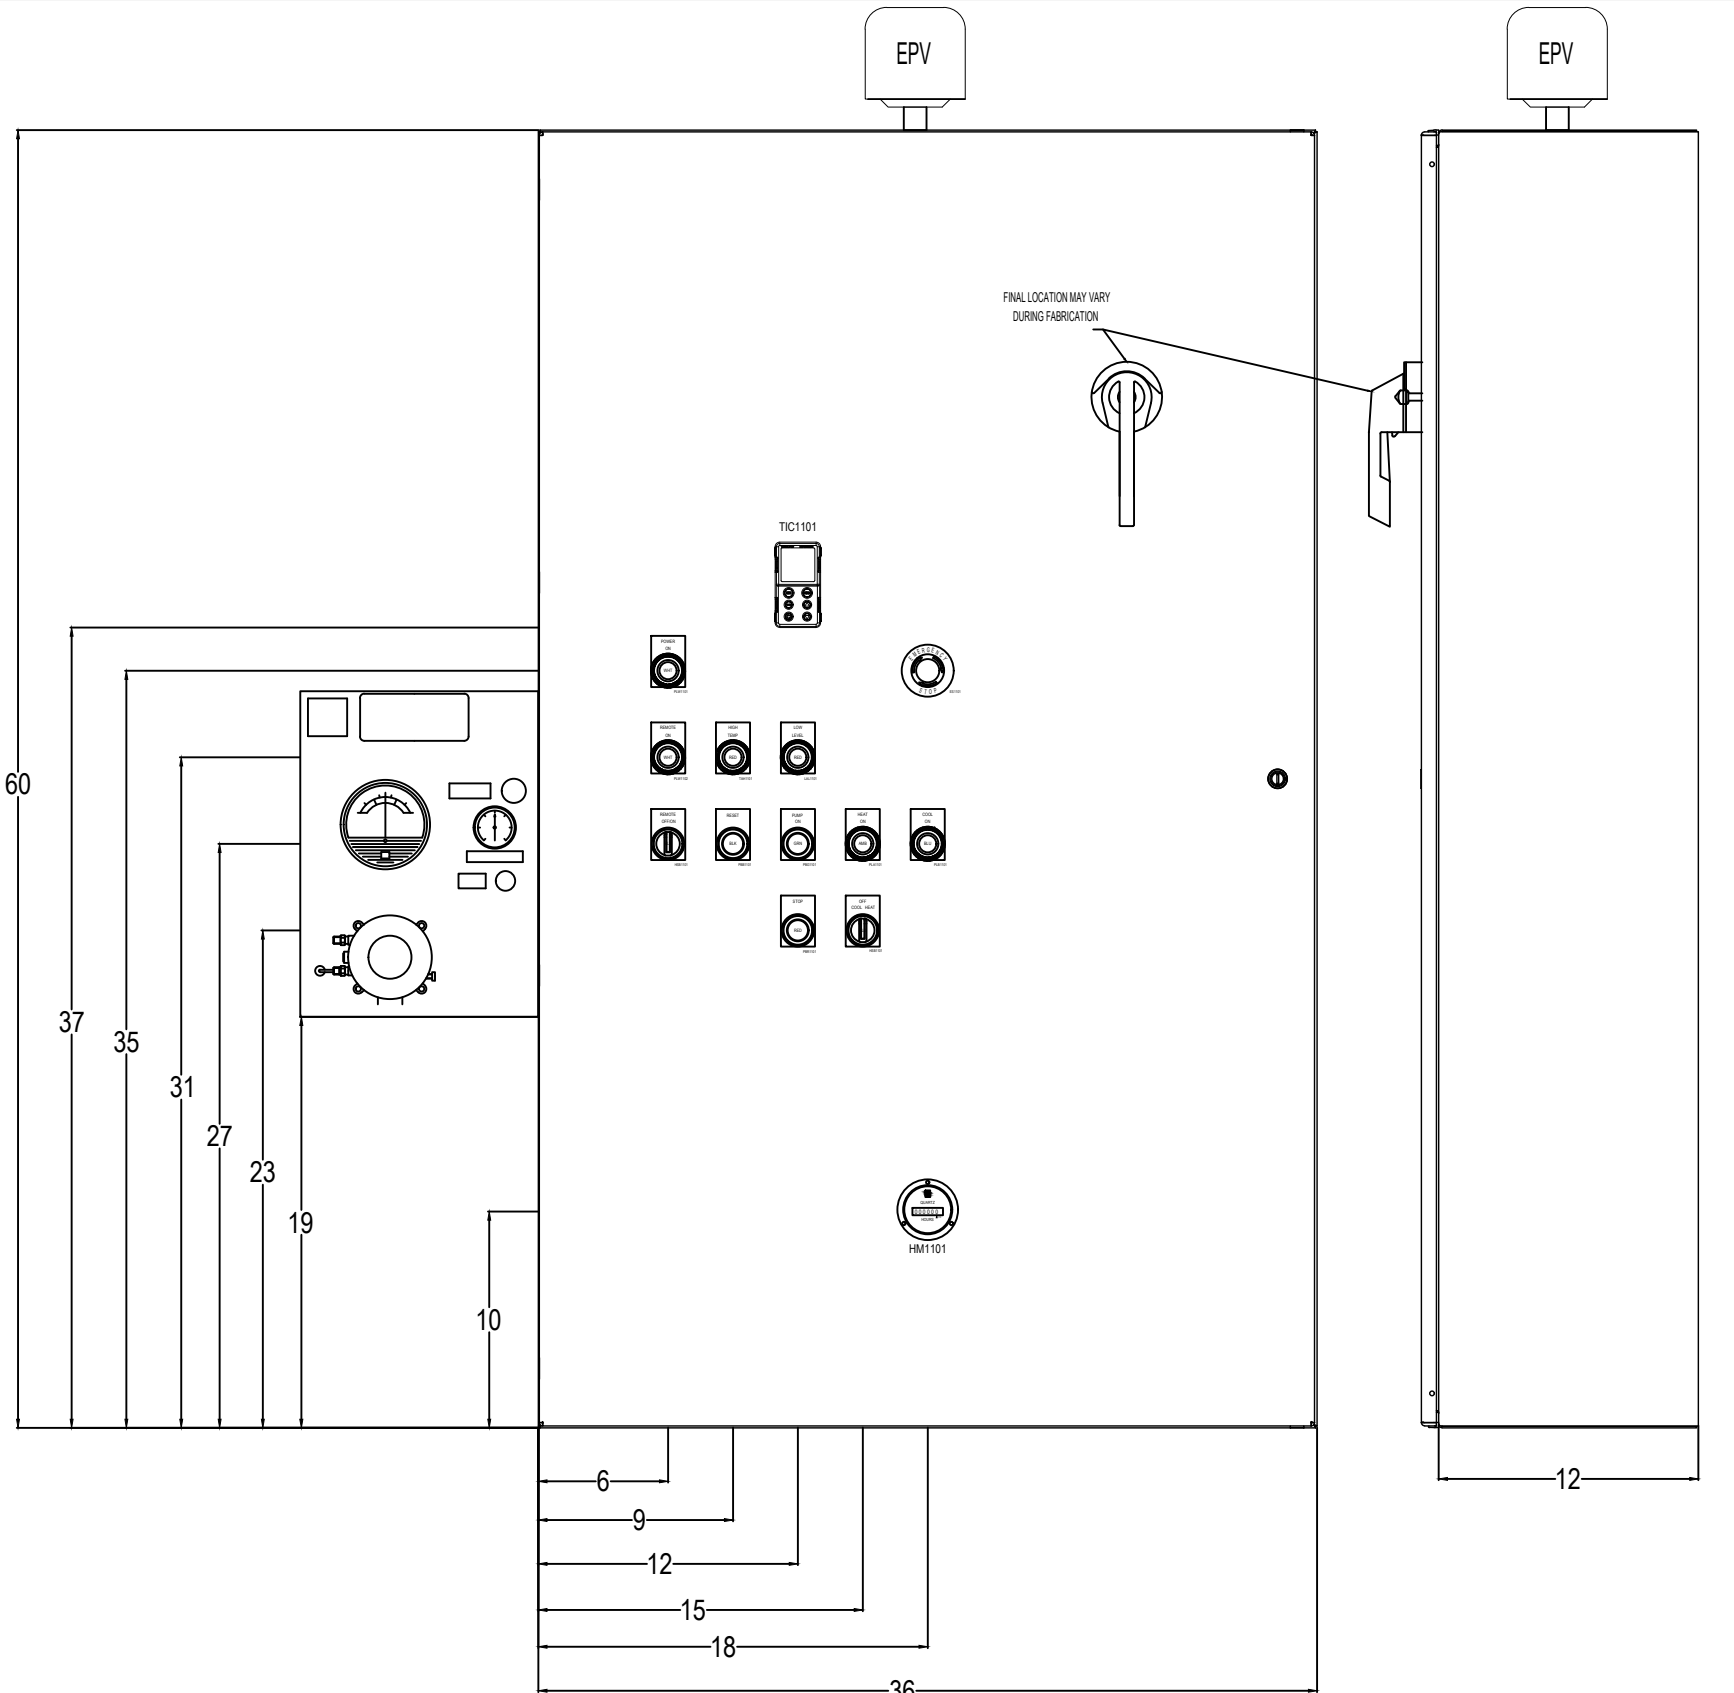

				GENERAL NOTES		SYSTEM DATA		DRAWING DESCRIPTION		TOL.		HEAT HEAT EXCHANGE AND TRANSFER, INC 500 SUPERIOR STREET - CARNEGIE, PA 15106 PHONE: 412-276-3388 FAX: 412-276-3397 WWW.HEAT-INC.COM			
				1. POWER SUPPLY BY OTHERS: 480VAC, 3PH, 60HZ, 256FLA CURRENT, 400AMP SERVICE, 5ka SCCR.		EMPTY WEIGHT: (LBS) N/A		DOOR AND LIGHT LAYOUT		FRACTIONS: $\pm 1/8$					
				2. HEATER RATING: 200kW, 241FLA.		FLUID CAPACITY: (GAL) N/A				DECIMALS: $\pm .125$					
				3. PUMP RATING: 10HP, 11.8FLA.		DESIGN TEMP.: (°F) N/A		ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED		ANGLES: $\pm 1^\circ$					
				4. SKID MOUNTED NEMA 4, SUITABLE FOR CLASS 1 DIV2 GRPS C & D CONTROL CENTER.		DESIGN PRESS.: (PSIG) N/A		PROPRIATARY/CONFIDENTIALITY NOTE: THIS DRAWING AND DESIGN, INCLUDING ALL PATENTED OR PATENTABLE FEATURES SEPARATELY OR COLLECTIVELY SHOWN, ARE THE PROPERTY OF HEAT EXCHANGE AND TRANSFER INC., AND ARE NOT TO BE REPRODUCED IN WHOLE OR PART NOR EMPLOYED FOR ANY PURPOSE OTHER THAN SPECIFICALLY PERMITTED IN WRITING BY HEAT EXCHANGE AND TRANSFER INC.		HEAT APPROVALS		MODEL NO.: CC04-548-ZP-483		SHT. #	
				5. ALL FUSING IS 100 KAIC OR BETTER.		RATING: (KW) N/A				PROJECT LEAD: PNM				DWG. NO.: 20-012956-1A-PC01	
				6. CONTROL CENTER PAINT TO BE IN ACCORDANCE WITH HEAT, INC STANDARD: SHERWIN WILLIAMS MACROPOXY 646 COLOR: HEAT GREEN / RAL6028.		VOLTAGE: (VAC) 480		DRAWN BY: JAH		INITIALS		DATE		N/A	
				7. DIMENSIONS ARE IN INCHES UNLESS OTHERWISE SPECIFIED.		PHASE: 3				CHECKED BY:		11-23-20		SIZE	
						FREQUENCY: (HZ) 60		APPROVED BY:						REV	
						CONTROL VOLTAGE: (VAC)/(VDC) 120VAC								D 0	